

REVIEW OF THE  
**2015 TEN-YEAR SITE PLANS**  
OF FLORIDA'S ELECTRIC UTILITIES



NOVEMBER 2015



# Table of Contents

---

List of Figures .....	iii
List of Tables .....	v
List of Ten-Year Site Plan Utilities .....	vi
<b>Executive Summary .....</b>	<b>1</b>
Review of the 2015 Ten-Year Site Plans .....	2
Future Concerns .....	5
Conclusion .....	5
<b>Introduction.....</b>	<b>7</b>
Statutory Authority .....	7
Additional Resources .....	9
Structure of the Commission’s Review .....	9
Conclusion .....	9
<b>Statewide Perspective .....</b>	<b>11</b>
<b>Load Forecasting.....</b>	<b>12</b>
Electric Customer Composition.....	12
Growth Projections .....	13
Peak Demand .....	14
Electric Vehicles .....	15
Demand-Side Management.....	16
Forecast Load & Peak Demand .....	18
<b>Renewable Generation.....</b>	<b>24</b>
Existing Renewable Resources .....	24
Non-Utility Renewable Generation .....	25
Customer Owned Generation.....	25
Utility-Owned Renewable Generation.....	26
Planned Renewable Resources .....	27
Renewable Outlook.....	30
<b>Traditional Generation.....</b>	<b>32</b>
Existing Generation .....	32
Impact of EPA Rules .....	33
Modernization and Efficiency Improvements .....	35
Planned Retirements .....	35
Reliability Requirements .....	36
Fuel Price Forecast.....	38
Fuel Diversity.....	39

## Table of Contents (cont.)

---

New Generation Planned .....	41
New Power Plants by Fuel Type.....	43
Commission’s Authority over Siting .....	43
Transmission .....	44
<b>Utility Perspectives.....</b>	<b>46</b>
Florida Power & Light Company (FPL).....	47
Duke Energy Florida, Inc. (DEF) .....	53
Tampa Electric Company (TECO) .....	58
Gulf Power Company (GPC).....	63
Florida Municipal Power Agency (FMPA) .....	68
Gainesville Regional Utilities (GRU).....	72
JEA.....	77
Lakeland Electric (LAK) .....	82
Orlando Utilities Commission (OUC) .....	86
Seminole Electric Cooperative (SEC) .....	91
City of Tallahassee Utilities (TAL) .....	96

## List of Figures

---

Figure 1: State of Florida - Growth in Customers and Sales .....	2
Figure 2: State of Florida - Natural Gas Contribution to Energy Consumption.....	3
Figure 3: State of Florida - Current and Projected Installed Capacity by Fuel.....	4
Figure 4: TYSP Utilities - Comparison of Reporting Electric Utility Size .....	8
Figure 5: State of Florida - Electric Customer Composition in 2014.....	12
Figure 6: National - Climate Data by State (Continental US) .....	13
Figure 7: State of Florida - Growth in Customers and Sales .....	13
Figure 8: TYSP Utilities - Example Daily Load Curves .....	14
Figure 9: TYSP Utilities - Daily Peak Demand (2014 Actual) .....	15
Figure 10: State of Florida - Historic & Forecast Seasonal Peak Demand & Annual Energy .....	20
Figure 11: State of Florida - Current and Projected Renewable Resources .....	27
Figure 12: State of Florida - Electric Utility Installed Capacity by Decade.....	33
Figure 13: State of Florida - Projected Reserve Margin by Season.....	37
Figure 14: TYSP Utilities - Average Reporting Electric Utility Fuel Price .....	38
Figure 15: TYSP Utilities - Fuel Price Comparison for Coal and Natural Gas .....	39
Figure 16: State of Florida - Natural Gas Contribution to Energy Consumption.....	40
Figure 17: State of Florida - Historic and Forecast Fuel Consumption.....	41
Figure 18: State of Florida - Current and Projected Installed Capacity by Fuel.....	42
Figure 19: FPL Growth Rate.....	47
Figure 20: FPL Demand and Energy Forecasts .....	48
Figure 21: FPL Reserve Margin Forecast.....	50
Figure 22: DEF Growth Rate.....	53
Figure 23: DEF Demand and Energy Forecasts .....	54
Figure 24: DEF Reserve Margin Forecast .....	56
Figure 25: TECO Growth Rate.....	58
Figure 26: TECO Demand and Energy Forecasts.....	59
Figure 27: TECO Reserve Margin Forecast .....	61
Figure 28: GPC Growth Rate.....	63
Figure 29: GPC Demand and Energy Forecasts .....	64
Figure 30: GPC Reserve Margin Forecast .....	66
Figure 31: FMPA Growth Rate.....	68
Figure 32: FMPA Demand and Energy Forecasts .....	69
Figure 33: FMPA Reserve Margin Forecast.....	71
Figure 34: GRU Growth Rate.....	72
Figure 35: GRU Demand and Energy Forecasts.....	73
Figure 36: GRU Reserve Margin Forecast .....	75

## List of Figures (cont.)

---

Figure 37: JEA Growth Rate.....	77
Figure 38: JEA Demand and Energy Forecasts .....	78
Figure 39: JEA Reserve Margin Forecast.....	80
Figure 40: LAK Growth Rate .....	82
Figure 41: LAK Demand and Energy Forecasts.....	83
Figure 42: LAK Reserve Margin Forecast.....	85
Figure 43: OUC Growth Rate .....	86
Figure 44: OUC Demand and Energy Forecasts.....	87
Figure 45: OUC Reserve Margin Forecast .....	89
Figure 46: SEC Growth Rate .....	91
Figure 47: SEC Demand and Energy Forecasts.....	92
Figure 48: SEC Reserve Margin Forecast .....	94
Figure 49: TAL Growth Rate.....	96
Figure 50: TAL Demand and Energy Forecasts .....	97
Figure 51: TAL Reserve Margin Forecast .....	99

## List of Tables

---

Table 1: State of Florida - Planned Units Requiring a Determination of Need.....	5
Table 2: TYSP Utilities - Estimated Number of Electric Vehicles by Service Territory .....	16
Table 3: TYSP Utilities - Estimated Electric Vehicle Annual Energy Consumption (GWh) .....	16
Table 4: TYSP Utilities – Accuracy of Retail Energy Sales Forecasts .....	22
Table 5: TYSP Utilities – Accuracy of Retail Energy Sales Forecasts – Annual Analysis.....	23
Table 6: State of Florida - Existing Renewable Resources.....	24
Table 7: State of Florida - Net Metering Growth .....	26
Table 8: TYSP Utilities - Planned Solar Installations .....	29
Table 9: State of Florida - Electric Generating Units to be Retired.....	36
Table 10: State of Florida - Planned Natural Gas Units .....	44
Table 11: State of Florida - Planned Transmission Lines.....	45
Table 12: FPL Energy Consumption by Fuel Type .....	49
Table 13: FPL Generation Resource Changes .....	52
Table 14: DEF Energy Consumption by Fuel Type .....	55
Table 15: DEF Generation Resource Changes .....	57
Table 16: TECO Energy Consumption by Fuel Type .....	60
Table 17: TECO Generation Resource Changes .....	62
Table 18: GPC Energy Consumption by Fuel Type .....	65
Table 19: GPC Generation Resource Changes .....	67
Table 20: FMPA Energy Consumption by Fuel Type .....	70
Table 21: GRU Energy Consumption by Fuel Type .....	74
Table 22: GRU Generation Resource Changes .....	76
Table 23: JEA Energy Consumption by Fuel Type .....	79
Table 24: JEA Generation Resource Changes .....	81
Table 25: LAK Energy Consumption by Fuel Type.....	84
Table 26: OUC Energy Consumption by Fuel Type .....	88
Table 27: OUC Generation Resource Changes .....	90
Table 28: SEC Energy Consumption by Fuel Type.....	93
Table 29: SEC Generation Resource Changes.....	95
Table 30: TAL Energy Consumption by Fuel Type .....	98
Table 31: TAL Generation Resource Changes .....	100

## List of Ten-Year Site Plan Utilities

Name	Abbreviation
<b>Investor-Owned Electric Utilities</b>	
Florida Power & Light Company	FPL
Duke Energy Florida, Inc.	DEF
Tampa Electric Company	TECO
Gulf Power Company	GPC
<b>Municipal Electric Utilities</b>	
Florida Municipal Power Agency	FMPA
Gainesville Regional Utilities	GRU
JEA	JEA
Lakeland Electric	LAK
Orlando Utilities Commission	OUC
City of Tallahassee Utilities	TAL
<b>Rural Electric Cooperatives</b>	
Seminole Electric Cooperative	SEC



# Executive Summary

---

Integrated resource planning (IRP) is a utility process that includes a cost-effective combination of demand-side resources and supply-side resources. While each utility has slightly different approaches to IRP, some things are consistent across the industry. Each utility must update their load forecast assumptions based on Commission decisions in various dockets, such as demand-side management goals. Changes in government mandates, such as appliance efficiency standards, building codes, and environmental requirements, must also be considered. Other input assumptions such as demographics, financial parameters, generating unit operating characteristics, etc. are more fluid and do not require prior approval by the Commission. Each utility then conducts a reliability analysis to determine when resources may be needed to meet expected load. Next, an initial screening of demand-side and supply-side resources is performed to find candidates that meet the expected resource need. The demand-side and supply-side resources are combined in various scenarios to decide which combination meets the need most cost-effectively. After the completion of all these components, utility management reviews the results of the varying analyses and a utility's Ten-Year Site Plan is produced as the culmination of the IRP process. Commission Rules also require the utilities to provide aggregate data which provides an overview of the State of Florida electric grid.

The Commission's annual review of utility Ten-Year Site Plans is non-binding but it does provide state, regional, and local agencies advance notice of proposed power plants and transmission facilities. Any concerns identified during the review of the utilities' Ten-Year Site Plans may be addressed by the Commission at a formal public hearing, such as a power plant need determination proceeding. While Florida Statutes and Commission Rules do not specifically define IRP, they do provide a solid framework for flexible, cost-effective utility resource planning. In this way, the Commission fulfills its oversight and regulatory responsibilities while leaving day-to-day planning and operations to utility management.

Pursuant to Section 186.801(1), Florida Statutes (F.S.), each generating electric utility must submit to the Florida Public Service Commission (Commission) a Ten-Year Site Plan which estimates the utility's power generating needs and the general locations of its proposed power plant sites over a ten-year planning horizon. The Ten-Year Site Plans of Florida's electric utilities summarize the results of each utility's IRP process and are designed to give state, regional, and local agencies advance notice of proposed power plants and transmission facilities. The Commission is required to perform a preliminary study of each plan and classify each one as either "suitable" or "unsuitable." This document represents the review of the 2015 Ten-Year Site Plans for Florida's electric utilities, filed by eleven reporting utilities.<sup>1</sup>

All findings of the Commission are made available to the Florida Department of Environmental Protection (DEP) for its consideration at any subsequent certification proceedings pursuant to the

---

<sup>1</sup> Investor-owned utilities filing 2015 TYSPs include Florida Power & Light Company (FPL), Duke Energy Florida, Inc. (DEF), Tampa Electric Company (TECO), and Gulf Power Company (GPC). Municipal utilities filing 2015 TYSPs include Florida Municipal Power Agency (FMPA), Gainesville Regional Utilities (GRU), JEA (formerly Jacksonville Electric Authority), Lakeland Electric (LAK), Orlando Utilities Commission (OUC), and City of Tallahassee Utilities (TAL). Seminole Electric Cooperative (SEC) also filed a 2015 TYSP.

Power Plant Siting Act or the Transmission Line Siting Act.<sup>2</sup> In addition, this document is also provided to the Florida Department of Agriculture and Consumer Services pursuant to Section 377.703(2)(e), F.S., which requires the Commission to provide a report on electricity and natural gas forecasts.


## Review of the 2015 Ten-Year Site Plans

The Commission has divided this review into two portions: a Statewide Perspective, which covers the whole of Florida, and Utility Perspectives, which address each of the reporting utilities. From a statewide perspective, the Commission has reviewed the implications of the combined trends of Florida’s electric utilities regarding load forecasting, renewable generation, and traditional generation.

### Load Forecasting

Forecasting load growth is an important component of the IRP process for Florida’s electric utilities. Florida’s electric utilities reduce the rate of growth in customer peak demand and annual energy consumption through demand-side management. The Commission, through its authority granted by Sections 366.80 through 366.85 and Section 403.519, F.S., otherwise known as the Florida Energy Efficiency and Conservation Act (FEECA), encourages demand-side management by establishing goals for the reduction of seasonal peak demand and annual energy consumption for those utilities under its jurisdiction. Based on current projections, Florida’s electric utilities anticipate exceeding the historic 2007 peak by 2017. Figure 1 below, details these trends.

**Figure 1: State of Florida - Growth in Customers and Sales**

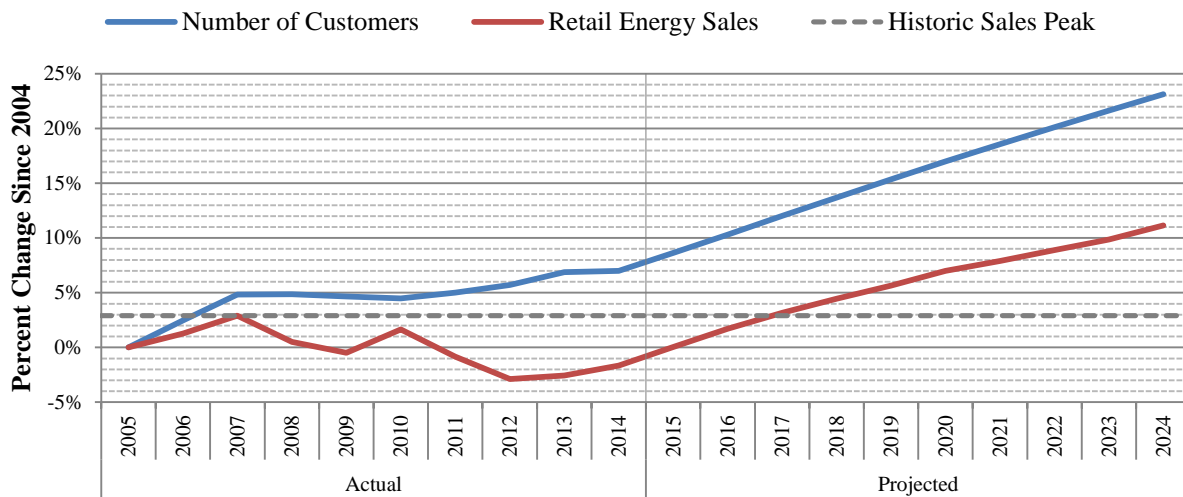

Source: 2015 FRCC Load and Resource Plan

<sup>2</sup> The Power Plant Siting Act is Sections 403.501 through 403.518, F.S. Pursuant to Section 403.519, F.S., the Commission is the exclusive forum for the determination of need for an electrical power plant. The Transmission Line Siting Act is Sections 403.52 through 403.5365, F.S. Pursuant to Section 403.537, F.S., the Commission is the sole forum for the determination of need for a transmission line.

**Renewable Generation**


Renewable resources continue to expand in Florida, with approximately 1,640 MW of renewable generating capacity currently installed in Florida. The majority of installed renewable capacity is represented by biomass and municipal solid waste, making up approximately 60 percent of Florida’s renewables. Other major renewable types, in order of capacity contribution, include waste, heat, solar, hydroelectric, and landfill gas. Notably, Florida had 80 MW of demand-side renewable energy systems installed and using net metering by the end of 2014, an increase in capacity of 27 percent from 2013.

Over the next 10 years, Florida’s electric utilities have reported that 1,566 MW of additional renewable generation is planned in Florida, excluding any potential net metering additions. Over 1,100 MW of the projected capacity additions are solar facilities, which is the largest amount ever included in the utilities’ Ten-Year Site Plans. Some utilities are including a portion of these solar resources as a firm resource for reliability considerations for the first time. Reasons given for these changes are a continued reduction in the price of solar facilities, availability of utility property with access to the grid, and actual performance data obtained from some pilot programs. If these conditions continue, cost-effective forms of renewable generation will continue to improve the state’s fuel diversity and reduce dependence on fossil fuels.

**Traditional Generation**

Generating capacity within the State of Florida is anticipated to grow to meet the increase in customer demand, with approximately 11,548 MW of new utility-owned generation added over the planning horizon. This figure represents a decrease from the previous year, which estimated the need for about 12,570 MW new generation. Natural gas remains the dominant fuel over the planning horizon, with usage in 2014 at approximately 60 percent of the state’s net energy for load (NEL). Figure 2 illustrates the use of natural gas as a generating fuel for electricity production in Florida. Natural gas usage is expected to grow slowly.


**Figure 2: State of Florida - Natural Gas Contribution to Energy Consumption**

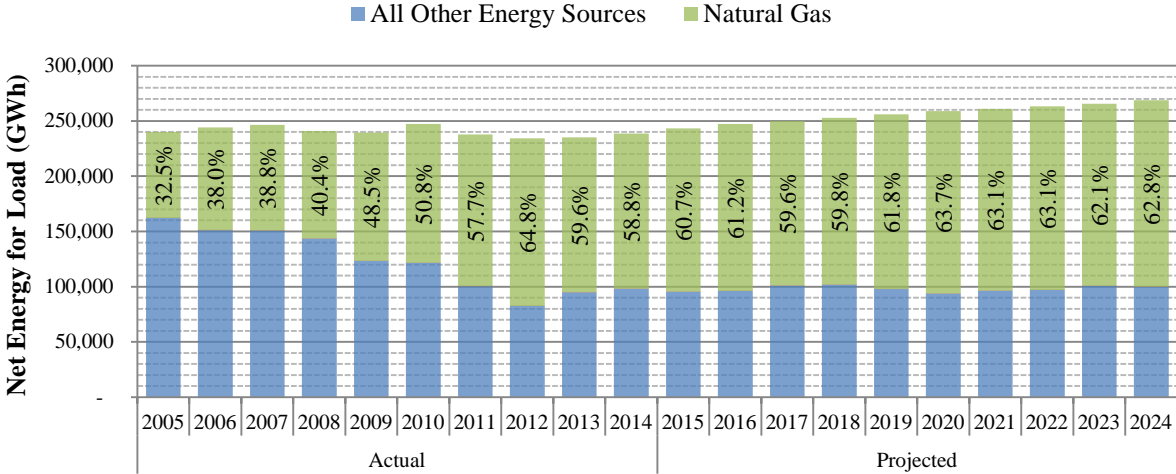

Source:2005-2015 FRCC Load and Resource Plan

Based on the 2015 Ten-Year Site Plans, Figure 3, below illustrates the present and future aggregate capacity mix of the State of Florida. The capacity values in Figure 3 incorporate all proposed additions, changes, and retirements planned during the ten-year period. As in previous planning cycles, natural gas-fired generating units make up a majority of the generation additions and now represent a majority of capacity within the state.

**Figure 3: State of Florida - Current and Projected Installed Capacity by Fuel**

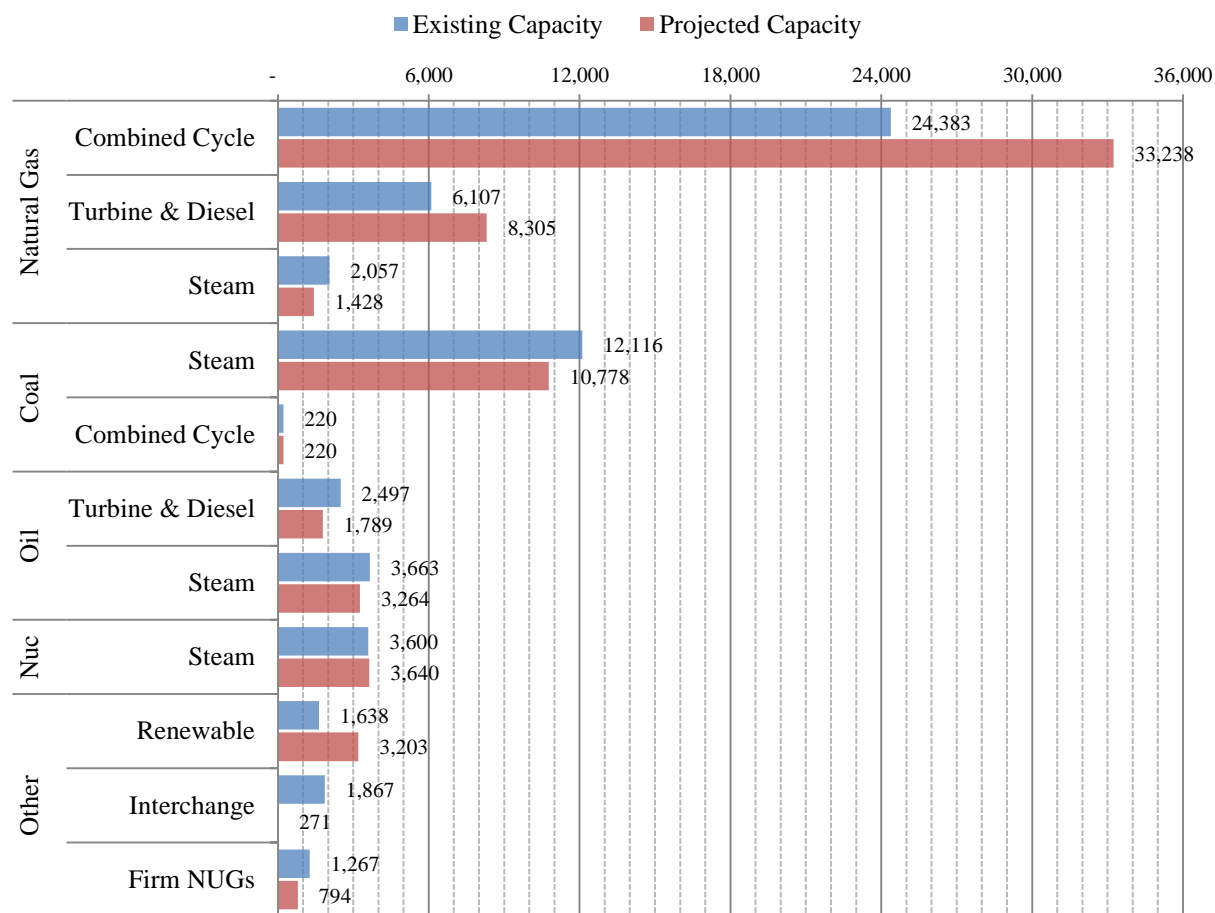

Source: 2015 FRCC Load and Resource Plan and TYSP Data Responses

As noted previously, the primary purpose of this review of the utilities' plans is to provide information regarding new electric power plants for local and state agencies to assist in the certification process. Table 1 below, displays those generation facilities that have not yet received from the Commission, a determination of need. A petition for a determination of need is generally anticipated at four years in advance of the in-service date for a natural gas-fired combined cycle unit.

---

**Table 1: State of Florida - Planned Units Requiring a Determination of Need**

Year	Utility Name	Unit Name	Fuel & Unit Type	Net Capacity (Sum MW)	Notes
2019	FPL	Okeechobee	Natural Gas Combined Cycle	1,622	Docket No. 150196-EI
2021	SEC	Unnamed	Natural Gas Combined Cycle	649	
2023	FPL	Unknown	Natural Gas Combined Cycle	1,317	
2023	OUC	Unknown	Natural Gas Combined Cycle	285	

Source: 2015 Ten Year Site Plans

---

## Future Concerns

Florida's electric utilities must also consider environmental concerns associated with existing generators and planned generation to meet Florida's electric needs. The U.S. Environmental Protection Agency (EPA) has finalized or proposed several new rules in recent years that have a sizeable impact on Florida's existing generation fleet, as well as on its proposed new facilities.

Notably, the EPA finalized a rule in August 2015, associated with carbon pollution for existing power plants, also known as the Clean Power Plan. Because of the Clean Power Plan's implementation schedules, these EPA Rules, though they may have a significant effect on Florida's electric utilities, are not considered as part of this review. The Commission anticipates that the utilities' 2016 Ten-Year Site Plans will include more discussion of potential impacts from the Clean Power Plan.

## Conclusion

The Commission has reviewed the 2015 Ten-Year Site Plans and finds that the projections of load growth appear reasonable. The reporting utilities have identified sufficient additional generation facilities to maintain an adequate supply of electricity at a reasonable cost. The Commission will continue to monitor the impact of current and proposed EPA Rules and the state's dependence on natural gas for electricity production.

Based on its review, the Commission finds the 2015 Ten-Year Site Plans to be suitable for planning purposes. Since the Plans are not a binding plan of action for electric utilities, the Commission's classification of these Plans as suitable or unsuitable does not constitute a finding or determination in docketed matters before the Commission. The Commission may address any concerns raised by a utility's Ten-Year Site Plan at a public hearing.



# Introduction

---

Integrated resource planning (IRP) is a term used to describe a utility planning process to insure reliable and affordable electric service. Each utility must periodically update their load forecast assumptions and combine demand-side and supply-side resources in various scenarios to decide which combination meets the need most cost-effectively. The Ten-Year Site Plans (TYSPs or Plans) of Florida's electric utilities are the culmination of an integrated resource plan which is designed to give state, regional, and local agencies advance notice of proposed power plants and transmission facilities. The Commission receives comments from these agencies regarding any issues with which they may have concerns. The Plans are planning documents that contain tentative data that is subject to change by the utilities upon written notification to the Commission.

For any new proposed power plants and transmission facilities, certification proceedings under the Power Plant Siting Act, Sections 403.501 through 403.518, Florida Statutes (F.S.), or the Transmission Line Siting Act, Sections 403.52 through 403.5365, F.S., will include more detailed information than is provided in the Plans. The Commission is the exclusive forum for determination of need for electrical power plants, pursuant to Section 403.519, F.S., and for transmission lines, pursuant to Section 403.537, F.S. The Plans are not intended to be comprehensive, and therefore may not have sufficient information to allow regional planning councils, water management districts, and other reviewing state and local agencies to evaluate site-specific issues within their respective jurisdictions. Other regulatory processes may require the electric utilities to provide additional information as needed.

## **Statutory Authority**


All major generating electric utilities are required by Section 186.801, F.S., to submit at least every two years, for review a Ten-Year Site Plan to the Commission. Based on these filings, the Commission performs a preliminary study of each Plan and makes a non-binding determination as to whether it is suitable or unsuitable. The results of the Commission's study are contained in this report, the Review of the 2015 Ten-Year Site Plans, and are forwarded to the Florida Department of Environmental Protection for use in subsequent proceedings. In addition, Section 377.703(2)(e), F.S., requires the Commission to collect and analyze energy forecasts, specifically for electricity and natural gas, along with the Department of Agriculture and Consumer Services. The Commission has adopted Rules 25-22.070 through 25-22.072, Florida Administrative Code (F.A.C.) in order to fulfill these statutory requirements and provide a solid framework for flexible, cost-effective utility resource planning. In this way, the Commission fulfills its oversight and regulatory responsibilities while leaving day-to-day planning and operations to utility management.

## ***Applicable Utilities***

Florida is served by 58 electric utilities, including 5 investor-owned utilities, 35 municipal utilities, and 18 rural electric cooperatives. Pursuant to Rule 25-22.071(1), F.A.C., only generating electric utilities with an existing capacity above 250 megawatts (MW) or a planned unit with a capacity of 75 MW or greater are required to file with the Commission a Ten-Year Site Plan every year.

In 2015, 11 utilities met these requirements and filed a Ten-Year Site Plan, including 4 investor-owned utilities, 6 municipal utilities, and 1 rural electric cooperative. The investor-owned utilities, in order of size, are Florida Power & Light Company (FPL), Duke Energy Florida, Inc. (DEF), Tampa Electric Company (TECO), and Gulf Power Company (GPC). The municipal utilities, in alphabetical order, are Florida Municipal Power Agency (FMPA), Gainesville Regional Utilities (GRU), JEA (formerly Jacksonville Electric Authority), Lakeland Electric (LAK), Orlando Utilities Commission (OUC), and City of Tallahassee Utilities (TAL). The sole rural electric cooperative filing a 2015 Plan is Seminole Electric Cooperative (SEC). Collectively, these utilities are referred to as the Ten-Year Site Plan Utilities (TYSP Utilities).

Figure 4 below, illustrates the comparative size of the TYSP Utilities, in terms of each utility’s percentage share of the state’s retail energy sales in 2014. Combined, the reporting investor-owned utilities account for 78.3 percent of the state’s retail energy sales. Non-reporting utilities make up approximately 1.8 percent of the State’s retail energy sales.

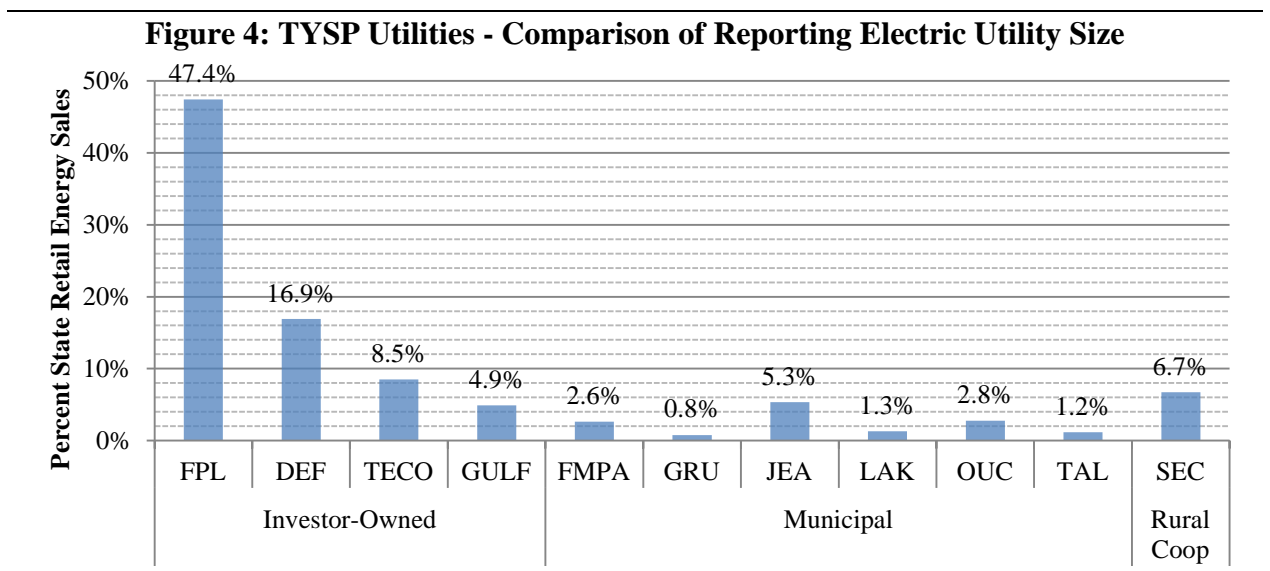

Source: 2015 Ten-Year Site Plans, 2015 Load & Resource Plan

**Required Content**

The Commission requires each reporting utility to provide information on a variety of topics. Schedules describe the utility’s existing generation fleet, customer composition, demand and energy forecasts, fuel requirements, reserve margins, changes to existing capacity, and proposed power plants and transmission lines. The utilities also provide a narrative documenting the methodologies used to forecast customer demand and the identification of resources to meet that demand over the ten-year planning period. This information, supplemented by additional data requests, provides the basis of the Commission’s review.



## **Additional Resources**

The Commission's Rules also task the reporting electric utilities with collecting information on both a statewide basis and for Peninsular Florida, which excludes the area east of the Apalachicola River. The Florida Reliability Coordinating Council (FRCC) provides this aggregate data for the Commission's review. Each year, the FRCC publishes a Regional Load and Resource Plan, which contains historic and forecast data on demand and energy, capacity and reserves, and proposed new generating units and transmission line additions. In addition, the FRCC publishes an annual Reliability Report which is also relied upon by the Commission.

For certain comparisons additional data from various government agencies is relied upon, including the Energy Information Administration and the Florida Department of Highway Safety and Motor Vehicles.

The Commission held a public workshop on September 15, 2015, to facilitate discussion of the annual planning process and allow for public comments. A presentation was conducted by the FRCC summarizing the 2015 Load and Resource Plan and other related matters, including fuel reliability, environmental regulations, and physical security of infrastructure. Presentations were also conducted by the four IOU's FPL, DEF, TECO and GPC, discussing upcoming solar installations. Public comments from Office of Public Counsel, Southern Alliance for Clean Energy and Sierra Club were also given at the workshop.

## **Structure of the Commission's Review**

The Commission's review is divided into multiple sections. The Statewide Perspective provides an overview of the State of Florida as a whole, including discussions of load forecasting, renewable generation, and traditional generation. The Utility Perspectives provides more focus, discussing the various issues facing each electric utility and its unique situation. Lastly, the comments collected from various review agencies, local governments, and other organizations are included as Appendix A.

## **Conclusion**

Based on its review, the Commission finds all 11 reporting utility's 2015 Ten-Year Site Plans to be suitable for planning purposes. During its review, the Commission has determined that the projections for load growth appear reasonable and that the reporting utilities have identified sufficient generation facilities to maintain an adequate supply of electricity at a reasonable cost.

The Commission notes that, as the Ten-Year Site Plans are non-binding, the classification of suitable does not constitute a finding or determination in any docketed matter before the Commission, nor an approval of all planning assumptions contained within the Ten-Year Site Plans. The Commission may address any concerns raised by a utility's Ten-Year Site Plan at a public hearing.



# Statewide Perspective


# Load Forecasting

Forecasting load growth is an important component of the IRP process for Florida’s electric utilities. In order to maintain system reliability, utilities must be prepared for future changes in electricity consumption, including changes to the number of electric customers, customer usage patterns, building codes and appliance efficiency standards, new technologies such as electric vehicles, and the role of demand-side management.

## Electric Customer Composition

The residential class represent the majority in terms of number of customers at 88.7 percent of customers , and retail energy sales for the three major customer classes, as illustrated in Figure 5 below. Both commercial and industrial customers make up a sizeable percentage of energy sales, due to each class’ higher energy usage per customer account.

**Figure 5: State of Florida - Electric Customer Composition in 2014**

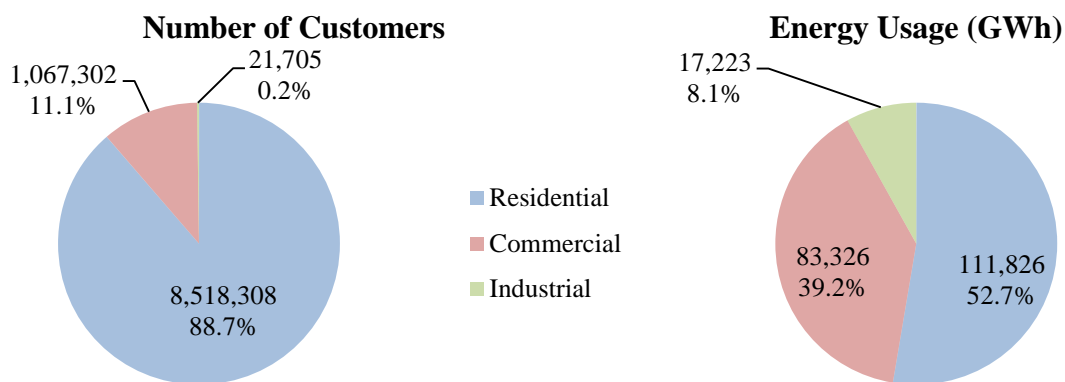


Source: FRCC 2015 Load and Resource Plan

Florida’s residential customers make up a larger portion of retail energy sales than the United States as a whole, with a national average of 38 percent for residential retail sales. As a result, Florida’s utilities are impacted more by trends in residential energy usage, which tend to be associated with weather conditions. Florida’s residential customers rely more upon electricity for heating than the national average, with only a small portion using alternate fuels such as natural gas or oil for home heating needs.

Florida’s unique climate plays an important role in electric utility planning. Florida is an outlier in terms of climate, with the highest number of cooling degree days and lowest number of heating degree days within the continental United States, as shown below in Figure 6. Other states tend to rely upon alternative fuels for heating, but Florida’s heavy use of electricity results in high winter peak demand.

**Figure 6: National - Climate Data by State (Continental US)**

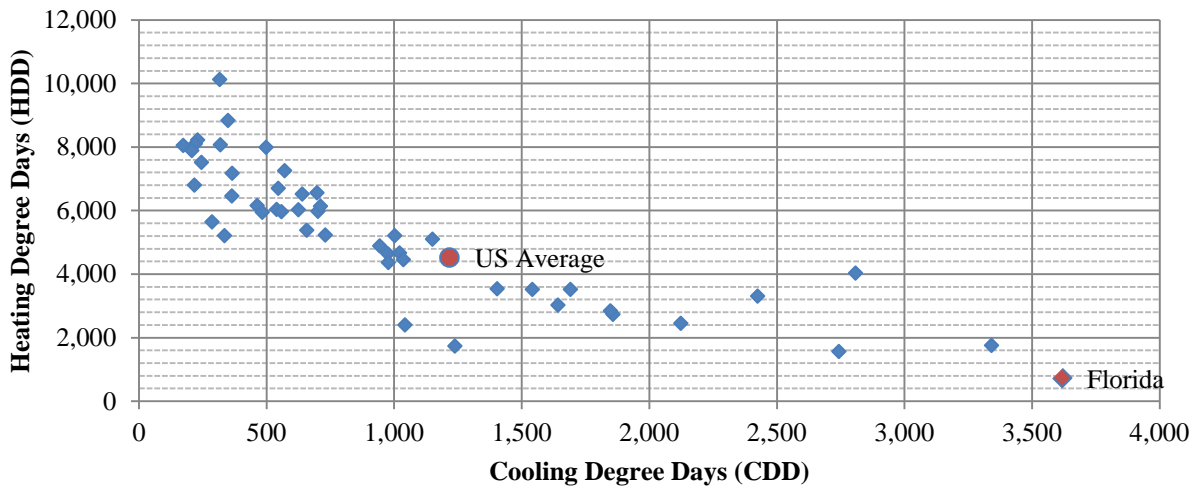


Source: National Oceanic & Atmospheric Administration, Historical Climatology Series 5-1 and 5-2

## Growth Projections

For the next ten year period, Florida’s customer base and retail sales are anticipated by the reporting utilities to grow at a faster pace than the last few years, reversing a trend of small population increases with declining retail sales. While this rate remains below those experienced before the financial crisis, it would set the State on track to exceed its previous 2007 retail sales peak in 2017. The current divide between customers and retail sales is anticipated to remain similar over the ten-year period, with customers growing at an average annual rate of 1.40 percent while retail sales increase by 1.18 percent annually. Florida’s electric utilities are projecting an increase in economic growth in the state, but at levels below those experienced before the financial crisis. The trends are showcased in Figure 7 below.

**Figure 7: State of Florida - Growth in Customers and Sales**

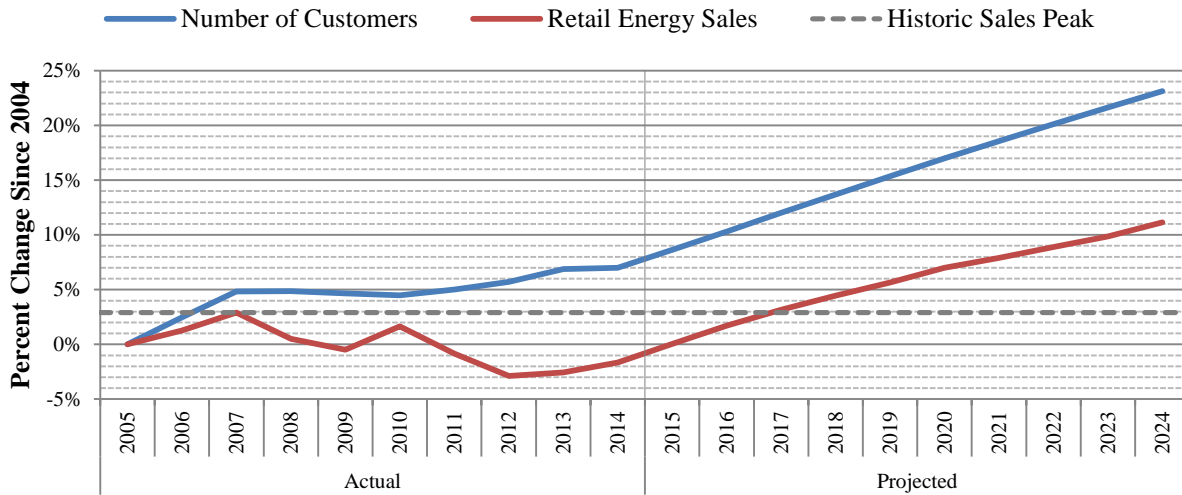


Source: FRCC 2015 Load and Resource Plan

## Peak Demand

The aggregation of each individual customer's electric consumption must be met at all times by Florida's electric utilities to ensure reliable service. The time at which customers demand the most energy simultaneously is referred to as peak demand. While retail energy sales primarily vary the amount of fuel consumed by the electric utilities to deliver energy, peak demand determines the amount of generating capacity required to deliver that energy at a single moment in time.

A primary factor in this is seasonal weather patterns, with peak demands calculated separately for the summer and winter periods annually. The influence of residential customers is evident in the determination of these seasonal peaks, as they correspond to times of increased usage to meet home heating (winter) and cooling (summer) demand. Figure 8 below, illustrates a daily load curve for a typical day for each season. In summer, air-conditioning needs increase throughout the day, climbing steadily until a peak is reached in the late afternoon and then declining into the evening. In winter, electric heat and electric water heating produce a higher base level of usage, with a large spike in the morning and a smaller spike in the evening.

**Figure 8: TYSP Utilities - Example Daily Load Curves**

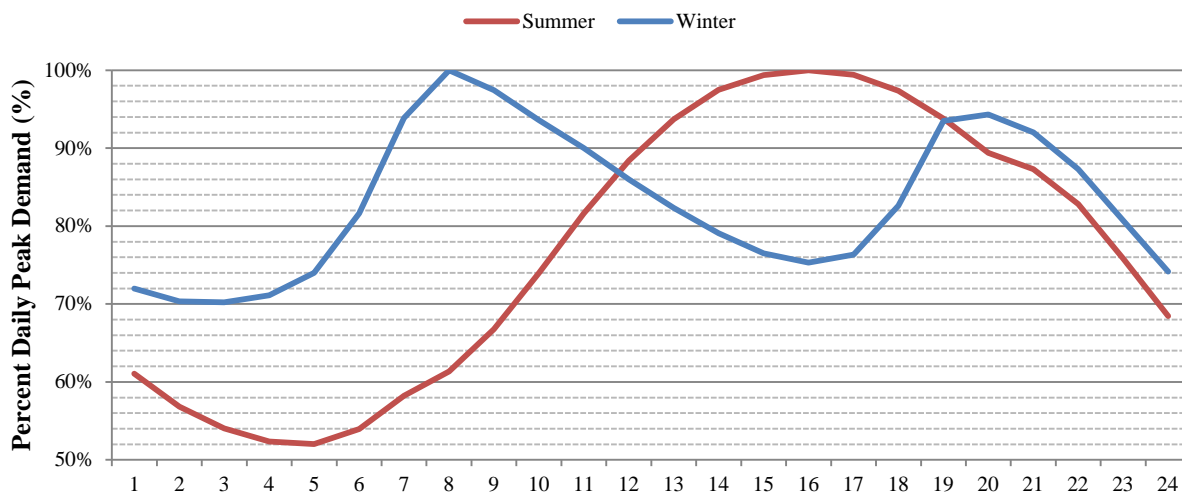

Source: TYSP Utilities Data Responses


Florida is typically a summer-peaking state, meaning that the summer peak demand generally exceeds winter peak demand, and therefore controls the amount of generation required. Higher temperatures in summer also reduce the efficiency of generation, with high water temperatures reducing the quality of cooling provided, and can sometimes limit the quantity as units may be required to operate at reduced power or go offline based on environmental permits. Conversely, in winter, utilities can take advantage of lower ambient air and water temperatures to produce more electricity from a power plant.

As daily load varies, so do seasonal loads. Figure 9 below, illustrates this for 2014, showing the daily peak demand as a percentage of the annual peak demand for the reporting investor-owned

utilities combined. Typically, winter peaks are short events while summer demand tends to stay at near peak levels for longer periods. The periods between seasonal peaks are referred to as shoulder months, in which the utilities take advantage of lower demand to perform maintenance without impacting their ability to meet daily peak demand.

---

**Figure 9: TYSP Utilities - Daily Peak Demand (2014 Actual)**

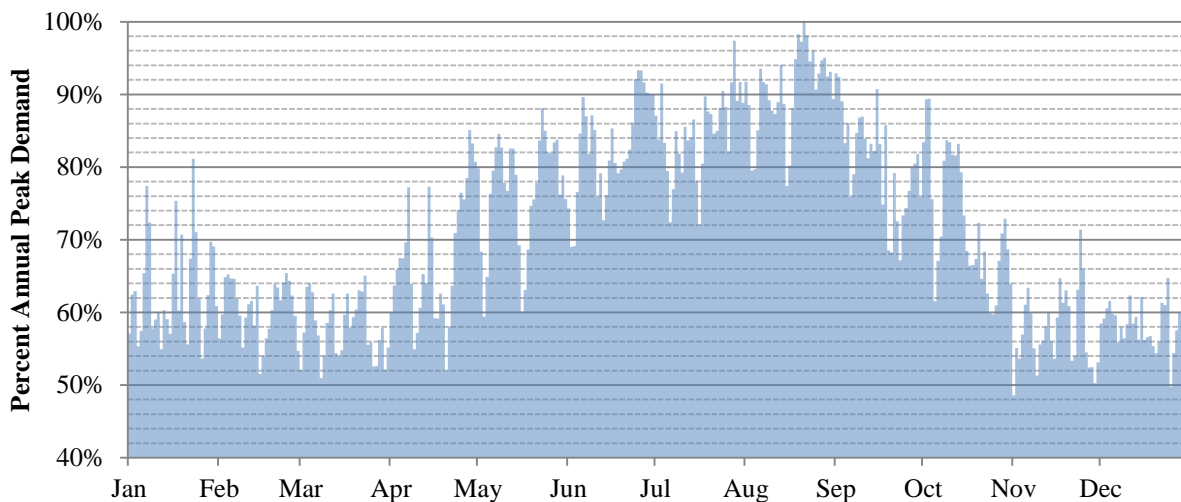

Source: TYSP Utilities Data Responses (Investor-Owned Utilities Only)

---

While the utilities assume normalized weather in forecasts of peak demand, during operation of the system, utilities continuously monitor the short-term weather patterns. Utilities adjust maintenance schedules to ensure the highest unit availability during the utility’s projected peak demand, bringing units back online if necessary or delaying maintenance until after a weather system has passed.

## Electric Vehicles

Utilities also examine other trends that may impact the amount of customer peak demand and energy consumption. This includes new sources of energy consumption, such as electric vehicles, which can be considered analogous to a home air conditioning system in terms of system load. At present, the reporting electric utilities estimate approximately 12,000 electric plug-in vehicles were operating in Florida by the end of 2014. The Florida Department of Highway Safety and Motor Vehicles lists the number of registered vehicles in Florida as of December 31, 2014, as 13.9 million vehicles, resulting in 0.047 percent penetration rate of electric vehicles of Florida’s registered vehicle fleet.

Florida’s electric utilities anticipate growth in the electric vehicle market, as illustrated in Table 2.below Electric vehicles are anticipated to grow rapidly throughout the planning period, resulting in almost a quarter-million electric vehicles operating within the electric service territories by the end of 2024. The projected increase in electric vehicle ownership would result in approximately 2 percent share of Florida’s vehicles being fueled by electricity.

**Table 2: TYSP Utilities - Estimated Number of Electric Vehicles by Service Territory**

Year	FPL	DEF	TECO	GULF	JEA	OUC	TAL	Total
2014	6,576	2,099	827	219	248	2,355	36	12,360
2015	9,395	4,194	1,432	453	372	4,504	43	20,393
2016	13,341	6,922	1,909	864	532	6,470	52	30,090
2017	17,702	10,701	2,328	1,443	733	8,409	67	41,383
2018	22,658	15,722	2,907	2,226	978	10,496	88	55,075
2019	29,002	22,321	3,273	3,227	1,263	12,428	114	71,628
2020	39,153	30,888	3,580	4,471	1,588	14,343	148	94,171
2021	52,857	41,801	3,879	5,972	1,950	16,278	192	122,929
2022	71,357	55,198	4,398	7,733	2,347	18,439	260	159,732
2023	96,332	70,992	5,076	9,720	2,777	20,762	351	206,010

Source: TYSP 2015 Data Responses

In terms of energy consumed by electric vehicles, Table 3 below, illustrates the estimates provided by the reporting utilities. The anticipated growth would result in an annual energy consumption of 765.6 GWh.

**Table 3: TYSP Utilities - Estimated Electric Vehicle Annual Energy Consumption (GWh)**

Year	FPL	DEF	TECO	GULF	JEA	OUC	TAL	Total
2014	3.1	4.4	3.3	1.0	1.6	2.7	0.1	16.2
2015	17.4	10.9	5.8	2.0	2.5	5.2	0.2	43.9
2016	36.3	20.7	7.7	3.8	3.7	7.2	0.2	79.5
2017	57.1	33.8	9.3	6.4	5.4	9.2	0.2	121.3
2018	80.7	50.6	11.7	9.8	7.5	11.4	0.3	172.0
2019	111.0	72.0	13.1	14.3	10.3	13.5	0.4	234.6
2020	159.5	99.4	14.4	19.8	13.6	15.6	0.5	322.8
2021	224.9	133.2	15.6	26.4	17.5	17.7	0.7	435.9
2022	313.2	173.4	17.7	34.2	22.0	20.1	0.9	581.4
2023	432.4	218.7	20.4	43.0	27.2	22.7	1.2	765.6

Source: TYSP 2015 Data Responses

The effect of increased electric vehicle ownership on peak demand is more difficult to determine. While comparable in electric demand to a home air conditioning system, the time of charging and whether charging would be shifted away from periods of peak demand are uncertainties that must be clarified to determine impact on system peak. As electric vehicle ownership increases, the effects of electric vehicles on system peak should become clearer and be able to be addressed by electric utilities.

## Demand-Side Management

Florida's electric utilities also must consider how the efficiency of customer energy consumption changes over the planning period. Changes in government mandates, such as building codes and appliance efficiency standards, reduce the amount of energy consumption for new construction and electric equipment. Electric customers, through the power of choice, can elect to engage in behaviors that decrease peak load or annual energy usage. Examples include, turning off lights



and fans in vacant rooms, increasing thermostat settings, and purchasing appliances that go beyond efficiency standards. While a certain portion of customers will engage in these activities without incentives due to economic, aesthetic, or environmental concerns, other customers may lack information or require additional incentives. Demand-side management represents an area where Florida's electric utilities can empower and educate its customers to make choices that reduce peak load and annual energy consumption.

### ***Florida Energy Efficiency and Conservation Act (FEECA)***

The Florida Legislature has directed the Commission to encourage utilities to decrease the growth in seasonal peak demand and annual energy consumption by FEECA, which consists of Sections 366.80 through 366.85 and Section 403.519, F.S. Under FEECA, the Commission is required to set goals for seasonal demand and annual energy reduction for seven electric utilities, known as the FEECA Utilities. These include the five investor-owned electric utilities (including Florida Public Utility Company, which is a non-generating utility and therefore does not file a Ten-Year Site Plan) and two municipal electric utilities (JEA and OUC). The FEECA utilities represented approximately 86.5 percent of 2014 retail sales in Florida.

The FEECA utilities currently offer demand-side management programs for residential, commercial, and industrial customers which are integral to the utilities' IRP process. Energy audit programs are designed to provide an overview of customer energy usage and to evaluate conservation opportunities, including behavioral changes, low-cost measures customers can undertake themselves, and participation in utility-sponsored DSM programs.

The last FEECA goal-setting proceeding was completed in December 2014, establishing goals for the period 2015 through 2024. The 2015 Ten-Year Site Plans incorporate the impacts of the goals established by the Commission for the planning period. During 2015, the Commission reviewed the FEECA Utility's proposed DSM Plans to comply with the established goals, approving the plans with some modifications in July, 2015.

### ***DSM Programs***

DSM Programs generally are divided into three categories: interruptible load, load management, and energy efficiency. The first two are considered dispatchable, and are collectively known as demand response, meaning that the utility can call upon them during a period of peak demand or other reliability concerns, but otherwise they are not utilized. In contrast, energy efficiency measures are considered passive and are always working to reduce customer demand and energy consumption.

Interruptible load is achieved through the use of agreements with large customers to allow the utility to interrupt the customer's load, reducing the generation required to meet system demand. Interrupted customers may use back-up generation to fill their energy needs, or cease operation until the interruption has passed. A subtype of interruptible customers is curtailable customers, which allow the utility to interrupt only a portion of the customer's load. In exchange for the ability to interrupt these customers, the utility offers a discounted rate for energy or other credits which are paid for by all ratepayers.

Load management is similar to interruptible customers, but focuses on smaller customers and targets individual appliances. The utility installs a device on an electric appliance, such as a water heater or air conditioner that allows for remote deactivation for a short period of time. Load management activations tend to have less advanced notice than those for interruptible customers, but tend to be activated only for short periods and are cycled through groups of customers to reduce the impact to any single customer. Due to the focus on specific appliances, certain appliances would be more appropriate for addressing certain seasonal demands. For example, load management programs targeting air conditioning units would be more effective to reduce a summer peak, while water heaters are more effective for reducing a winter peak.

As of 2015, demand response available for reduction of peak load is 3,110 MW for summer peak and 2,985 MW for winter peak. Demand response is anticipated to increase to approximately 3,458 for summer peak and 3,263 for winter peak by the end of the planning period in 2024.

Energy efficiency or conservation measures also have an impact on peak demand, and due to their passive nature do not require activation by the utility. Conservation measures include improvements in a home or business' building envelope to reduce heating or cooling needs, or the installation of more efficient appliances. By installing additional insulation, energy-efficient windows or window films, and more efficient appliances, customers can reduce both their peak demand and annual energy consumption, leading to reductions in customer bills. Demand-side management programs work in conjunction with building codes and appliance efficiency standards to increase energy savings above the minimum required by local, state, or federal regulations. As of 2015, energy efficiency is responsible for peak load reduction of 3,970 MW for summer peak and 3,611 MW for winter peak. Energy efficiency is anticipated to increase to approximately 4,757 MW for summer peak and 4,361 MW for winter peak by the end of the planning period in 2024.

## **Forecast Load & Peak Demand**

The historic and forecasted seasonal peak demand and annual energy consumption values for the State of Florida are illustrated below, in Figure 10. It should be noted, that the forecasts shown below are based upon normalized weather conditions, while the historic demand and energy values represent the actual impact of weather conditions on Florida's electric customers. Florida relies heavily upon both air conditioning in the summer and electric heating in the winter, so both seasons experience a great deal of variability due to severe weather conditions.

Demand-side management, including demand response and energy efficiency, along with self-service generation is included in each figure for seasonal peak demand and annual energy for load. The total demand or total energy for load represents what otherwise would need to be served if not for the impact of these programs and self-service generators. The net firm demand is used as a planning number for the calculation of generating reserves and determination of generation needs for Florida's electric utilities.


Demand response is included in Figure 10 below, in two different ways based upon the time period considered. For historic values of seasonal demand, the actual rates of demand response activation are shown, not the full amount demand response that was available at the time.

Overall, demand response has only been partially activated as sufficient generation assets were available during the annual peak. Residential load management has been called upon to a limited degree during peak periods, with a lesser amount of interruptible load activated. The primary exception to this trend was the summer of 2008 and winter of 2009, when a larger portion of the available demand response resources were called upon.

For forecast values of seasonal demand, it is assumed that all demand response resources will be activated during peak. The assumption of all demand response being activated reduces generation planning need. Based on operating conditions in the future, if an electric utility has sufficient generating units, and it is economical to serve all customer load demand, response would not be activated or only partially activated in the future.

As previously discussed, Florida is normally a summer-peaking state. Only three of the past 10 years have had higher winter net firm demand than summer, and all 10 of the forecast years are anticipated to be summer peaking. Based upon current forecasts using normalized weather data, Florida's electric utilities do not anticipate exceeding the winter 2009 peak during the planning period.

**Figure 10: State of Florida - Historic & Forecast Seasonal Peak Demand & Annual Energy**

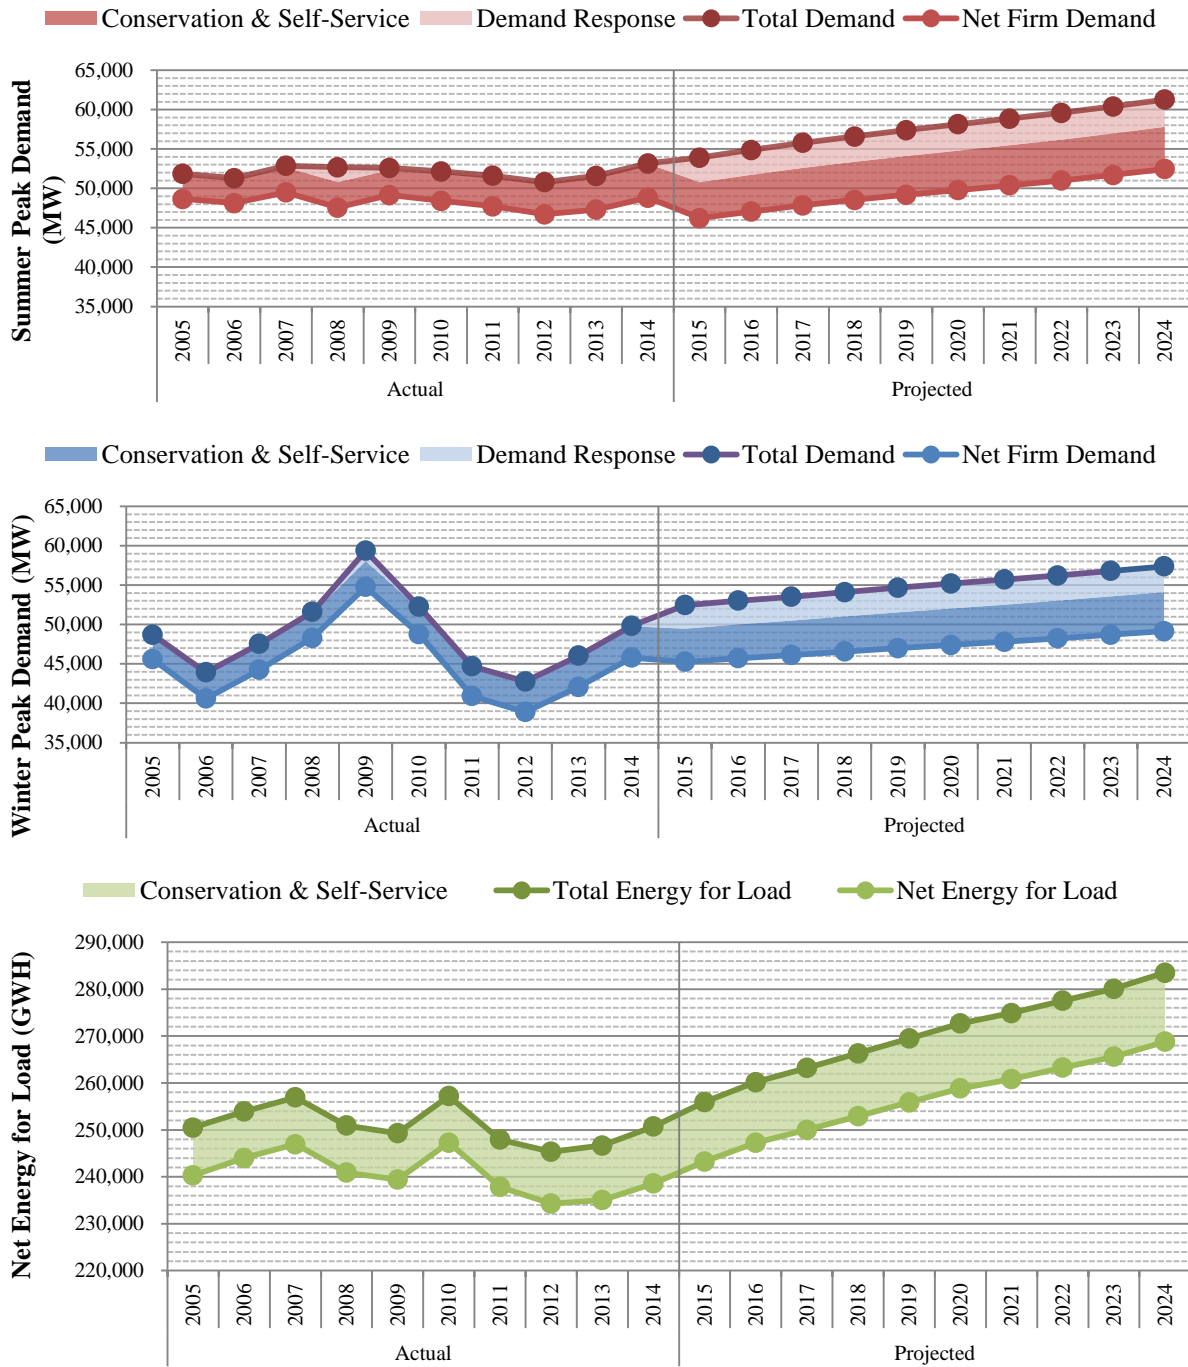

Source: 2015 FRCC Load & Resource Plan

## ***Forecast Methodology***

Florida's electric utilities perform forecasts of peak demand and annual energy sales using various forecasting models, including econometric and end-use models, and other forecasting techniques such as surveys. In the development of econometric models, the utilities use historical data sets including dependent variables (e.g. summer peak demand per customer, residential energy use per customer) and independent variables (e.g. cooling degree days, real personal income, etc.) to infer relationships between the two types of variables. These historical relationships, combined with available forecasts of the independent variables and the utilities' forecasts of customers, are then used to forecast the peak demand and energy sales. For some customer classes, such as industrial customers, surveys may be conducted to determine the customer's expectations for their own future electricity consumption. Commonly, the results of the models must be adjusted to take into account exogenous impacts, such as the impact of the recent growth in plug-in electric vehicles and distributed generation. End-use models are often used to project energy use in conjunction with econometric models. End use models are used to capture trends in appliance and equipment saturation and efficiency, as well as building size and thermal efficiency, on residential and commercial energy use.

Florida's electric utilities rely upon data sourced from public and private entities for historic and forecast values of specific independent variables used in econometric modeling. Public resources such as the University of Florida's Bureau of Economic and Business Research, which provides county-level data on population growth, and the U.S. Department of Commerce's Bureau of Labor Statistics, which publishes the Consumer Price Index, are utilized along with private forecasts for economic growth from macroeconomic experts, such as Moody's Analytics. By combining historic and forecast macroeconomic data with customer and climate data, Florida's electric utilities project future load conditions.

The various forecast models and techniques used by Florida's electric utilities are commonly used throughout the industry, and each utility has developed its own individualized approach to projecting load. The resulting forecasts allow each electric utility to evaluate its individual needs for new generation, transmission, and distribution resources to meet customers' current and future needs reliably and affordably.

## ***Historic Forecast Accuracy***

For each reporting electric utility, the Commission reviewed the historic forecast accuracy of past retail energy sales forecasts. The review methodology, previously used by the Commission, involves comparing actual retail sales for a given year to energy sales forecasts made three, four, and five years prior. For example, the actual 2014 retail energy sales were compared to the forecasts made in 2011, 2010, and 2009. These differences, expressed as a percentage error rate, are used to determine each utility's historic forecast accuracy using a five year rolling average. An average error with a negative value indicates an under-forecast, while a positive value represents an over-forecast. An absolute average error provides an indication of the total magnitude of error, regardless of the tendency to under or over forecast.

For the 2015 Ten-Year Site Plans, determining the accuracy of the five-year rolling average forecasts involves comparing the actual retail energy sales for the period 2014 through 2010 to forecasts made between 2011 and 2005. As discussed previously, the period before the financial

crisis experienced a higher annual growth rate for retail energy sales than the post-crisis period. As most electric utilities and macroeconomic forecasters did not predict the financial crisis, the economic impact and its resulting effect on retail energy sales of Florida’s electric utilities was not included in these projections. Therefore, the use of a metric that compares pre-crisis forecasts with post-crisis actual data has a high rate of error.

Table 4 below, shows that the forecast error is increasing with time starting 2010 due to the unexpected impact of the financial crisis on retail energy sales in Florida due to decreased population growth, decreased economic growth, and decreased usage of electricity per capita. However, the forecast error should start to return to its historically normal lower levels as utility retail sales forecasts include more years after the financial crisis. This has been confirmed by the most recent data provided in the current TYSP. The forecasting errors (both average and absolute average) generated by comparing actual 2014 retail energy sales to the 2013 forecast of 2014 energy sales are reduced.

**Table 4: TYSP Utilities – Accuracy of Retail Energy Sales Forecasts**

TYSP Year	Five Year Analysis Period	Forecast Years Analyzed	Forecast Error (%)	
			Average	Absolute Average
2010	2009 - 2005	2006-2000	4.98%	5.70%
2011	2010 - 2006	2007-2001	8.28%	8.29%
2012	2011 - 2007	2008-2002	11.93%	11.93%
2013	2012 - 2008	2009-2003	15.13%	15.13%
2014	2013 - 2009	2010-2004	16.16%	16.16%
2015	2014 - 2010	2011-2005	14.90%	14.90%

Source: 2000-2015 Ten-Year Site Plans

To verify whether more recent forecasts lowered the error rates, an additional analysis was conducted to determine with more detail, the source of high error rates in terms of forecast timing. Table 5 below, provides the forecast error rate for forecasts made between one and six years prior, along with the average and absolute average error rates for the three- to five-year period used in the analysis above.

As displayed in Table 5 below, the companies’ retail energy sales forecasts show a consistent positive error rate beginning in 2007 and extending through 2014, for forecasts prepared two to six years prior. However, 2014 sales forecasted in 2010 and 2011, reveal that three and four year error rates (6.10 percent and 5.73 percent, respectively) have declined considerably compared to the three and four year forecast error rates associated with 2010-2013 sales. The fact that three and four year forecast errors started to decline in 2009 and 2010 forecasts is not surprising because, by 2009, the inputs to the utilities’ forecast models reflected the impacts of the financial crisis and population growth decline.

**Table 5: TYSP Utilities – Accuracy of Retail Energy Sales Forecasts – Annual Analysis**

Year	Annual Forecast Error Rate (%)						3-5 Year Error (%)	
	Years Prior						Average	Absolute Average
	6	5	4	3	2	1		
2005	-5.82%	-4.03%	-0.69%	-0.64%	0.71%	0.90%	-1.79%	1.79%
2006	-3.29%	-0.03%	1.03%	2.30%	2.43%	2.37%	1.10%	1.12%
2007	0.57%	2.26%	3.49%	3.59%	4.20%	3.05%	3.11%	3.11%
2008	7.02%	8.40%	8.56%	9.97%	9.24%	8.34%	8.98%	8.98%
2009	11.95%	12.15%	14.48%	13.91%	12.68%	10.18%	13.51%	13.51%
2010	12.93%	15.57%	14.89%	13.70%	10.55%	-0.73%	14.72%	14.72%
2011	21.56%	20.79%	20.09%	17.02%	3.79%	0.08%	19.30%	19.30%
2012	26.31%	25.97%	23.04%	8.47%	3.90%	3.71%	19.16%	19.16%
2013	28.55%	26.29%	10.00%	5.98%	5.58%	2.97%	14.09%	14.09%
2014	27.285%	9.8%	6.10%	5.73%	2.84%	2.21%	7.21%	7.21%

Source: 2000-2015 Ten-Year Site Plans

On a going forward basis (2015 and beyond), average forecasted energy sales error rates for forecasts prepared three to five years prior, are likely to continue to decline as the older forecasts drop out of the analysis. For several years, Florida’s electric utilities responded to the declines in customer load growth by delaying and cancelling new generation, and by taking opportunities to modernize existing plants, as discussed in previous annual reviews of the Ten-Year Site Plans. The dynamic nature of the state and national economies, actual and projected, continue to exert a significant impact on Florida utilities’ load forecasts and, ultimately, the accuracy of such forecasts.

# Renewable Generation

---

Pursuant to Section 366.91, F.S., it is in the public interest to promote the development of renewable energy resources in Florida. Section 366.91(2)(d), F.S., defines renewable energy in part, as follows:

“Renewable energy” means electrical energy produced from a method that uses one or more of the following fuels or energy sources: hydrogen produced from sources other than fossil fuels, biomass, solar energy, geothermal energy, wind energy, ocean energy, and hydroelectric power.

Although not considered a traditional renewable resource, some industrial plants take advantage of waste heat, produced in production processes, to also provide electrical power via cogeneration. Phosphate fertilizer plants, which produce large amounts of heat in the manufacturing of phosphate from the input stocks of sulfuric acid, are a notable example of this type of renewable resource. The Section 366.91(2) (b), F.S., definition also includes the following language which recognizes the aforementioned cogeneration process:

The term [Renewable Energy] includes the alternative energy resource, waste heat, from sulfuric acid manufacturing operations and electrical energy produced using pipeline-quality synthetic gas produced from waste petroleum coke with carbon capture and sequestration.

## Existing Renewable Resources

Currently, renewable energy facilities provide approximately 1,638 MW of firm and non-firm generation capacity, which represents 2.8 percent of Florida’s overall generation capacity of 58,148 MW in 2014. Table 6 below, summarizes the contribution by renewable type of Florida’s existing renewable energy sources.

---

**Table 6: State of Florida - Existing Renewable Resources**

Renewable Type	MW	% Total
Biomass	581	35.5%
Municipal Solid Waste	400	24.4%
Waste Heat	308	18.8%
Solar	228	13.9%
Hydro	64	3.9%
Landfill Gas	47	2.9%
Wind	10	0.6%
<b>Renewable Total</b>	<b>1,638</b>	<b>100.0%</b>

Source: FRCC 2015 Load & Resource Plan and TYSP Utilities Data Responses

---



Of the total 1,638 MW of renewable generation, approximately 570 MW are considered firm, based on either operational characteristics or contractual agreement. Firm renewable generation can be relied on to serve customers and can contribute toward the deferral of new fossil fueled power plant construction. Solar generation contributes 33 MW to this total, based upon the coincidence of solar generation and summer peak demand. Changes in timing of peak demand may influence the firm contributions of renewable resources such as solar and wind.

The remaining renewable generation can generate energy on an as-available basis or for internal use (self-service). As-available energy is considered non-firm, and cannot be counted on for reliability purposes; however, it can contribute to the avoidance of burning fossil fuels in existing generators. Self-service generation reduces demand on Florida's utilities.

## **Non-Utility Renewable Generation**

The majority of Florida's existing renewable energy generation, approximately 87 percent, comes from non-utility generators. In 1978, the US Congress enacted the Public Utility Regulatory Policies Act (PURPA). PURPA requires utilities to purchase electricity from cogeneration facilities and renewable energy power plants with a capacity no greater than 80 MW (collectively referred to as Qualifying Facilities or QFs). PURPA required utilities to buy electricity from qualifying QFs at the utility's full avoided cost. These costs are defined in Section 366.051, F.S., which provides in part that:

A utility's "full avoided costs" are the incremental costs to the utility of the electric energy or capacity, or both, which, but for the purchase from cogenerators or small power producers, such utility would generate itself or purchase from another source.

If a renewable energy generator can meet certain deliverability requirements, it can be paid for its capacity and energy output under a firm contract. Rule 25-17.250, F.A.C., requires each IOU to establish a standard offer contract with timing and rate of payments based on each fossil-fueled generating unit type identified in the utility's TYSP. In order to promote renewable energy generation, the Commission requires the IOUs to offer multiple options for capacity payments, including the options to receive early (prior to the in-service date of the avoided-unit) or levelized payments. The different payment options allow renewable energy providers the option to select the payment option that best fits its financing requirements, and provides a basis from which negotiated contracts can be developed.

As previously discussed, large amounts of renewable energy is generated on an as-available basis. As-available energy is energy produced and sold by a renewable energy generator on an hour-by-hour basis for which contractual commitments as to the quantity and time of delivery are not required. As-available energy is purchased at a rate equal to the utility's hourly incremental system fuel cost, which reflects the highest fuel cost of generation each hour.

## **Customer Owned Generation**

With respect to customer owned renewable generation, Rule 25-6.065, F.A.C., requires the IOUs to offer net metering for all types of renewable generation up to 2 MW in capacity and a standard interconnection agreement with an expedited interconnection process. Net metering allows a

customer, with renewable generation capability, to offset their energy usage. In 2008, the effective year of Rule 25-6.065, F.A.C., customer owned renewable generation accounted for 3 MW of renewable capacity. As of the end of 2014, approximately 80 MW of renewable capacity from nearly 8,600 systems has been installed statewide. Table 7 below, summarizes the growth of customer owned renewable generation interconnections. Almost all installations under net metering are solar, with non-solar generation accounting for only 35 installations and 5.7 MW of installed capacity. The renewable generators in this category include wind turbines and anaerobic digesters.

**Table 7: State of Florida - Net Metering Growth**

Year	2008	2009	2010	2011	2012	2013	2014
<b>Number of Installations</b>	577	1,625	2,833	3,994	5,302	6,697	8,581
<b>Installed Capacity (MW)</b>	2.8	13.0	19.9	28.4	42.2	63.0	79.8

Source: Annual Net Metering Reports

## Utility-Owned Renewable Generation

Utility owned renewable generation also contributes to the State’s total renewable capacity. The majority of this generation is from solar facilities. Due to the intermittent nature of solar resources, capacity from these facilities has previously been considered non-firm for planning purposes.

In 2008, Section 366.92(4), F.S., was enacted and provides, in part, the following:

In order to demonstrate the feasibility and viability of clean energy systems, the commission shall provide for full cost recovery under the environmental cost-recovery clause of all reasonable and prudent costs incurred by a provider for renewable energy projects that are zero greenhouse gas emitting at the point of the generation, up to a total of 110 MW statewide.

In 2008, the Commission approved a petition by FPL seeking installation of the full 110 MW across three solar energy facilities. The solar projects consisted of, a pair of solar PV facilities and a single solar thermal facility. In response to staff interrogatories, FPL estimated that the three solar facilities would cost an additional \$573 million, above traditional generation costs over the life of the facilities. In 2012, Section 366.92, F.S., was revised and no longer includes the passage described above.


Based on actual data provided by FPL, the combined cost of generation of the three solar facilities was \$0.37/kWh in 2014. These facilities make up a significant portion of the utility owned renewable generation. Since full operation began, the two solar PV facilities have operated largely as expected; however, the solar thermal facility has experienced multiple outages which have hindered its performance. In FPL’s 2015 TYSP, FPL claims that the Desoto and Space Coast solar facilities contributed approximately 46 percent and 32 percent, respectively, of the system’s installed capacity to summer peak demand. No contribution to winter peak demand as determined from either facility.

Hydroelectric units at two sites, one owned by the City of Tallahassee Utilities, and one operated by the federal government, supply 63 MW of renewable capacity. Due to operational constraints, the City of Tallahassee does not consider its 12.3 MW of hydroelectric generation firm. Because of Florida’s geography, however, new hydroelectric power generation is largely limited.

## Planned Renewable Resources

Florida’s utilities plan to construct or purchase an additional 1,566 MW of renewable generation over the ten-year planning period, a significant increase from last year’s estimated 722 MW projection. Figure 11 below, summarizes the existing and projected renewable capacity by generation type. Solar generation is projected to have the greatest increase over the planning horizon.

**Figure 11: State of Florida - Current and Projected Renewable Resources**

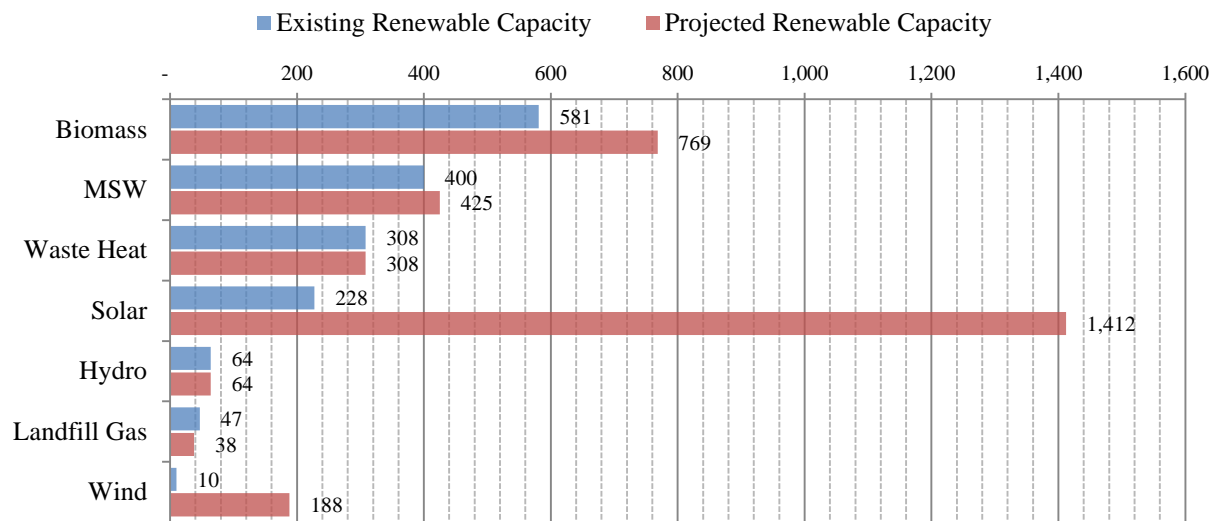

Source: 2015 FRCC Load & Resource Plan, TYSP Utilities Data Responses

Of the 1,566 MW of planned renewable capacity, 432 MW is projected to be from firm resources, including 116 MW from solar generation. The projected firm capacity additions are from a combination of renewable contracts with non-utility generators, primarily biomass, and several utility-owned solar facilities. The remaining planned capacity from renewable resources is projected to be from non-firm resources.

For some existing renewable facilities, contracts for firm capacity are projected to expire within the ten-year planning. If new contracts are signed in the future to replace those that expire, these resources will once again be included in the state’s capacity mix to serve future demand. If these contracts are not extended, the renewable facilities could still deliver energy on an as-available basis.

As noted above, solar generation is anticipated to increase significantly over the ten-year period, with a total of 1,185 MW to be installed. This consists of 730 MW of utility-owned solar, 155 MW of contracted solar and 300 MW of as-available energy contract solar facilities. Table 8 below, lists some of the utility-scale (greater than 2 MW) solar installations with in-service dates within the planning period.

**Table 8: TYSP Utilities - Planned Solar Installations**

Year	Utility	Facility Name	Type	Capacity (MW)
2015	LAK	SunEdison Sutton	Purchased	6.0
2015	LAK	SunEdison East Main	Purchased	6.0
2015	DEF	Solar 1 & 2	Utility Owned	5.0
2015	LAK	SunEdison Airport	Purchased	3.2
<b>2015 Subtotal</b>				<b>20.2</b>
2016	FPL	Babcock Solar Energy Center	Utility Owned	74.5
2016	FPL	Citrus Solar Energy Center	Utility Owned	74.5
2016	FPL	Manatee Solar	Utility Owned	74.5
2016	OUC	Stanton Solar Phase 2	Purchased	12.0
2016	DEF	Solar 3, 4 & 5	Utility Owned	10.0
<b>2016 Subtotal</b>				<b>245.5</b>
2017	GULF	Gulf Coast Solar Center I Eglin	Purchased	30.0
2017	GULF	Gulf Coast Solar Center II Holley	Purchased	40.0
2017	GULF	Gulf Coast Solar Center III Saufley	Purchased	50.0
2017	DEF	Solar 6 & 7	Utility Owned	10.0
<b>2017 Subtotal</b>				<b>130.0</b>
2018	DEF	Solar 8	Utility Owned	10.0
<b>2018 Subtotal</b>				<b>10.0</b>
2019	DEF	Solar 9	Utility Owned	50.0
<b>2019 Subtotal</b>				<b>50.0</b>
2020	DEF	Solar 10 & 11	Utility Owned	130.0
<b>2020 Subtotal</b>				<b>130.0</b>
2021	DEF	Solar 12	Utility Owned	35.0
<b>2021 Subtotal</b>				<b>35.0</b>
2022	DEF	Solar 13	Utility Owned	50.0
<b>2022 Subtotal</b>				<b>50.0</b>
2023	DEF	Solar 14 & 15	Utility Owned	75.0
<b>2023 Subtotal</b>				<b>75.0</b>
2024	DEF	Solar 16 & 17	Utility Owned	125.0
<b>2024 Subtotal</b>				<b>125.0</b>
TBD	DEF	Blue Chip Energy Lake Mary	Purchased	10.0
TBD	DEF	Blue Chip Energy Sorrento	Purchased	40.0
TBD	DEF	National Solar Gadsden	Purchased	50.0
TBD	DEF	National Solar Hardee	Purchased	50.0
TBD	DEF	National Solar Suwannee	Purchased	50.0
TBD	DEF	National Solar Highlands	Purchased	50.0
TBD	DEF	National Solar Osceola	Purchased	50.0
<b>TBD Subtotal</b>				<b>300.0</b>

Source: FRCC Load &amp; Resource Plan, TYSP Utilities Data Responses

## **Renewable Outlook**

Florida's renewable generation is projected to increase over the planning period. This is the first time significant solar facilities have been included in the utilities TYSP. Also, the first time that some are including a portion of solar capacity as a firm resource for reliability considerations. Reasons given for this change are the continual reduction in price of solar facilities, availability of utility property with access to the grid, and actual performance data from FPL's pilot program. If these conditions remain, the cost-effective forms of renewable generation will continue to improve the state's fuel diversity and reduce dependence on fossil fuels.



## Traditional Generation

---

While renewable generation increases its contribution to the state's generating capacity, a majority of generation is projected to come from traditional sources, such as fossil-fueled steam and turbine generators, that have been added to Florida's electric grid over the last several decades. Due to forecasted increases in peak demand, further traditional resources are anticipated over the planning period.


Florida's electric utilities have historically relied upon several different fuel types to serve customer load. Previous to the oil embargo, Florida used oil-fired generation as its primary source of electricity until the increase in oil prices made this undesirable. Since that time, Florida's electric utilities have sought a variety of other fuel sources to diversify the state's generation fleet and more reliably and affordably serve customers. Numerous factors, including swings in fuel prices, availability, environmental concerns, and other factors have resulted in a variety of capacity on Florida's electric grid. Solid fuels, such as coal and nuclear, increased during the shift away from oil-fired generation, and more recently natural gas has emerged as the dominant fuel type in Florida.

### Existing Generation

Florida's generating fleet includes incremental new additions to a historic base fleet, with units retiring as they become uneconomical to operate or maintain. Currently, Florida's existing capacity ranges greatly in age and fuel type, and legacy investments continue. The weighted average age of Florida's generating units is 23 years. While the original commercial in-service date may be in excess of 60 years for some units, they are constantly maintained as necessary in order to ensure safe and reliable operation, including uprates from existing capacity, which may have been added after the original in-service date. Figure 12 below, illustrates the decade current operating generating capacity was originally added to the grid, with the largest additions occurring in the 2000s.



**Figure 12: State of Florida - Electric Utility Installed Capacity by Decade**

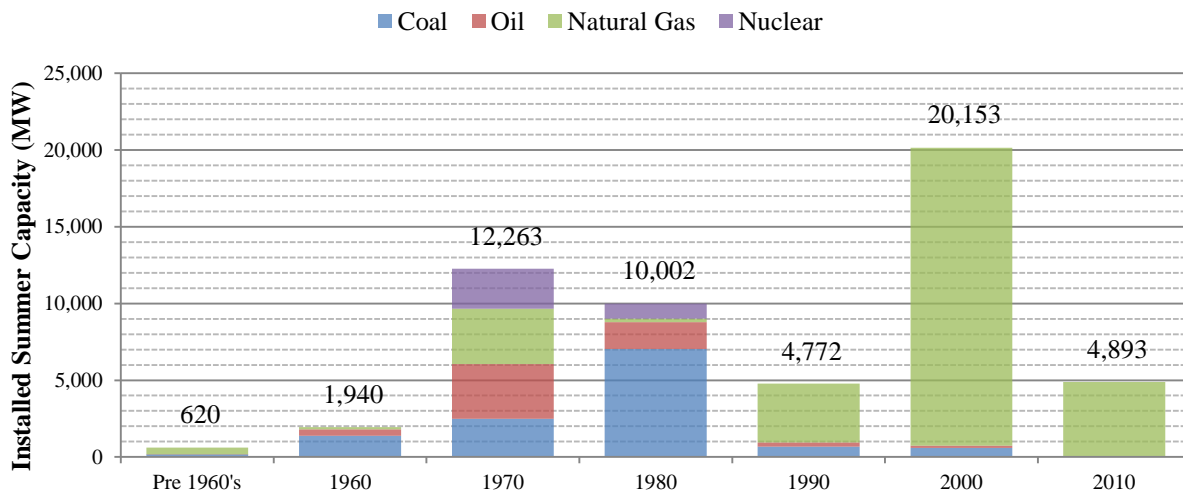

Source: 2015 FRCC Load & Resource Plan

The existing generating fleet will be impacted by several events over the planning period. New and proposed environmental regulations may require changes in unit dispatch, fuel switching, or installation of pollution control equipment which may reduce net capacity. Modernizations will allow more efficient resources to replace older generation, while potentially reusing power plant assets such as transmission and other facilities, switching to more economic fuel types, or uprates at existing facilities to improve power output. Lastly, retirements of units which can no longer be economically operated and maintained or meet environmental requirements will reduce the existing generation.

## Impact of EPA Rules

In addition to maintaining a fuel efficient and diverse fleet, Florida's utilities must also comply with changing environmental requirements. During the past several years, the U.S. Environmental Protection Agency (EPA) has finalized or proposed several rules which will impact both existing and planned generating units in the state. Environmental requirements and associated costs must be considered to fully evaluate any new supply-side resources, as well as the operation of existing generating units.

Six EPA rules are anticipated to affect electric generation in Florida:

- Carbon Pollution Emissions Standards for Modified and Reconstructed Secondary Sources: Electric Utility Generating Units – Sets carbon dioxide emission limits for modified or reconstructed electric generators. These limits vary by type of fuel (coal/IGCC or natural gas), size of unit (less than or above approximately 100 megawatts), and whether the unit is modified or reconstructed. EPA issued the final rule on August 3, 2015, and published in the *Federal Register* on October 23, 2015.

- Carbon Pollution Emission Guideline for Existing Electric Generating Units – Requires each state to submit a plan to EPA that outlines how the state’s existing electric generation fleet will meet a series of goals, in terms of pounds of carbon dioxide emitted per generated megawatt-hour, to reduce the state’s carbon dioxide emissions. The guidelines will apply to a statewide average of all generating units over 25 megawatts. EPA issued the final rule on August 3, 2015, and published in the *Federal Register* on October 23, 2015
- Mercury and Air Toxics Standards (MATS) - Sets limits for air emissions from existing and new coal- and oil-fired electric generators with a capacity greater than 25 megawatts. Covered emissions include: mercury and other metals, acid gases, and organic air toxics for all generators, as well as particulate matter, sulfur dioxide, and nitrogen oxide from new and modified coal and oil units. On June 29, 2015, the U.S. Supreme Court found in a 5-4 decision that the EPA acted improperly by not considering the costs of compliance in deciding whether regulation of mercury and air toxics is appropriate and necessary. The court did not explicitly vacate the rule, and remanded the case back to the U.S. Court of Appeals for the D.C. Circuit for further proceedings consistent with its opinion.
- Cross-State Air Pollution Rule (CSAPR) - Requires 28 states, including Florida, to reduce air emissions that contribute to ozone and/or fine particulate pollution in other states. The rule applies to all fossil-fueled (i.e., coal, oil, and natural gas) electric generators with a capacity over 25 megawatts within these states. Florida is only subject to the rule’s seasonal NOx emissions requirements. On July 28, 2015, the U.S. Court of Appeals for the D.C. Circuit issued its opinion on the remaining issues raised with respect to CSAPR, keeping CSAPR in place.
- Cooling Water Intake Structures (CWIS) - Sets impingement standards to reduce harm to aquatic wildlife pinned against cooling water intake structures at electric generating facilities. All existing electric generators that use water for cooling with an intake velocity of at least two million gallons per day must meet impingement standards. Generating units with higher intake velocity may have additional requirements to reduce the damage to aquatic wildlife due to entrapment in the cooling water system (entrainment). The rule became effective on October 14, 2014.
- Coal Combustion Residuals (CCR) - Requires liners and ground monitoring to be installed on new landfills in which coal ash is deposited. On December 19, 2014, the EPA Administrator signed the Disposal of Coal Combustion Residuals from Electric Utilities final rule. The rule will become effective on October 14, 2015

For many of the units that will remain in operation, these new rules will result in an increased cost of operations. Each utility will need to evaluate whether these additional costs or new operational limitations allow the continued economic operation of each affected unit, and whether installation of emissions control equipment, fuel switching, or retirement is the proper course of action.

## **Modernization and Efficiency Improvements**

Modernizations involve removing existing generator units that may no longer be economical to operate, such as oil-fired steam units, and reusing the power plant site's transmission or fuel handling facilities with a new set of generating units. The modernization of existing plant sites, allows for significant improvement in both performance and emissions, typically at a lower price than new construction at a greenfield site. Not all sites are candidates for modernization due to site layout and other concerns, and to minimize rate impacts, modernization of existing units should be considered along with new construction at greenfield sites.

The Commission has previously granted determinations of need for several conversions of oil-fired steam units to natural gas-fired combined cycle units, including FPL's Cape Canaveral, Riviera, and Port Everglades power plants. DEF has also recently conducted a conversion of its Bartow power plant, but this did not require a determination of need from the Commission.

Utilities also plan several efficiency improvements to existing generating units. An example is the conversion of existing simple cycle combustion turbines into a combined cycle unit, which captures the waste heat and uses it to generate additional electricity using a steam turbine. The Commission has granted a determination of need for the conversion of TECO's Polk Units 2 through 5 to a single combined cycle unit. FPL plans on upgrades to its existing combined cycle fleet by improving the performance of the integrated combustion turbines at many of its current and planned power plants.

## **Planned Retirements**

Power plant retirements occur when the electric utility is unable to economically operate or maintain a generating unit due to environmental, economic, or technical concerns. Table 9 below, lists the 4,252 MW of existing generation that is scheduled to be retired during the planning period, a majority of which are natural gas-fired peaking units. Approximately 1,260 MW of the planned retirements are three dozen small peaking units at two power plant sites operated by FPL.

A notable retirement is DEF's Crystal River Units 1 and 2. Originally scheduled to retire in 2016, the retirement of these units have been delayed until 2018. This delay is due in part to a temporary averaging of emissions across the existing four units at the Crystal River site to meet environmental regulations, as Crystal River Units 4 and 5 have pollution controls installed.

Some retired units will continue operation in a different form. FPL intends to retire Turkey Point 1, a large oil-fired steam unit, and convert it to a synchronous condenser to support the transmission system and provide voltage regulation. FPL previously converted Turkey Point 2 to operate as a synchronous condenser.

**Table 9: State of Florida - Electric Generating Units to be Retired**

Year	Utility Name	Unit Name	Fuel & Unit Type	Net Capacity (Sum MW)
2015	GPC	Scholz 1 & 2	Coal Steam	92.0
2015	DEF	G. E. Turner P1 - P4	Distillate Oil Combustion Turbine	132.0
<b>2015 Subtotal</b>				<b>224.0</b>
2016	FPL	Cedar Bay	Coal Steam	250.0
2016	GPC	Lansing Smith 2	Coal Steam	0.0
2016	FPL	Turkey Point 1 [Condensor]	Residual Oil Steam	396.0
2016	JEA	Northside 3 [Reserve Storage]	Natural Gas Steam	524.0
2016	DEF	Avon Park 2	Distillate Oil Combustion Turbine	24.0
2016	DEF	Rio Pinar 1	Distillate Oil Combustion Turbine	12.0
2016	FPL	Ft. Myers 1 - 10	Distillate Oil Combustion Turbine	540.0
2016	DEF	Avon Park 1	Natural Gas Combustion Turbine	24.0
2016	FPL	Lauderdale 1 - 22	Natural Gas Combustion Turbine	754.0
2016	FPL	Port Everglades 1 - 12	Natural Gas Combustion Turbine	408.0
2016	TAL	Hopkins GT1	Natural Gas Combustion Turbine	12.0
2016	TAL	Purdom GT1 & GT2	Natural Gas Combustion Turbine	20.0
<b>2016 Subtotal</b>				<b>2,964.0</b>
2017	DEF	Suwannee River 1 - 2	Natural Gas Steam	57.0
2017	TAL	Hopkins GT2	Natural Gas Combustion Turbine	24.0
<b>2017 Subtotal</b>				<b>81.0</b>
2018	DEF	Crystal River 1 & 2	Coal Steam	740.0
2018	DEF	Suwannee River 3	Natural Gas Steam	71.0
2018	GPC	Pea Ridge 1 - 3	Natural Gas Combustion Turbine	12.0
<b>2018 Subtotal</b>				<b>823.0</b>
2020	DEF	Higgins 1 - 4	Natural Gas Combustion Turbine	109.0
<b>2020 Subtotal</b>				<b>109.0</b>
2021	TAL	Hopkins 1	Natural Gas Steam	76.0
<b>2021 Subtotal</b>				<b>76.0</b>
2022	GRU	Deerhaven FS01	Natural Gas Steam	75.0
<b>2022 Subtotal</b>				<b>75.0</b>
<b>Total Retirements</b>				<b>4,352</b>

Source: 2015 Ten-Year Site Plans

## Reliability Requirements

Florida's electric utilities are expected to have enough generating assets available at the time of peak demand to meet forecasted customer demand. If utilities only had sufficient generating capacity to meet forecasted peak demand, potential instabilities could occur if customer demand exceeds the forecast, or if generating units are unavailable due to maintenance or forced outages. To address these circumstances, utilities are required to maintain additional planned generating capacity above the forecast customer demand, referred to as the reserve margin.

Electric utilities within the Florida Reliability Coordinating Council region, which consists of Peninsular Florida, must maintain a minimum of 15 percent reserve margin for planning purposes. Certain utilities have elected to have a higher reserve margin, either on an annual or seasonal basis. The three largest reporting electric utilities, FPL, DEF, and TECO, are party to a stipulation approved by the Commission that utilizes a 20 percent reserve margin for planning.

While Florida’s electric utilities are separately responsible for maintaining an adequate planning reserve margin, a statewide view illustrates the degree to which capacity may be available for purchases during periods of high demand or unit outages. Figure 13 below, is a projection of the statewide seasonal reserve margin including all proposed power plants.

**Figure 13: State of Florida - Projected Reserve Margin by Season**



Source: 2015 FRCC Load & Resource Plan


### **Role of Demand Response in Reserve Margin**

The Commission also considers the planning reserve margin without demand response. As illustrated in Figure 13 above, the statewide seasonal reserve margin exceeds the FRCC’s required 15 percent planning reserve margin without activation of demand response. Demand response activation increases the reserve margin in summer by 8 percent on average, and represents 30 percent of the planning reserve margin.

Demand response participants receive discounted rates or credits regardless of activation, with these costs recovered from all ratepayers. Because of the voluntary nature of demand response, a concern exists that a heavy reliance upon this resource would make participants eschew the discounted rates or credits for firm service. For interruptible customers, participants must provide notice that they intend to leave the demand response program, with a notice period of three or more years being typical. For load management participants, usually residential or small commercial customers, no advanced notice is typically required to leave. Historically, demand response participants have rarely been called upon during the peak hour, but are more frequently called upon during off-peak periods due to unusual weather conditions.

## Fuel Price Forecast

Fuel price is an important economic factor affecting the dispatch of the existing generating fleet and the selection of new generating units. In general, the capital cost of a power plant is inversely proportional to the cost of the fuel used to generate electricity from that unit. The major fuels consumed by Florida’s electric utilities are natural gas, coal, uranium, and oil. Figure 14 below, illustrates the weighted average fuel price history and forecasts for the reporting electric utilities.

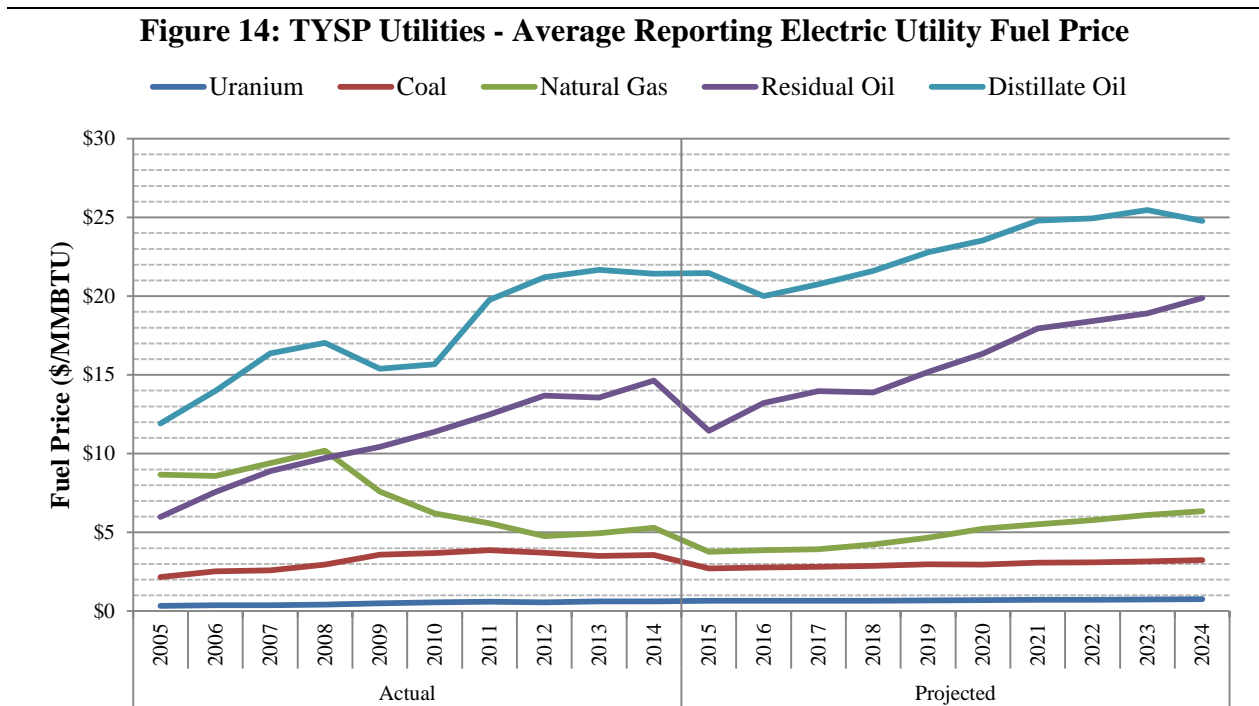


Source: TYSP Utilities Data Responses

From 2003 to 2005, the price of natural gas was substantially higher than utilities had forecast. This natural gas price volatility led to concern regarding escalating customer bills and an expectation that natural gas prices would remain high. As a result, Florida’s electric utilities began making plans to build coal-fired units rather than continuing to increase the reliance on

natural gas. Concerns regarding potential environmental regulations, and other projected costs, lead to this coal-fired generation to not materialize. Traditionally, coal was the lowest cost fuel besides uranium and was dispatched before most natural gas-fired units. While natural gas-fired units have the advantage of a lower heat rate, and therefore consume less units of thermal energy per unit of electrical energy produced, the fuel price differential allowed coal to remain dominant until 2008.

As Figure 15 below shows, the price of natural gas declined rapidly after the financial crisis, and is forecasted to remain at historically low levels. The smaller differential and higher efficiency of natural gas has shifted the dispatch order, with natural gas units displacing some coal units. The trend has also encouraged utilities to modify existing units to be capable of burning natural gas, either as a starter fuel, supplemental fuel, or primary fuel.

**Figure 15: TYSP Utilities - Fuel Price Comparison for Coal and Natural Gas**

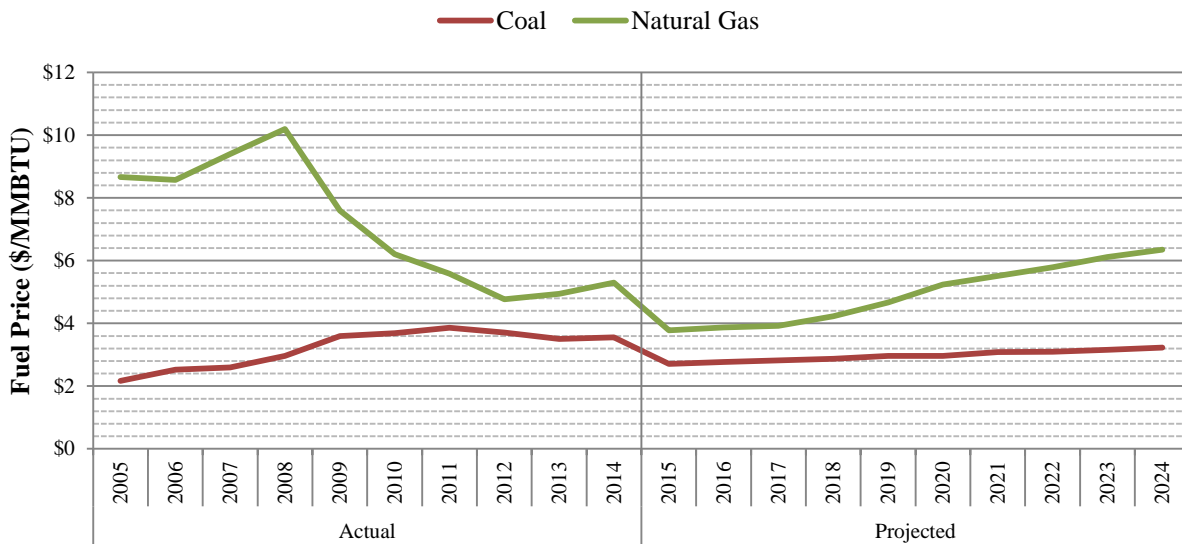


Source: TYSP Utilities Data Responses

## Fuel Diversity

Natural gas has risen to become the dominant fuel in Florida within the last ten years, displacing coal, and since 2010 has generated more net energy for load than all other fuels combined. As Figure 16 below illustrates, natural gas is the source of approximately 60 percent of electric energy consumed in Florida, down from its peak in 2012 of 65 percent. The 2012 spike in usage was associated with extended outages at FPL’s nuclear plants for uprates. Natural gas generation is anticipated to remain somewhat steady at its current level until the end of the planning period.

**Figure 16: State of Florida - Natural Gas Contribution to Energy Consumption**

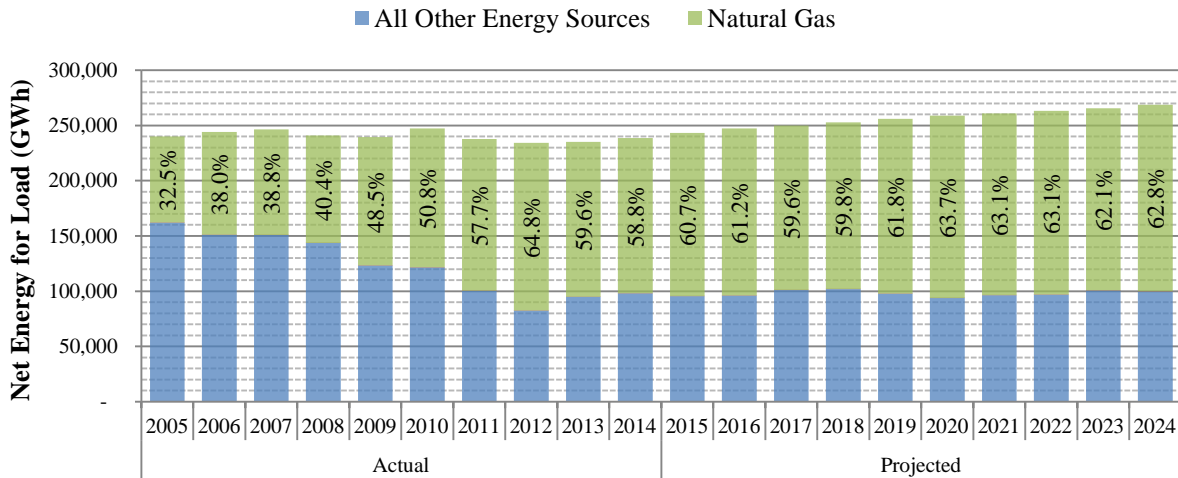


Source: 2006-2015 FRCC Load & Resource Plans

Because a balanced fuel supply can enhance system reliability and mitigate the effects of volatility in fuel price fluctuations, it is important that utilities have a level of flexibility in their generation mix. Maintaining fuel diversity on Florida’s system faces several difficulties. Existing coal units will require additional emissions control equipment leading to reduced output, or retirement if the emissions controls are uneconomic to install or operate. New solid fuel generating units such as nuclear and coal have long lead times and high capital costs. New coal units face challenges relating to new environmental compliance requirements, making it unlikely they could be permitted without novel emissions control technology.

Figure 17 below shows, Florida’s historic and forecast percent net energy for load by fuel type for the actual years 2004 and 2014, and forecast year 2024. Oil has declined significantly, with its uses reduced to start-up fuel, peaking, and back-up for dual-fuel units in case of a fuel outage. Nuclear generation was reduced beginning in 2010 by the outage and eventual retirement of Crystal River 3 and extended outages for uprates at FPL’s St. Lucie and Turkey Point power plants. The resulting capacity leaves Florida’s contribution from nuclear approximately the same even with the loss of one of five nuclear units. While coal generation has declined somewhat, it is expected to rebound slightly and remain at a plateau throughout the planning period. Natural gas has been the primary fuel used to meet the growth energy consumption, and this trend is anticipated to continue throughout the planning period.



**Figure 17: State of Florida - Historic and Forecast Fuel Consumption**

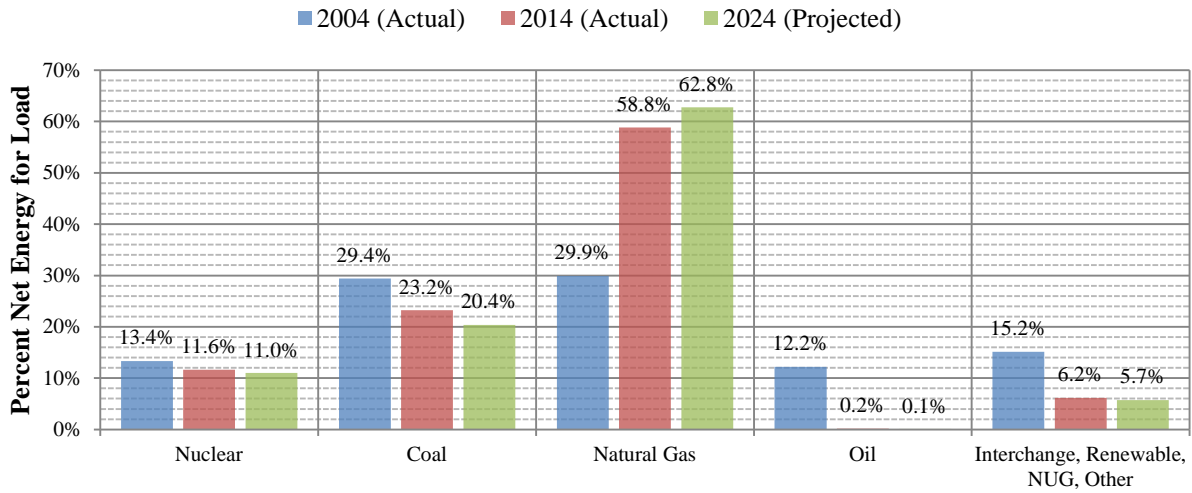

Source: 2005-2015 FRCC Load & Resource Plans

Based on 2012 EIA data, Florida ranks fourth place in terms of the total volume natural gas consumption compared to the rest of the United States. For volume of natural gas consumed for electric generation, Florida ranks second, behind Texas.


Florida’s percentage of natural gas consumption for electric generation is the highest in the country, with 86 percent of all natural gas consumed in the state for electricity. However, these figures do not consider population. On a per capita basis, Florida’s total consumption of natural gas ranks 30<sup>th</sup>, while natural gas consumption for electricity ranks 6<sup>th</sup>. Natural gas is not used as a heating fuel in most of Florida’s homes and businesses, which rely instead upon electricity that is increasingly being generated by natural gas. This leads to Florida’s per capita consumption of natural gas being 15 percent less than the national average, but twice the national average per capita consumption of natural gas for electricity. As Florida has very little natural gas production and no gas storage capacity, the State is reliant upon out-of-state production and storage to satisfy the growing electric demands of the state.

## New Generation Planned

Current demand and energy forecasts continue to indicate that in spite of increased levels of conservation, energy efficiency, renewable generation, and existing traditional generation resources, the need for additional generating capacity still exists. While reductions in demand have been significant, the total demand for electricity is expected to increase, making the addition of traditional generating units necessary to satisfy reliability requirements and provide sufficient electric energy to Florida’s consumers. Because any capacity addition has certain economic impacts based on the capital required for the project, and due to increasing environmental concerns relating to solid fuel-fired generating units, Florida’s utilities must carefully weigh the factors involved in selecting a supply-side resource for future traditional generation projects.

In addition to traditional economic analyses, utilities also consider several strategic factors, such as fuel availability, generation mix, and environmental compliance prior to selecting a new supply-side resource. Limited supplies, access to water or rail delivery points, pipeline capacity, water supply and consumption, land area limitations, cost of environmental controls, and fluctuating fuel costs are all important considerations to the utilities' IRP process.

Figure 18 below, illustrates the present and future aggregate capacity mix. The capacity values in Figure 18 incorporate all proposed additions, changes, and retirements contained in the reporting utilities' 2015 Ten-Year Site Plans and the FRCC's 2015 Load and Resource Plan.

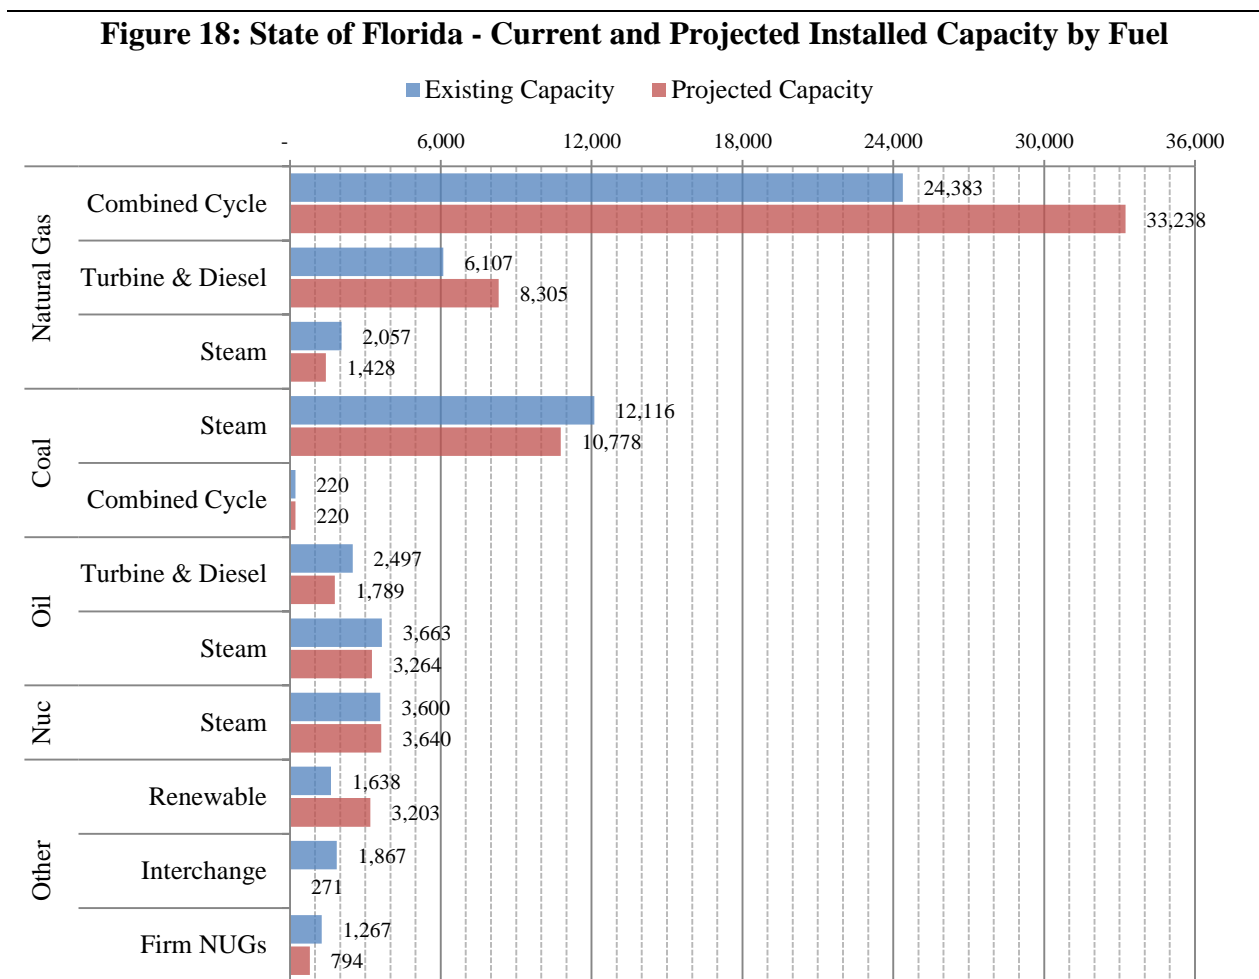

Source: 2015 FRCC Load & Resource Plan and TYSP Utilities Data Responses

## **New Power Plants by Fuel Type**

### ***Nuclear***

Nuclear capacity, while an alternative to natural gas-fired generation, is capital-intensive and requires a long lead time to construct. Previously, FPL had two nuclear projects at Turkey Point that have moved out of the planning horizon for the 2015 TYSP. Florida Power & Light had previously uprated its existing four nuclear generating units, with the last uprate completed in early 2013. While Duke Energy Florida had previously projected the addition of two nuclear units, Levy 1 and 2, it has discontinued this project but continues its efforts to obtain a combined operating license from the Nuclear Regulatory Commission.

### ***Natural Gas***

Excluding renewable and nuclear generation, all remaining new power plants are natural gas-fired combustion turbines or combined cycle units. Combustion turbines run in simple cycle mode as peaking units represent the third most abundant type of generating capacity, behind only coal-fired steam generation. Because combustion turbines are not a form of steam generation, unless part of a combined cycle unit, they do not require siting under the Power Plant Siting Act. Table 10 below, summarizes the approximately 11,548 MW of proposed new natural gas-fired generation included in the 2015 Ten-Year Site Plans.

## **Commission's Authority over Siting**

The Commission has been given exclusive jurisdiction to determine the need for new electric power plants by the Legislature, through the Power Plant Siting Act, contained in Sections 403.501 through 403.518, F.S. Any proposed steam or solar generating unit of at least 75 MW requires a certification under the Power Plant Siting Act. Upon receipt of a determination of need, the electric utility would then seek approval from the Florida Department of Environmental Protection, which addresses land use and environmental concerns. Finally, the Governor and Cabinet, sitting as the Siting Board, ultimate must approve or deny the overall certification of a proposed power plant.

**Table 10: State of Florida - Planned Natural Gas Units**

Year	Utility Name	Plant Name & Unit Number	Fuel & Unit Type	Net Capacity (MW)	Notes
<b>Previously Approved New Units</b>					
2016	FPL	Port Everglades	Natural Gas Combined Cycle	1,237	Docket No. 110309-EI
2017	TEC	Polk CC Conversion	Natural Gas Combined Cycle	459	Docket No. 120234-EI
2018	DEF	Citrus	Natural Gas Combined Cycle	1,640	Docket No. 140110-EI
<b>New Units Requiring PPSA Approval</b>					
2019	FPL	Okeechobee	Natural Gas Combined Cycle	1,622	Docket No. 150196-EI
2021	SEC	Unnamed CC	Natural Gas Combined Cycle	649	
2023	FPL	Combined Cycle Unit	Natural Gas Combined Cycle	1,317	
2023	OUC	Unknown	Natural Gas Combined Cycle	285	
<b>New Units Not Requiring PPSA Approval</b>					
2016	FPL	Ft. Myers 4A & 4B	Natural Gas Combustion Turbines	462	
2016	FPL	Lauderdale 6A - 6E	Natural Gas Combustion Turbines	1,155	
2021	TAL	Hopkins	Natural Gas Combustion Turbines	46	
2021	TEC	Future CT 1	Natural Gas Combustion Turbines	204	
2022	PEC	Mcintosh	Natural Gas Combined Cycle	191	Outside Florida
2022	SEC	Unnamed CT 1	Natural Gas Combustion Turbines	201	
2023	SEC	Unnamed CT 2	Natural Gas Combustion Turbines	201	
2023	GPC	Combustion Turbines	Natural Gas Combustion Turbines	866	
2024	SEC	Unnamed CT 3	Natural Gas Combustion Turbines	201	
2024	DEF	Unknown P1 - P4	Natural Gas Combustion Turbines	812	

Source: 2015 Ten-Year Site Plans

## Transmission

As generation capacity increases, the transmission system must grow accordingly to maintain the capability of delivering energy to end users. The Commission has been given broad authority pursuant to Chapter 366, F.S., to require reliability within Florida’s coordinated electric grid and to ensure the planning, development, and maintenance of adequate generation, transmission, and distribution facilities within the state.

The Commission has authority over certain proposed transmission lines under the Transmission Line Siting Act (TLSA), contained in Sections 403.52 through 403.5365, F.S. To require certification under Florida’s TLSA, a proposed transmission line must meet the following criteria: a nominal voltage rating of at least 230 kV, crossing a county line, and a length of at least 15 miles. Proposed lines in an existing corridor are also exempt from TLSA requirements. The Commission determines the reliability need and the proposed starting and end points for lines requiring TLSA certification. The proposed corridor route is subsequently determined by the Florida Department of Environmental Protection during the certification process. Much like the PPSA, the Governor and Cabinet sitting as the Siting Board ultimately must approve or deny the overall certification of a proposed line.

Table 11 below, lists all proposed transmission lines in the 2015 Ten-Year Site Plans that require TLSA certification. All planned lines have already received the approval of the Commission, either independently or as part of a PPSA determination of need.

**Table 11: State of Florida - Planned Transmission Lines**

Utility	Transmission Line	Line Length	Nominal Voltage	Date Need Approved	Date TLSA Certified	In-Service Date
		(miles)	(kV)			
FPL	St Johns - Pringle	25	230	-	04/21/2006	12/01/2018
FPL	Levee - Midway	150	500		04/20/1990	06/01/2023

Source: 2015 Ten-Year Site Plans

# Utility Perspectives


## Florida Power & Light Company (FPL)

FPL is an investor-owned utility and Florida’s largest electric utility. The utility’s service territory is within the FRCC region and is primarily in south Florida and along the east coast. As an investor-owned utility, the Commission has regulatory authority over all aspects of operations, including rates, reliability, and safety. Pursuant to Section 186.801(2), F.S., the Commission finds FPL’s 2015 Ten-Year Site Plan suitable for planning purposes.

### Load and Energy Forecasts

In 2014, FPL had approximately 4,708,829 customers and annual retail energy sales of 104,389 GWh or approximately 47.7 percent of Florida’s annual retail energy sales. Figure 19 below, illustrates the company’s historic and forecast number of customers and retail energy sales, in terms of percentage growth from 2005. Over the past ten years, FPL’s customer base has increased by 8.95 percent, while retail sales have grown by 2.05 percent. Since 2009, FPL has been outperforming the state average in retail energy sales growth, a trend it projects to continue into the future.

**Figure 19: FPL Growth Rate**

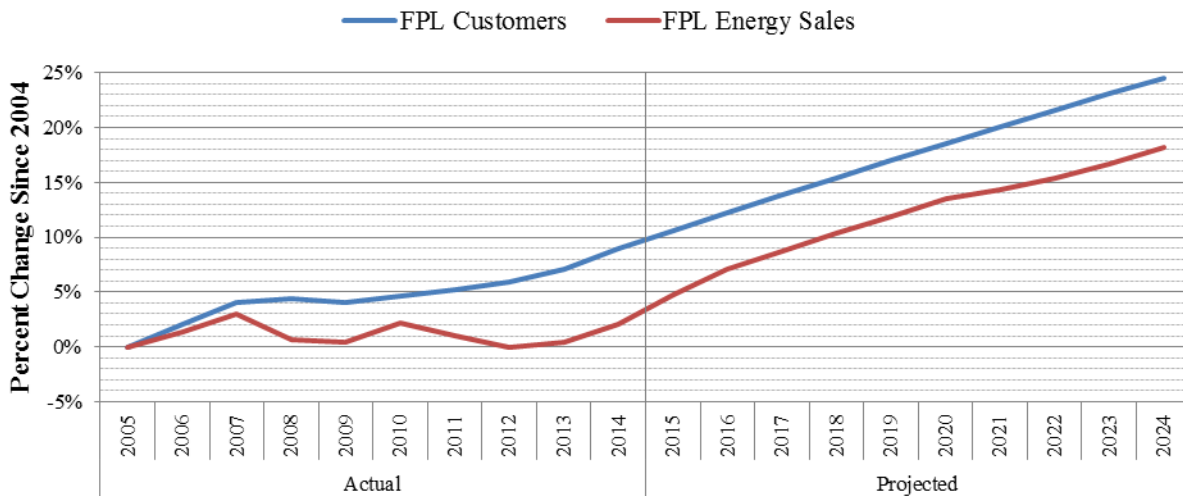


Source: 2015 Ten Year Site Plan

The three graphs in Figure 20 below, show’s FPL’s seasonal peak demand and net energy for load, for the historic years 2005 through 2014 and forecast years 2015 through 2024. These graphs include the impact of demand-side management, and for future years assume that all available demand response resources will be activated during the seasonal peak. Historically, demand response was not activated during the seasonal peak demand, excluding the winters of 2010 and 2011.

As an investor owned utility, FPL is subject to FEECA and currently offers energy efficiency and demand response programs to customers to reduce peak demand and annual energy consumption. The utility's 2015 Ten-Year Site Plan reflects the recently revised demand-side management goals established by the Commission in December 2014.

**Figure 20: FPL Demand and Energy Forecasts**

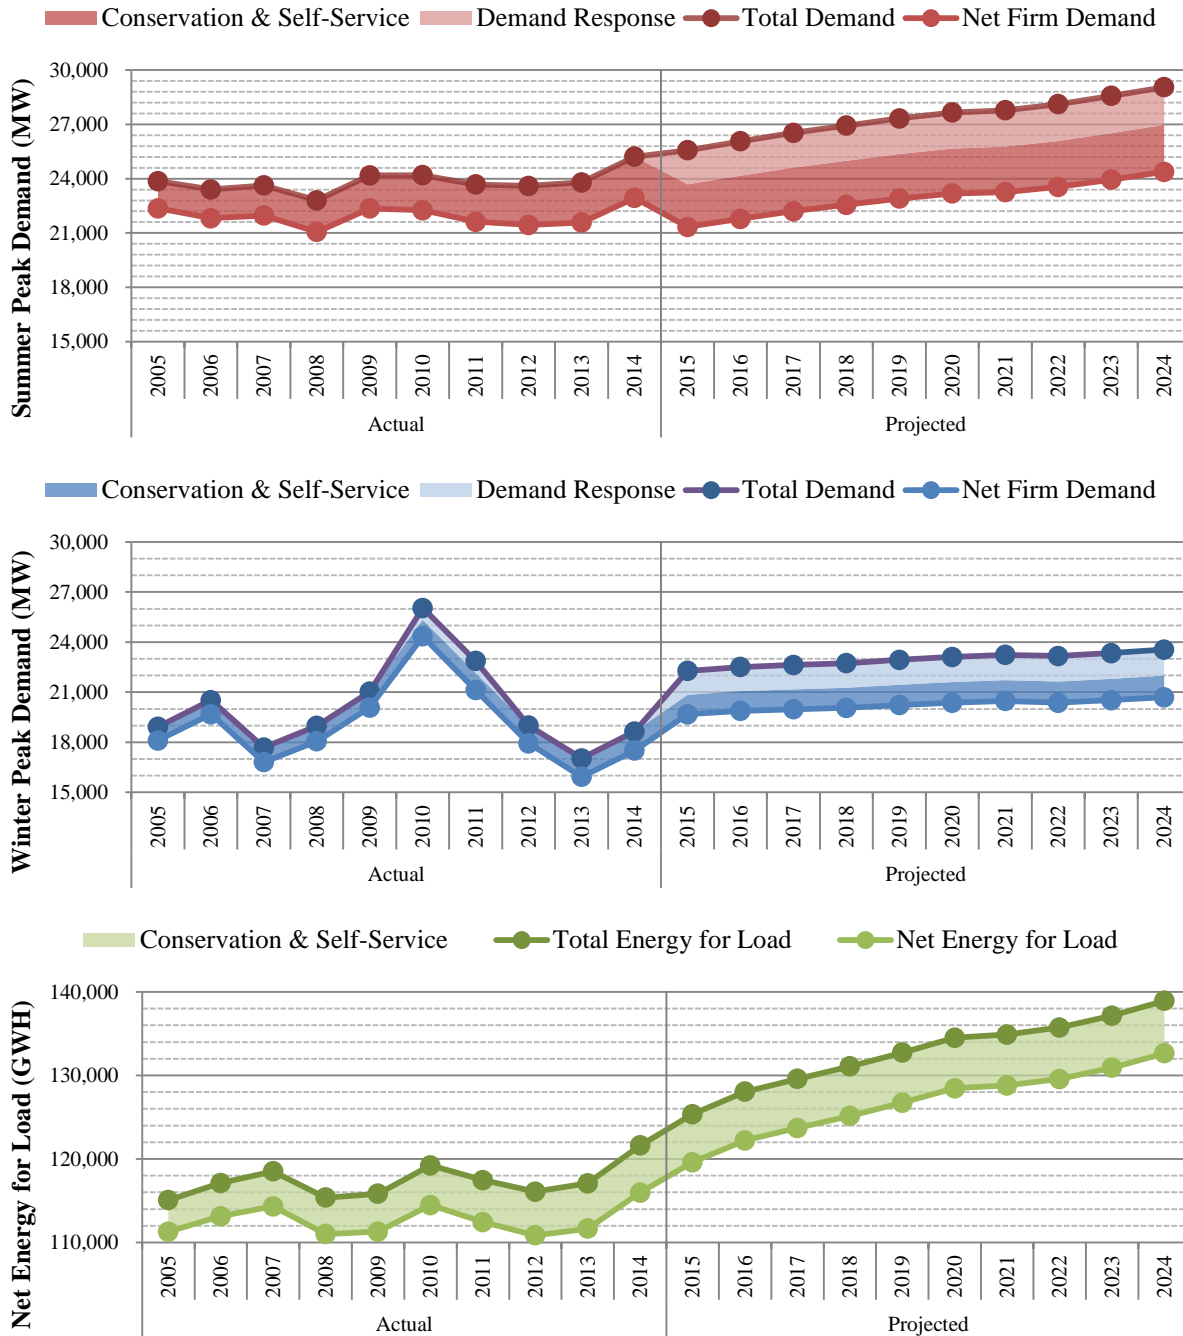

Source: 2015 Ten-Year Site Plan and Data Responses



## Fuel Diversity

Table 12 below, shows FPL’s actual net energy for load for fuel type for 2014, and the projected fuel mix for 2024. FPL relies primarily upon natural gas and nuclear for energy generation, making up approximately 90 percent of net energy for load.

**Table 12: FPL Energy Consumption by Fuel Type**

Fuel Type	Net Energy for Load			
	2014		2024	
	GWh	%	GWh	%
<b>Natural Gas</b>	79,102	<b>68.2%</b>	96,618	<b>72.5%</b>
<b>Coal</b>	4,482	<b>3.9%</b>	3,087	<b>2.3%</b>
<b>Nuclear</b>	26,812	<b>23.1%</b>	28,637	<b>21.5%</b>
<b>Oil</b>	359	<b>0.3%</b>	136	<b>0.1%</b>
<b>Renewable</b>	177	<b>0.2%</b>	691	<b>0.5%</b>
<b>Interchange</b>	4,908	<b>4.2%</b>	0	<b>0.0%</b>
<b>NUG &amp; Other</b>	127	<b>0.1%</b>	4,107	<b>3.1%</b>
<b>Total</b>	<b>115,968</b>		<b>133,276</b>	

Source: 2015 Ten Year Site Plan

## Reliability Requirements

While previously only reserve margin has been discussed, Florida’s utilities use multiple indices to determine the reliability of the electric supply. An additional metric is the Loss of Load Probability (LOLP), which is a probabilistic assessment of the duration of time electric customer demand will exceed electric supply, and is measured in units of days per year. FPL uses a maximum LOLP of no more than 0.1 days per year, or approximately 1 day of outage per ten years. Between the two reliability indices, LOLP and reserve margin, the reserve margin requirement is typically the controlling factor for the addition of capacity.

Since 1999, FPL has utilized a 20 percent planning reserve margin criterion. Figure 21 below, displays the forecast planning reserve margin for FPL through the planning period for both seasons, with and without the use of demand response. As shown in the figure, FPL’s generation needs are controlled by its summer peak throughout the planning period.

**Figure 21: FPL Reserve Margin Forecast**



Source: 2015 Ten Year Site Plan

In addition to LOLP and the reserve margin, FPL utilizes a third reliability criterion. FPL’s criterion would be to have available firm capacity 10 percent greater than the sum of customer seasonal demand, without consideration of incremental energy efficiency and all existing and incremental demand response resources. FPL refers to this as its 10 percent generation-only reserve margin. Currently, no other utility utilizes this same metric. While TECO includes a minimum supply-side contribution in its planning methodology, TECO uses a lower value of seven percent and incremental energy efficiency is included in its calculation.

While FPL does not include incremental energy efficiency resources and cumulative demand response in its resource planning for the generation-only reserve margin criterion, the utility would remain subject to FEECA and the conservation goals established by the Commission. FPL would continue paying rebates and other incentives to participants, which are collected from all ratepayers through the Energy Conservation Cost Recovery Clause, but would not consider the potential capacity reductions of any future participation in energy efficiency or demand response

programs during the ten-year planning period for planning purposes with this new reliability criterion only.

Energy efficiency, which includes installation of equipment designed to reduce peak demand and annual energy consumption, is considered a passive resource. While demand response must be activated by the utility, energy efficiency provides benefits consistently for the duration of the installation, reducing annual energy consumption, and if usage is coincident with system peak, peak demand. Customers do not remove building envelope improvements or newly installed equipment until the end of its service life for replacement.

As noted in the Statewide Perspective, the Commission does review the impact on reserve margin of demand response resources. At this time, FPL offers two types of demand response programs. The first type is interruptible and curtailable load programs, consisting of the Commercial/Industrial Load Control Program (CILC) and Commercial/Industrial Demand Reduction Rider (CDR) tariffs. The second type is load management programs, including the Residential On-Call and Business On-Call Programs. FPL utilizes load management programs on residential customers more often than commercial/industrial customers.

FPL's generation-only reserve margin is not the controlling factor for any planned unit additions. However, it does provide useful information regarding the assurance that the projected 20% reserve margin will be realized.

## **Generation Resources**

FPL plans multiple unit retirements and additions during the planning period, as described in Table 13 below. FPL's 2014 Ten Year Site Plan included the acquisition of Vero Beach's generating units. FPL's 2015 plan does not include this acquisition. The projected in-service dates of FPL's new planned nuclear units are now outside the 10-year planning period of 2015's Ten Year Site Plan. FPL included the addition of three new natural gas-fired combined cycle unit. Port Everglades combined cycle is expected to come online in 2016. FPL filed a need determination with the Commission for the Okeechobee Unit on September 3, 2015.

**Table 13: FPL Generation Resource Changes**

<b>Year</b>	<b>Unit Name</b>	<b>Fuel &amp; Unit Type</b>	<b>Net Capacity (Sum MW)</b>	<b>Notes</b>
<b>Retiring Units</b>				
2016	Turkey Point 1	Residual Oil Steam	396	Synchronous Condenser
2016	Ft. Myers 1 - 10	Distillate Oil Combustion Turbine	540	
2016	Cedar Bay	Coal Steam	250	Docket 150075-EI
2016	Lauderdale 1 - 22	Natural Gas Combustion Turbine	754	
2016	Port Everglades 1 - 12	Natural Gas Combustion Turbine	408	
<b>Retiring Units Total</b>			<b>2,348</b>	
<b>New Units</b>				
2016	Ft. Myers 4A & 4B	Natural Gas Combustion Turbine	462	
2016	Lauderdale 6A - 6E	Natural Gas Combustion Turbine	1,155	
2016	Port Everglades	Natural Gas Combined Cycle	1,237	Docket No. 110309-EI
2019	Okeechobee	Natural Gas Combined Cycle	1,622	Docket No. 150196-EI
2023	Unsitd Unit	Natural Gas Combined Cycle	1,317	Requires PPSA
<b>New Units Total</b>			<b>5,793</b>	
<b>Net Additions</b>			<b>3,445</b>	

Source: 2015 Ten Year Site Plan


## Duke Energy Florida, Inc. (DEF)

DEF is an investor-owned utility and Florida’s second largest electric utility. The utility’s service territory is within the FRCC region and is primarily in central and west central Florida. As an investor-owned utility, the Commission has regulatory authority over all aspects of operations, including rates, reliability, and safety. Pursuant to Section 186.801(2), F.S., the Commission finds DEF’s 2015 Ten-Year Site Plan suitable for planning purposes.

### Load & Energy Forecasts

In 2014, DEF had approximately 1,683,454 customers and annual retail energy sales of 37,240 GWh or approximately 16.9 percent of Florida’s annual retail energy sales. Figure 22 below, illustrates the company’s historic and forecast number of customers and retail energy sales, in terms of percentage growth from 2005. Over the last ten years, DEF’s customer base has increased by 6.88 percent, while retail sales have declined by 4.13 percent. As illustrated retail energy sales are anticipated to exceed the historic 2006 peak by 2020, three years later than the state as a whole.


**Figure 22: DEF Growth Rate**

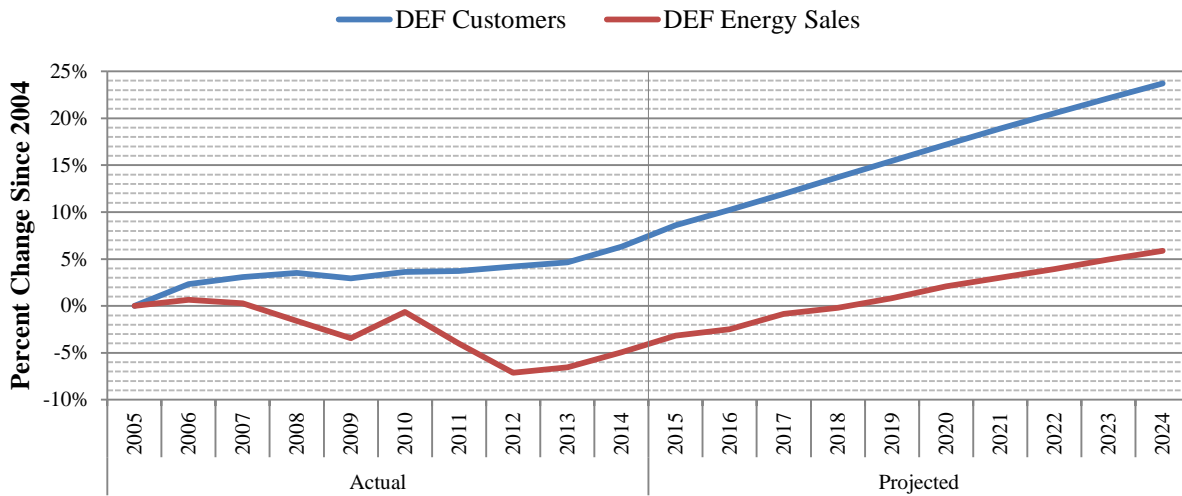

Source: 2015 Ten-Year Site Plan

The three graphs in Figure 23 below shows, DEF’s seasonal peak demand and net energy for load for the historic years of 2005 through 2014 and forecast years 2015 through 2024. These graphs include the full impact of demand-side management, and assume that all available demand response resources were or will be activated during the seasonal peak. Historically, demand response has not been activated during seasonal peak demand, excluding extreme weather events. As an investor-owned utility, DEF is subject to FEECA, and currently offers energy efficiency and demand response programs to customers to reduce peak demand and annual energy consumption. The utility's 2015 Ten-Year Site Plan reflects the recently revised demand-side management goals established by the Commission in December 2014.

**Figure 23: DEF Demand and Energy Forecasts**

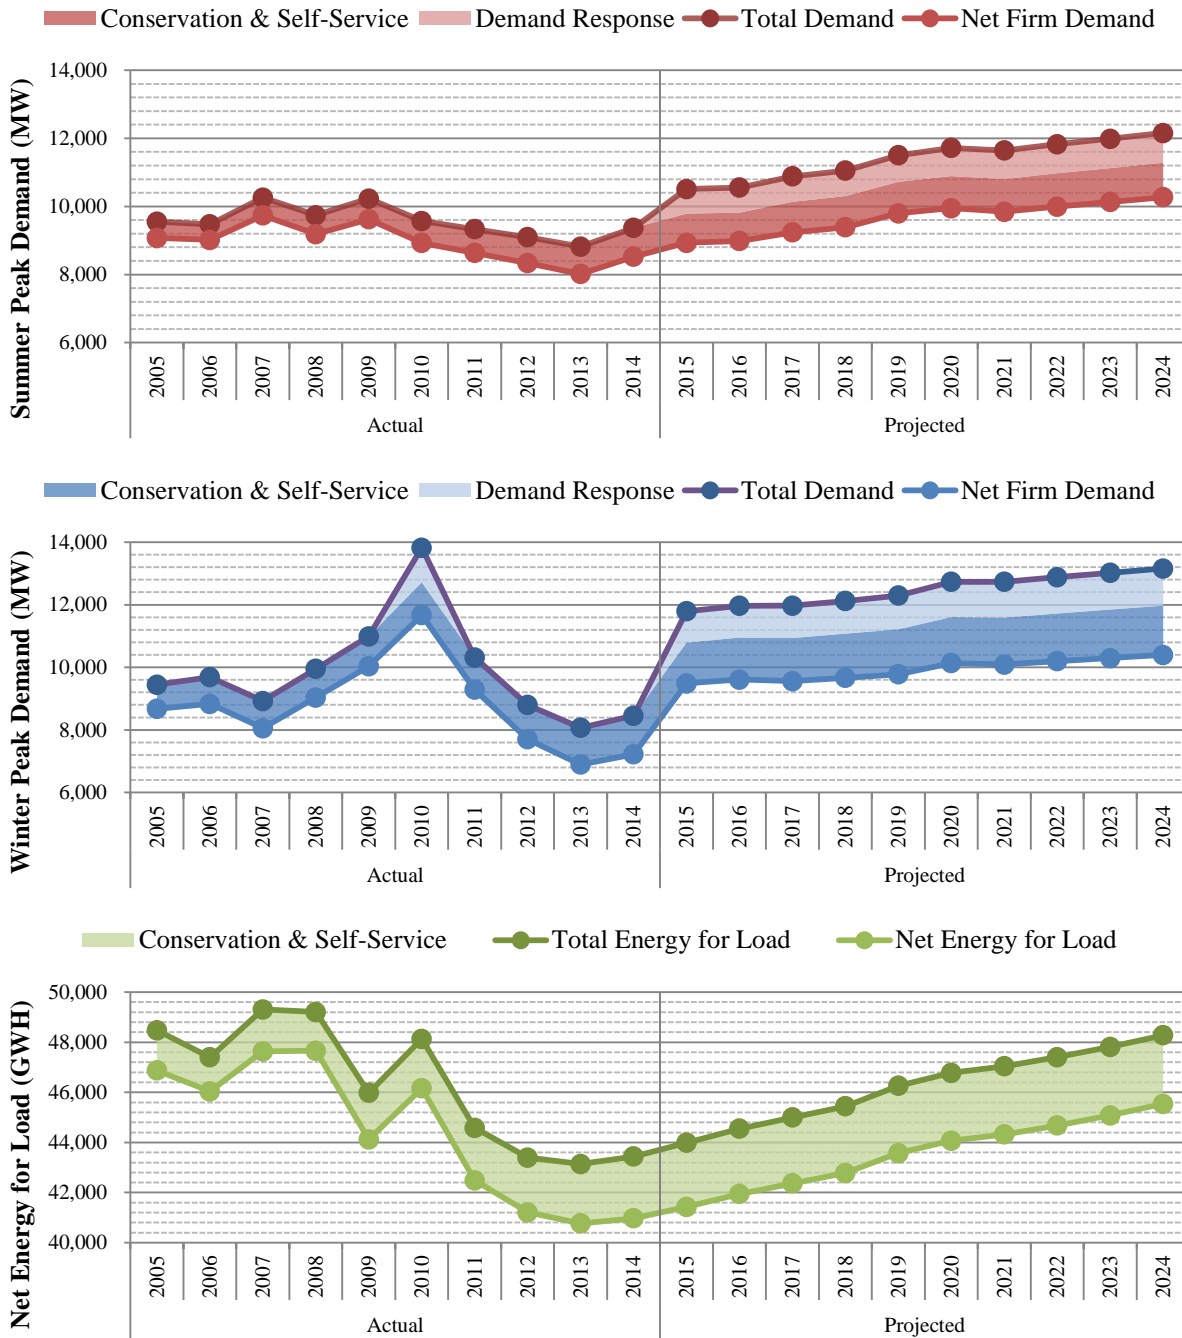

Source: 2015 Ten-Year Site Plan and Data Responses

## Fuel Diversity

Table 14 below shows, DEF's actual net energy for load by fuel type as of 2014 and the projected fuel mix for 2024. DEF relies primarily upon natural gas and coal for energy generation, making up approximately 80 percent of net energy for load. DEF plans to

substantially reduce coal usage over the planning period, but coal usage will be greater than all other energy types excluding natural gas.

**Table 14: DEF Energy Consumption by Fuel Type**

Fuel Type	Net Energy for Load			
	2014		2024	
	GWh	%	GWh	%
Natural Gas	22,962	56.0%	36,559	80.3%
Coal	11,760	28.7%	5,214	11.4%
Nuclear	0	0.0%	0	0.0%
Oil	38	0.1%	24	0.1%
Renewable	927	2.3%	2,152	4.7%
Interchange	1,755	4.3%	183	0.4%
NUG & Other	3,533	8.6%	1,412	3.1%
<b>Total</b>	<b>40,975</b>		<b>45,543</b>	

Source: 2015 Ten-Year Site Plan and Data Responses

## Reliability Requirements

Since 1999, DEF has utilized a 20 percent planning reserve margin criterion. Figure 24 below displays, the forecast planning reserve margin for DEF through the planning period for both seasons, with and without the use of demand response. As shown in the figure, DEF's generation needs are controlled by its summer peaking throughout the planning period. While the utility's summer planning reserve margin dips below 20 percent in 2018, the deficiency is only 19.6 MW and is anticipated to be resolved by 2019.

**Figure 24: DEF Reserve Margin Forecast**



Source: 2015 Ten-Year Site Plan

## Generation Resources

DEF plans multiple unit retirements and additions during the planning period, as described below in Table 15. DEF’s 2015 Ten-Year Site Plan includes the retirement of the coal-fired Crystal River Units 1 and 2, to be replaced by a pair of natural gas-fired combined cycle units.

In addition to the units discussed above, DEF includes the retirement of five oil-fired units and eight natural gas-fired units at multiple power plant sites. An additional new combined cycle is planned for 2021 which will require a determination of need from the Commission



Table 15: DEF Generation Resource Changes

Year	Unit Name	Fuel & Unit Type	Net Capacity (Sum MW)	Notes
<b>Retiring Units</b>				
2015	G. E. Turner P1 - P4	Distillate Oil Combustion Turbine	132	
2016	Avon Park 2	Distillate Oil Combustion Turbine	24	
2016	Rio Pinar 1	Distillate Oil Combustion Turbine	12	
2016	Avon Park 1	Natural Gas Combustion Turbine	24	
2017	Suwannee River 1 - 2	Natural Gas Steam	57	
2018	Suwannee River 3	Natural Gas Steam	71	
2018	Crystal River 1 & 2	Coal Steam	740	
2020	Higgins 1 - 4	Natural Gas Combustion Turbine	109	
<b>Retiring Units Total</b>			<b>1,169</b>	
<b>New Units</b>				
2018	Citrus	Natural Gas Combined Cycle	1,640	Docket No. 140110-EI
2024	Unknown P1 - P4	Natural Gas Combustion Turbine	812	
<b>New Units Total</b>			<b>2,452</b>	
<b>Net Additions</b>			<b>1,283</b>	

Source: 2015 Ten-Year Site Plan


# Tampa Electric Company (TECO)

TECO is an investor-owned utility and Florida’s third largest electric utility. The utility’s service territory is within the FRCC region and consists primarily of the Tampa metropolitan area. As an investor-owned utility, the Commission has regulatory authority over all aspects of operations, including rates, reliability, and safety. Pursuant to Section 186.801(2), F.S., the Commission finds TECO’s 2015 Ten-Year Site Plan suitable for planning purposes.

## Load & Energy Forecasts

In 2014, TECO had approximately 706,161 customers and annual retail energy sales of 18,526 GWh or approximately 8.5 percent of Florida’s annual retail energy sales. Figure 25 below, illustrates the company’s historic and forecast number of customers and retail energy sales, in terms of percentage growth from 2005. Over the last 10 years, TECO’s customer base has increased by 11 percent, while retail sales have declined by 2.06 percent. As illustrated retail energy sales are anticipated to exceed the historic 2007 peak by 2020, three years later than the state as a whole.


**Figure 25: TECO Growth Rate**

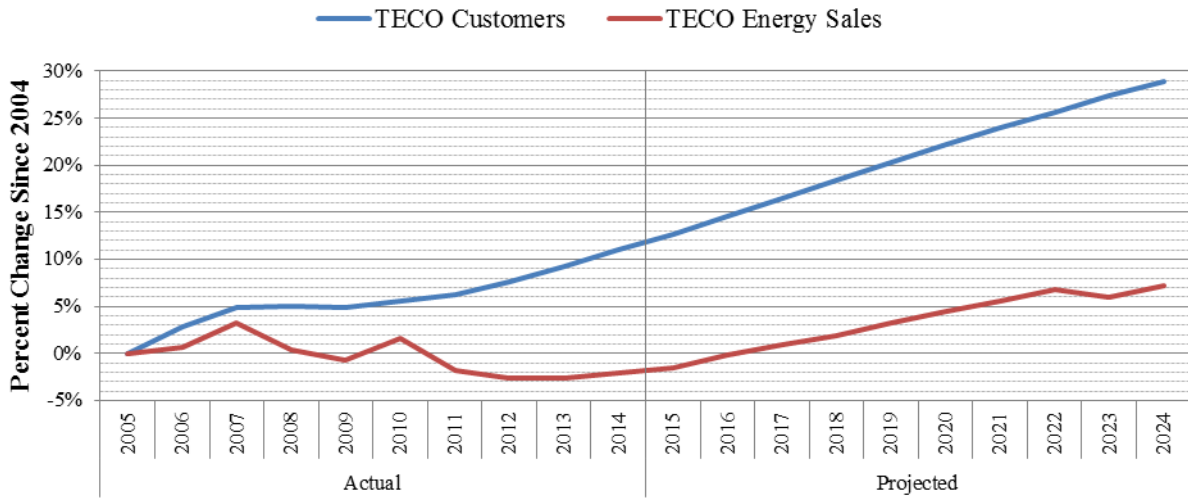

Source: 2015 Ten-Year Site Plan

The three graphs in Figure 26 below, shows TECO’s seasonal peak demand and net energy for load for the historic years of 2005 through 2014 and forecast years 2015 through 2024. These graphs include the full impact of demand-side management, and assume that all available demand response resources were or will be activated during the seasonal peak. Historically, demand response has not been activated during seasonal peak demand excluding extreme weather events.

**Figure 26: TECO Demand and Energy Forecasts**

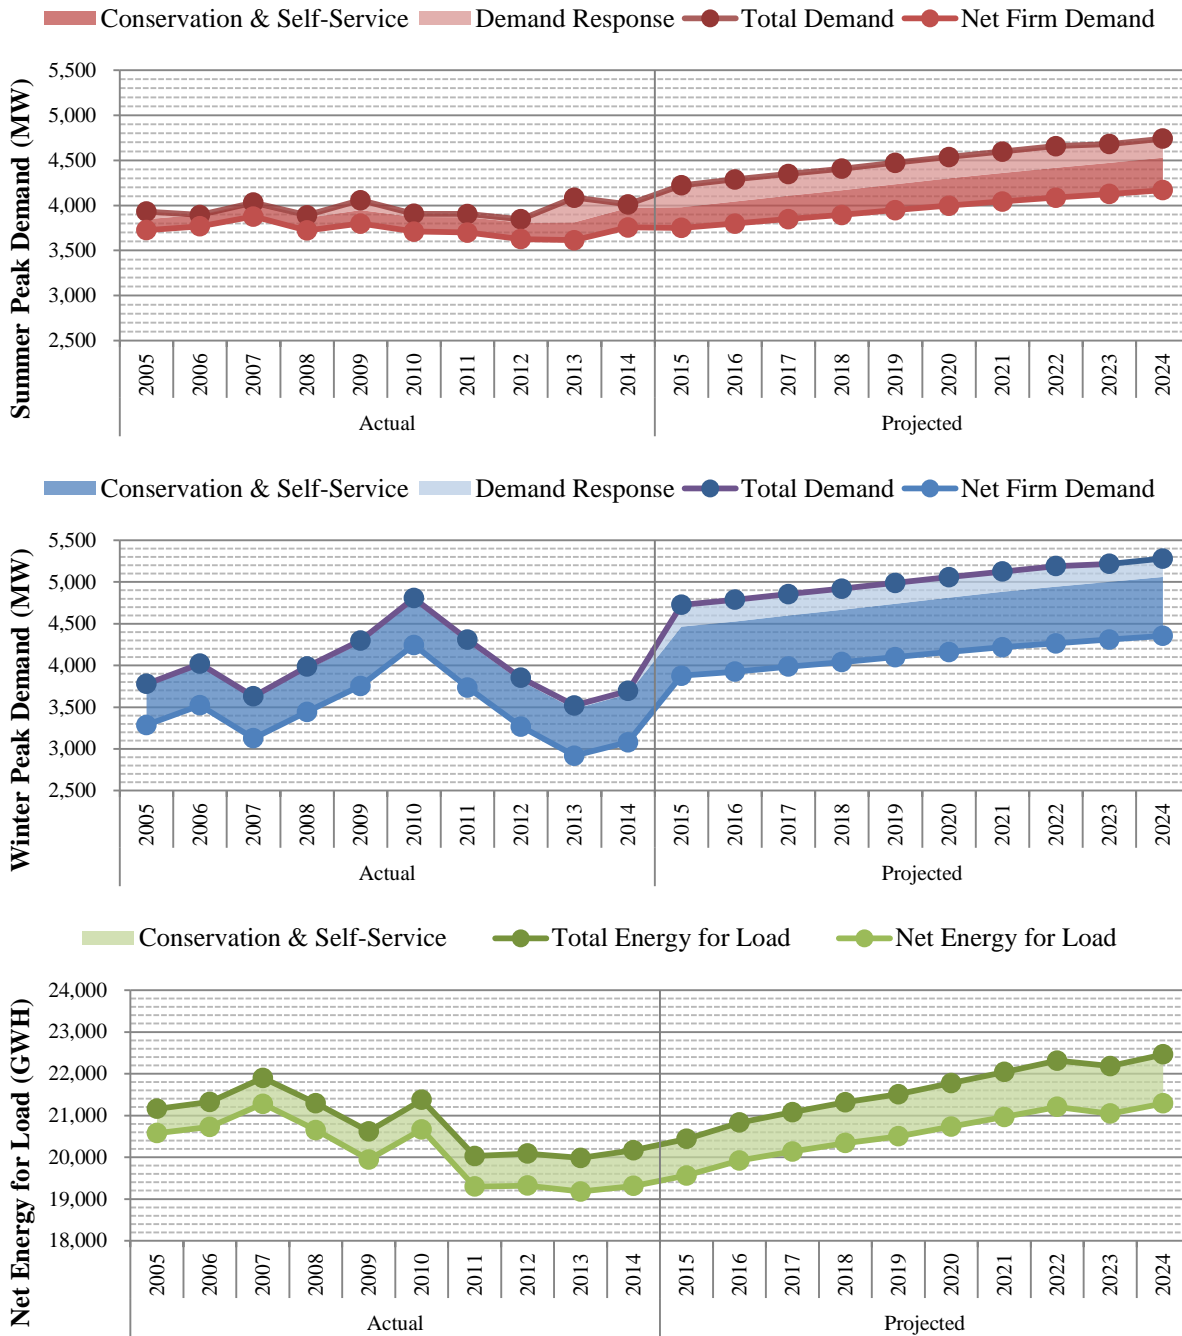

Source: 2015 Ten-Year Site Plan and Data Responses

As an investor-owned utility, TECO is subject to FEECA and currently offers energy efficiency and demand response programs to customers to reduce peak demand and annual energy consumption. The utility's 2015 Ten-Year Site Plan reflects the recently revised demand-side management goals established by the Commission in December 2014.

## Fuel Diversity

Table 16 below, shows TECO’s actual net energy for load by fuel type as of 2014 and the projected fuel mix for 2024. TECO uses coal for a majority of energy generation, and based on the 2015 Ten-Year Site Plan, actual energy from coal equal to all other sources combined. Natural gas is the second largest source of energy for the utility, at approximately 40 percent of net energy for load. In the future, TECO projects that energy from coal and gas will be approximately the same.

**Table 16: TECO Energy Consumption by Fuel Type**


Fuel Type	Net Energy for Load			
	2014		2024	
	GWh	%	GWh	%
Natural Gas	7,116	36.8%	10,197	47.9%
Coal	10,383	53.8%	9,755	45.8%
Nuclear	0	0.0%	0	0.0%
Oil	0	0.0%	0	0.0%
Renewable	272	1.4%	183	0.9%
Interchange	194	1.0%	0	0.0%
NUG & Other	1,351	7.0%	1,153	5.4%
<b>Total</b>	<b>19,315</b>		<b>21,288</b>	

Source: 2015 Ten-Year Site Plan and Data Responses

## Reliability Requirements

Since 1999, TECO has utilized a 20 percent planning reserve margin criterion. TECO also elects to maintain a minimum supply-side reserve margin of 7 percent. Figure 27 below, displays the forecast planning reserve margin for TECO through the planning period for both seasons, with and without the use of demand response. As shown in the figure, TECO’s generation needs are controlled by its summer peaking throughout the planning period.

**Figure 27: TECO Reserve Margin Forecast**

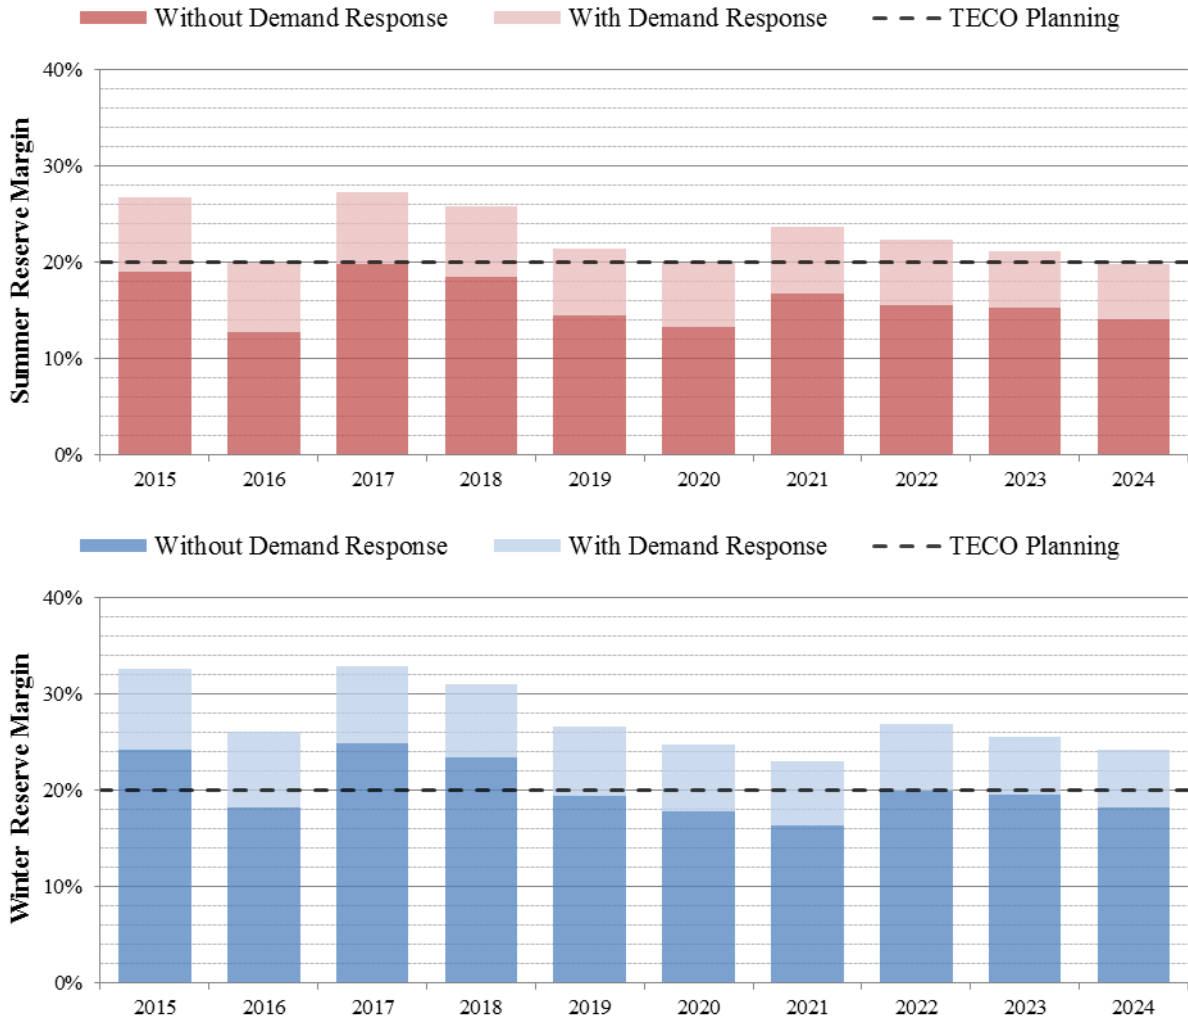

Source: 2015 Ten-Year Site Plan

## Generation Resources

TECO plans a pair of unit additions during the planning period, as described in Table 17 below. TECO plans to convert a set of four natural gas-fired simple cycle combustion turbines at its Polk power plant to combined cycle operation. The additional capacity associated with the modernization is listed below, and has already been certified through the Power Plant Siting Act. TECO also plans the addition of a peaking unit, a natural gas-fired combustion turbine in 2021.

---

**Table 17: TECO Generation Resource Changes**

<b>Year</b>	<b>Unit Name</b>	<b>Fuel &amp; Unit Type</b>	<b>Net Capacity (Sum MW)</b>	<b>Notes</b>
<b>New Units</b>				
2017	Polk CC Conversion	Natural Gas Combined Cycle	459	Docket No. 120234-EI
2021	Future CT 1	Natural Gas Combustion Turbine	204	
<b>New Units Total</b>			<b>663</b>	
<b>Net Additions</b>			<b>663</b>	

Source: 2015 Ten-Year Site Plan

---


# Gulf Power Company (GPC)

GPC is an investor owned utility, and is Florida’s sixth largest electric utility. It represents the smallest of the generating investor-owned utilities, and the only one inside the Southern Company electric system. As GPC plans and operates its system in conjunction with the other Southern Company utilities, not all of the energy generated by GPC is consumed within Florida. As an investor-owned utility, the Commission has regulatory authority over all aspects of operations, including rates, reliability, and safety. Pursuant to Section 186.801(2), F.S., the Commission finds GPC’s 2015 Ten-Year Site Plan suitable for planning purposes.

## Load & Energy Forecasts

In 2014, GPC had approximately 442,370 customers and annual retail energy sales of 11,075 GWh or approximately 5.1 percent of Florida’s annual retail energy sales. Figure 28 below, illustrates the company’s historic and forecast number of customers and retail energy sales, in terms of percentage growth from 2005. Over the last ten years, GPC’s customer base has increased by 9.47 percent, while retail sales have declined by 1.46 percent. As illustrated retail energy sales are anticipated to exceed the historic 2008 peak by 2022, six years later than the state as a whole.


**Figure 28: GPC Growth Rate**

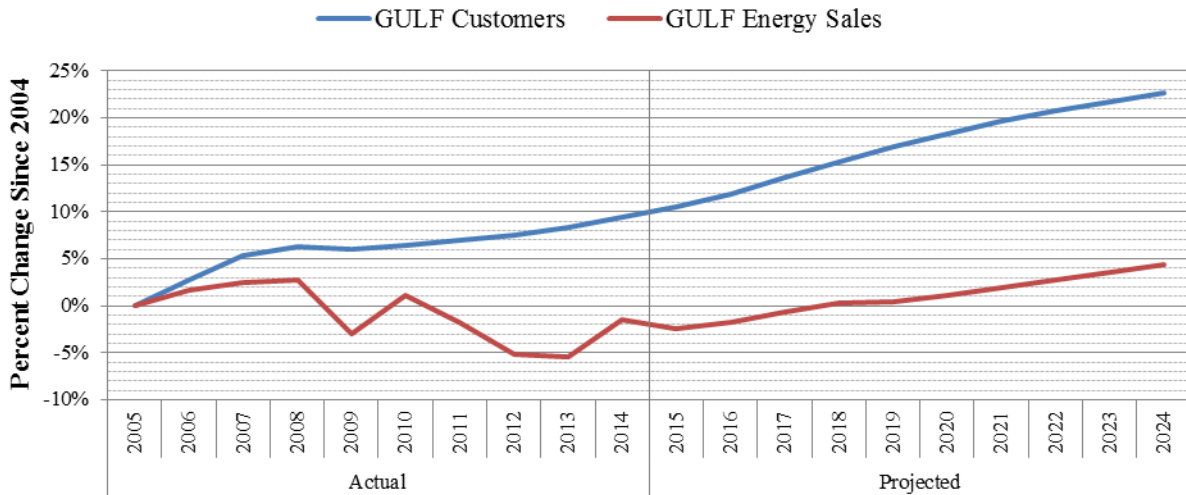

Source: 2015 Ten-Year Site Plan

The three graphs in Figure 29 below, shows GPC’s seasonal peak demand and net energy for load for the historic years of 2005 through 2014 and forecast years 2015 through 2024. These graphs include the full impact of demand-side management.

**Figure 29: GPC Demand and Energy Forecasts**

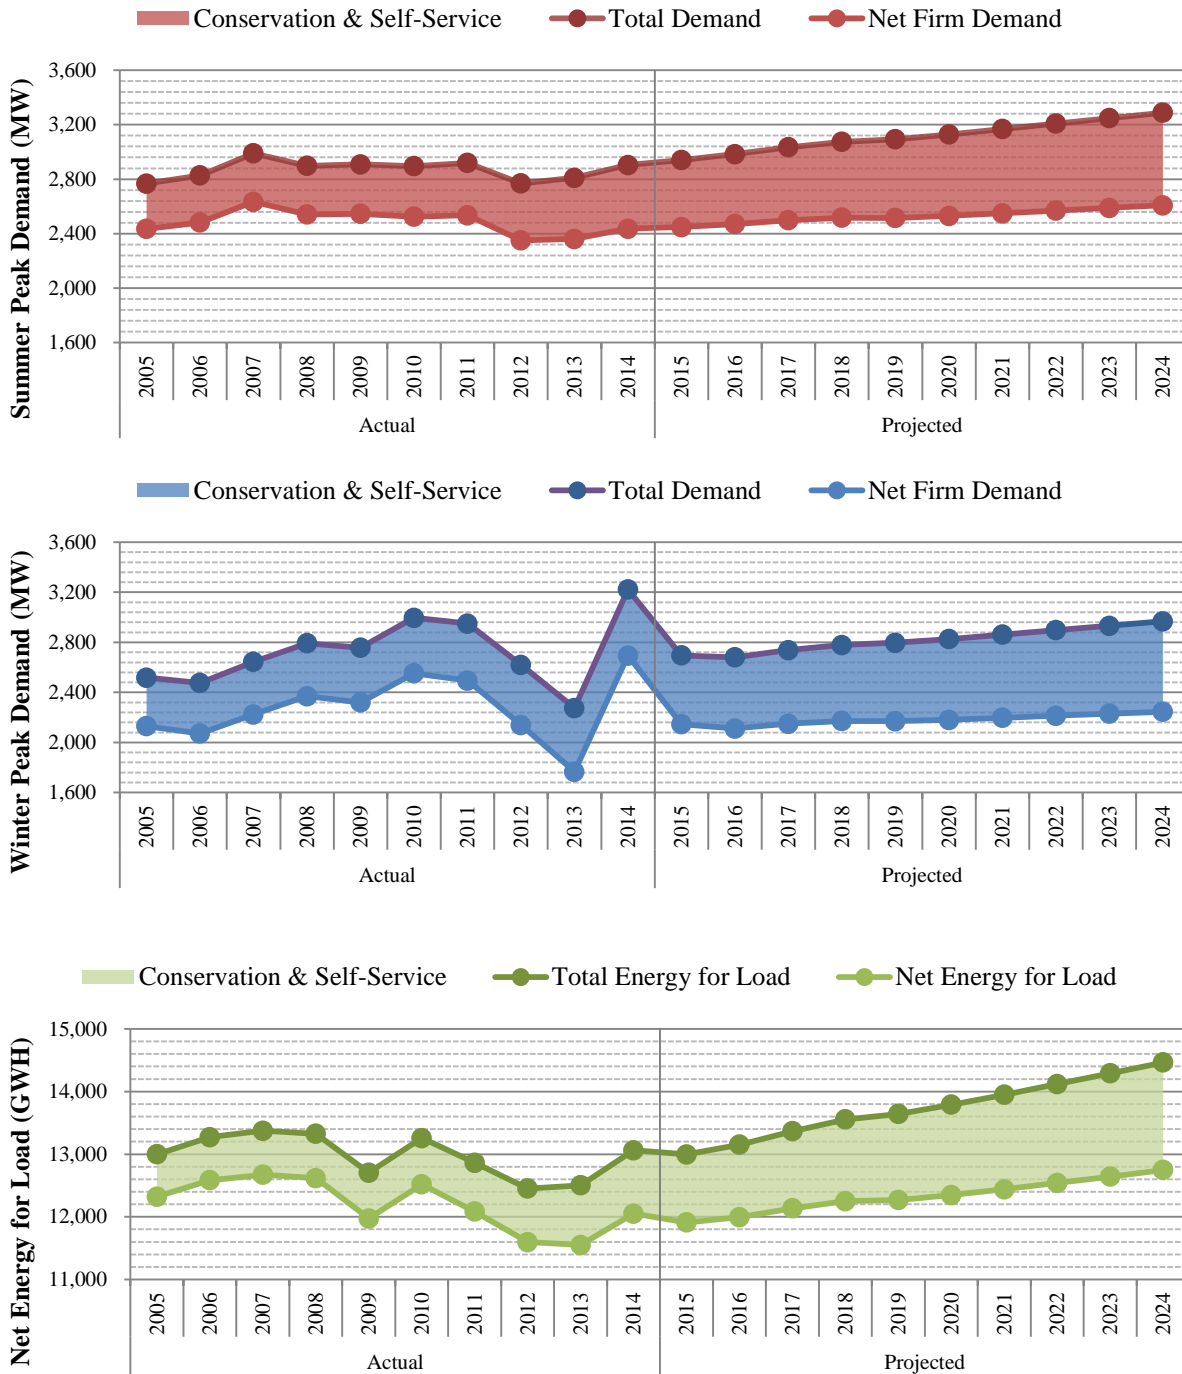

Source: 2015 Ten-Year Site Plan and Data Responses

As an investor-owned utility, GPC is subject to FEECA and currently offers energy efficiency and demand response programs to customers to reduce peak demand and annual energy consumption. The utility's 2015 Ten-Year Site Plan reflects the recently revised demand-side management goals established by the Commission in December 2014.



## Fuel Diversity

Table 18 below, shows GPC’s actual net energy for load by fuel type as of 2014, and the projected fuel mix for 2024. GPC is an energy exporter, producing over a quarter more energy than it requires for native load. While natural gas was the dominant fuel source in 2014, coal made up approximately half of energy produced. By 2024, GPC’s 2015 Ten-Year Site Plan projects a decline in sales to only 10.2 percent of native load, with coal representing approximately 84 percent of system energy. GPC projects a greater percent of energy consumption from coal in 2024 than any other investor-owned utility and all but two other TYSP Utilities, JEA and OUC.

**Table 18: GPC Energy Consumption by Fuel Type**


Fuel Type	Net Energy for Load			
	2014		2024	
	GWh	%	GWh	%
Natural Gas	8,207	68.1%	3,116	24.4%
Coal	7,394	61.4%	10,714	84.0%
Nuclear	0	0.0%	0	0.0%
Oil	1	0.0%	1	0.0%
Renewable	0	0.0%	0	0.0%
Interchange	-3,760	-31.2%	-1,296	-10.2%
NUG & Other	210	1.7%	214	1.7%
<b>Total</b>	<b>12,052</b>		<b>12,749</b>	

Source: 2015 Ten-Year Site Plan and Data Responses

## Reliability Requirements

As previously noted, GPC is the only Ten-Year Site Plan utility outside of the FRCC region. As part of Southern Company’s electric system, GPC plans to maintain a 15 percent seasonal planning reserve margin beginning in 2017. Figure 30 below, displays the forecast planning reserve margin for GPC through the planning period for both seasons, including the impact of energy efficiency programs. As shown in the figure, GPC’s generation needs are typically determined by its summer peak. It is anticipated that GPC would either construct additional generation beyond the units identified above or contract for purchased power to meet its planning reserve requirement in 2024.

**Figure 30: GPC Reserve Margin Forecast**

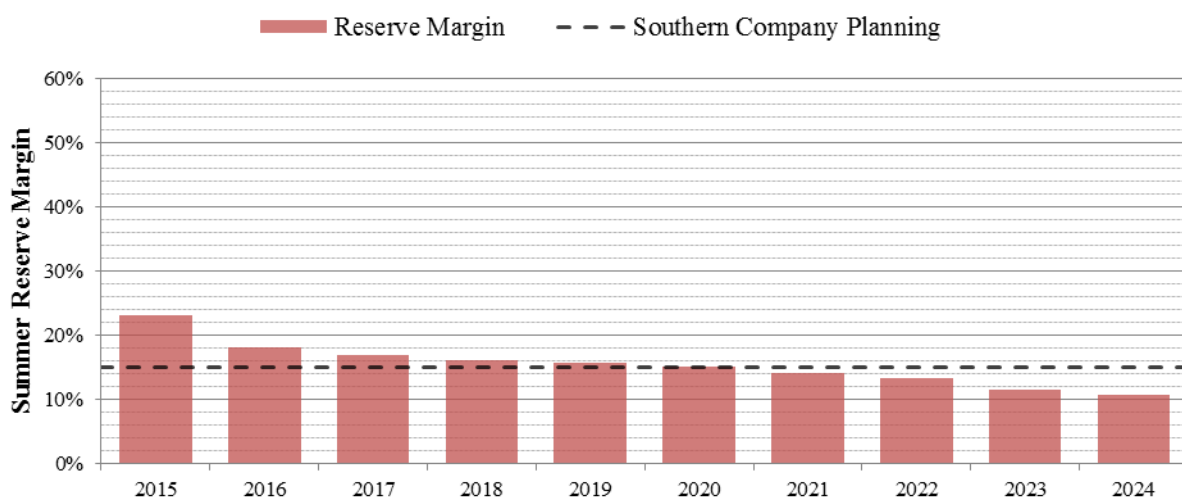

Source: 2015 Ten-Year Site Plan

## Generation Resources

GPC plans multiple unit retirements and additions during the planning period, as described in Table 19 below. A pair of coal-fired steam units and three natural gas-fired combustion turbines would be retired during the planning period. Based on its 2015 Ten-Year Site Plan, GPC plans to add a single natural gas-fired combustion turbine in 2023, after the expiration of a purchased power agreement expires. In addition, GPC plans on the addition of utility-owned renewable generation from a landfill gas-fired internal combustion unit, which would provide firm capacity.

**Table 19: GPC Generation Resource Changes**

<b>Year</b>	<b>Unit Name</b>	<b>Fuel &amp; Unit Type</b>	<b>Net Capacity (Sum MW)</b>	<b>Notes</b>
<b>Retiring Units</b>				
2015	Scholz 1 & 2	Coal Steam	92	
2016	Lansing Smith 2	Coal Steam	195	
2018	Pea Ridge 1 - 3	Natural Gas Combustion Turbine	12	
<b>Retiring Units Total</b>			<b>299</b>	
<b>New Units</b>				
2023	Combustion Turbines	Natural Gas Combustion Turbine	866	
<b>New Units Total</b>			<b>866</b>	
<b>Net Additions</b>			<b>567</b>	

Source: 2015 Ten-Year Site Plan


## Florida Municipal Power Agency (FMPA)

FMPA is a governmental wholesale power company owned by several Florida municipal utilities throughout Florida. Collectively, FMPA is Florida’s eighth largest electric utility and third largest municipal electric utility. While FMPA has 31 member systems, only those members who are participants of the All-Requirements Power Supply Project (ARP) are addressed in the utility’s Ten-Year Site Plan. FMPA is responsible for planning activities associated with ARP member systems. As a municipal utility, the Commission’s regulatory authority is limited to safety, rate structure, territorial boundaries, bulk power supply, operations, and planning. Pursuant to Section 186.801(2), F.S., the Commission finds FMPA’s 2015 Ten-Year Site Plan suitable for planning purposes.

### Load & Energy Forecasts


In 2014, FMPA had approximately 245,664 customers and annual retail energy sales of 5,353 GWh or approximately 2.4 percent of Florida’s annual retail energy sales. Figure 31 below, illustrates the company’s historic and forecast number of customers and retail energy sales, in terms of percentage growth from 2005. Over the last ten years, FMPA’s customer base has decreased by 12.95 percent, while retail sales have decreased by 20.97 percent. As illustrated retail energy sales are not anticipated to exceed the historic 2007 peak during the planning period, and will, in fact, be below 2004 retail energy sale levels by 7.56 percent. The reduction in sales is associated with several ARP member systems modifying their contractual agreements with FMPA, such that FMPA no longer provides for the system’s capacity and energy needs. Those member systems modifying agreements include the City of Vero Beach in 2010, the City of Lake Worth in 2014, and the City of Fort Meade in 2015.

**Figure 31: FMPA Growth Rate**

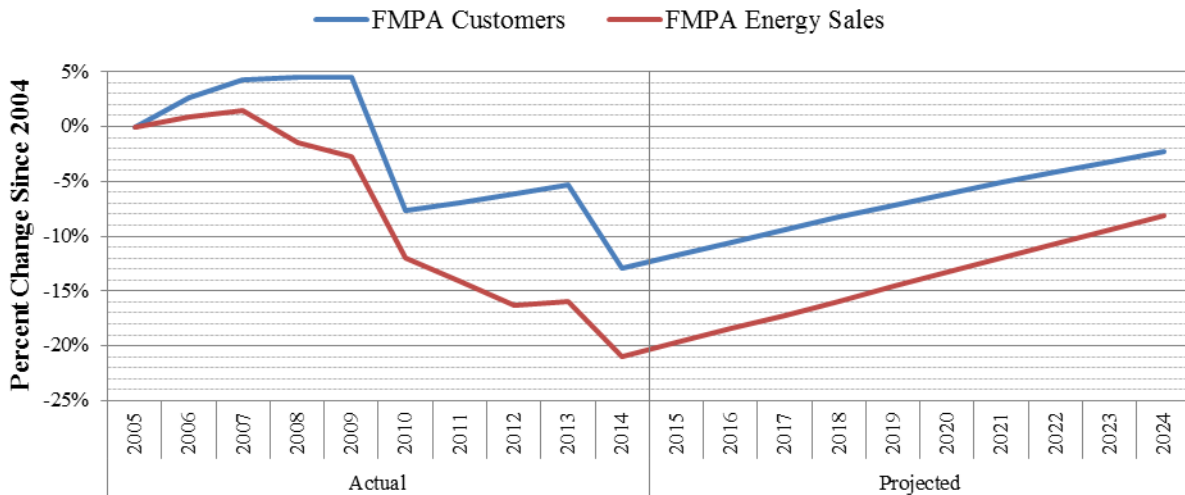

Source: 2015 Ten-Year Site Plan

**Figure 32: FMPA Demand and Energy Forecasts**

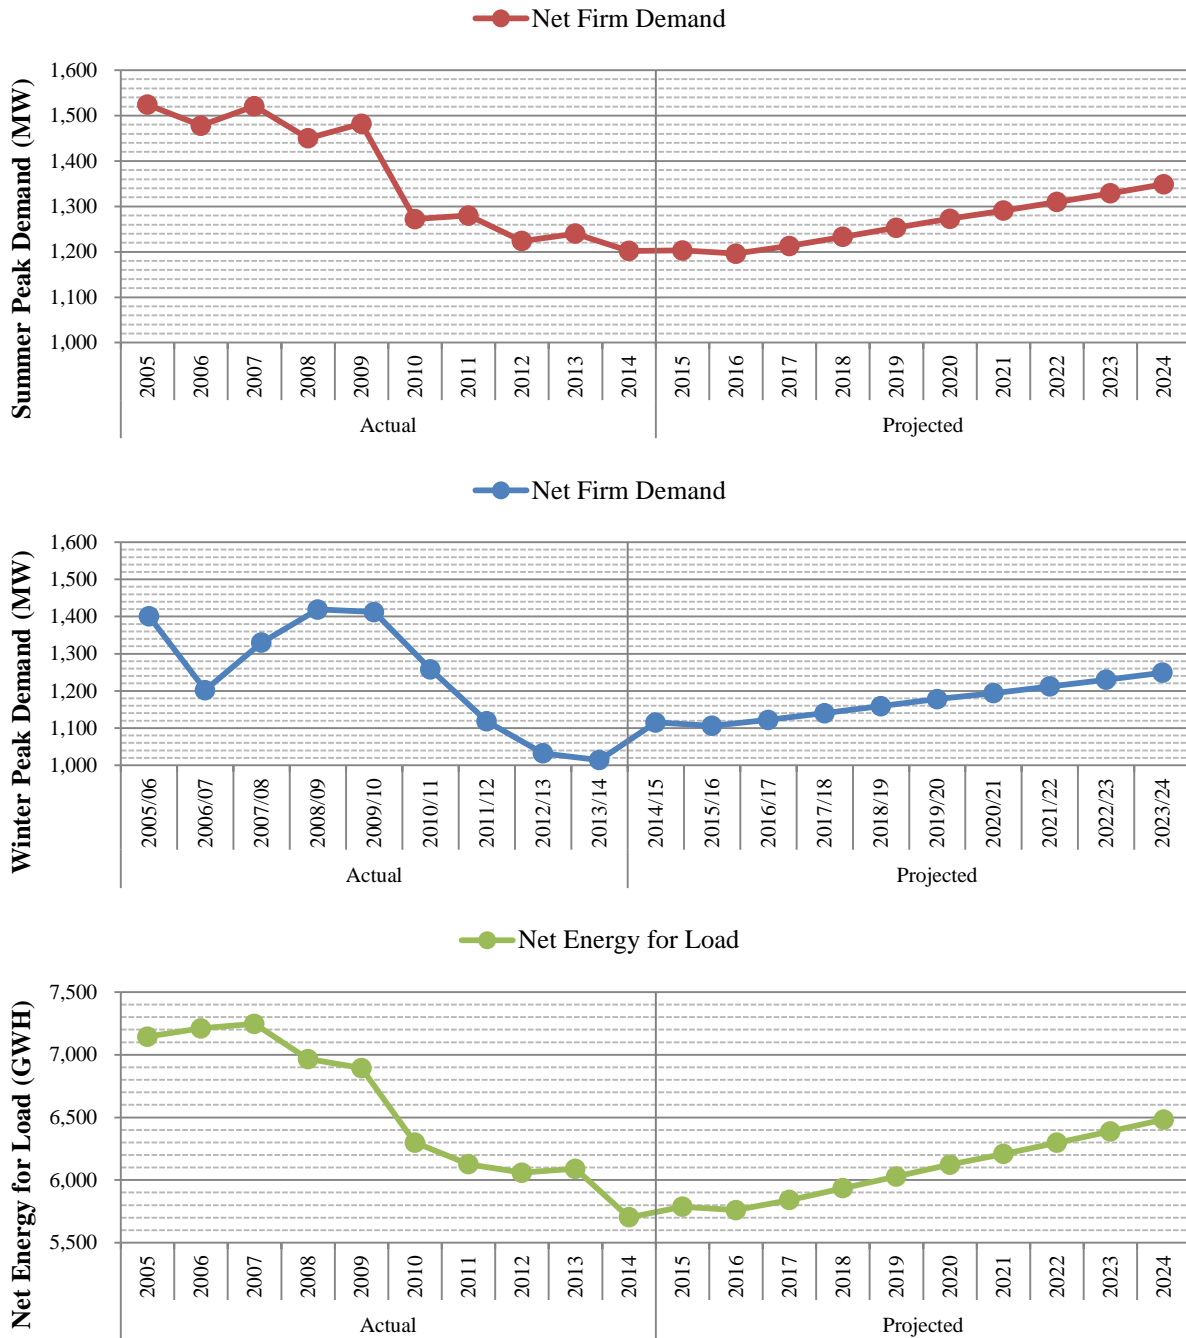

Source: 2015 Ten-Year Site Plan and Data Responses

The three graphs in Figure 32 above, shows FMPA’s seasonal peak demand and net energy for load for the historic years of 2005 through 2014 and forecast years 2015 through 2024. As FMPA is a wholesale power company, it does not directly engage in energy efficiency or demand response programs. ARP member systems do offer demand-side management programs, the impacts of which are included in the graphs above.

## Fuel Diversity

Table 20 below, shows FMPA’s actual net energy for load by fuel type as of 2014 and the projected fuel mix for 2024. FMPA uses natural gas as its primary fuel, supplemented by coal and nuclear generation. FMPA projects an increase in purchased power and energy from coal in 2024, but 85 percent of energy would still be sourced from natural gas and nuclear.

**Table 20: FMPA Energy Consumption by Fuel Type**


Fuel Type	Net Energy for Load			
	2014		2024	
	GWh	%	GWh	%
Natural Gas	4,596	79.3%	5,273	80.0%
Coal	837	14.4%	1,011	15.3%
Nuclear	286	4.9%	286	4.3%
Oil	3	0.1%	0	0.0%
Renewable	32	0.6%	23	0.3%
Interchange	0	0.0%	0	0.0%
NUG & Other	42	0.7%	0	0.0%
<b>Total</b>	<b>5,796</b>		<b>6,593</b>	

Source: 2015 Ten-Year Site Plan and Data Responses

## Reliability Requirements

FMPA utilizes an 18 percent planning reserve margin criterion for summer peak demand, and a 15 percent planning reserve margin criterion for winter peak demand. Figure 33 below, displays the forecast planning reserve margin for FMPA through the planning period for both seasons, with the impact of energy efficiency programs. As shown in the figure, FMPA’s generation needs are controlled by its summer peak throughout the planning period.

**Figure 33: FMPA Reserve Margin Forecast**

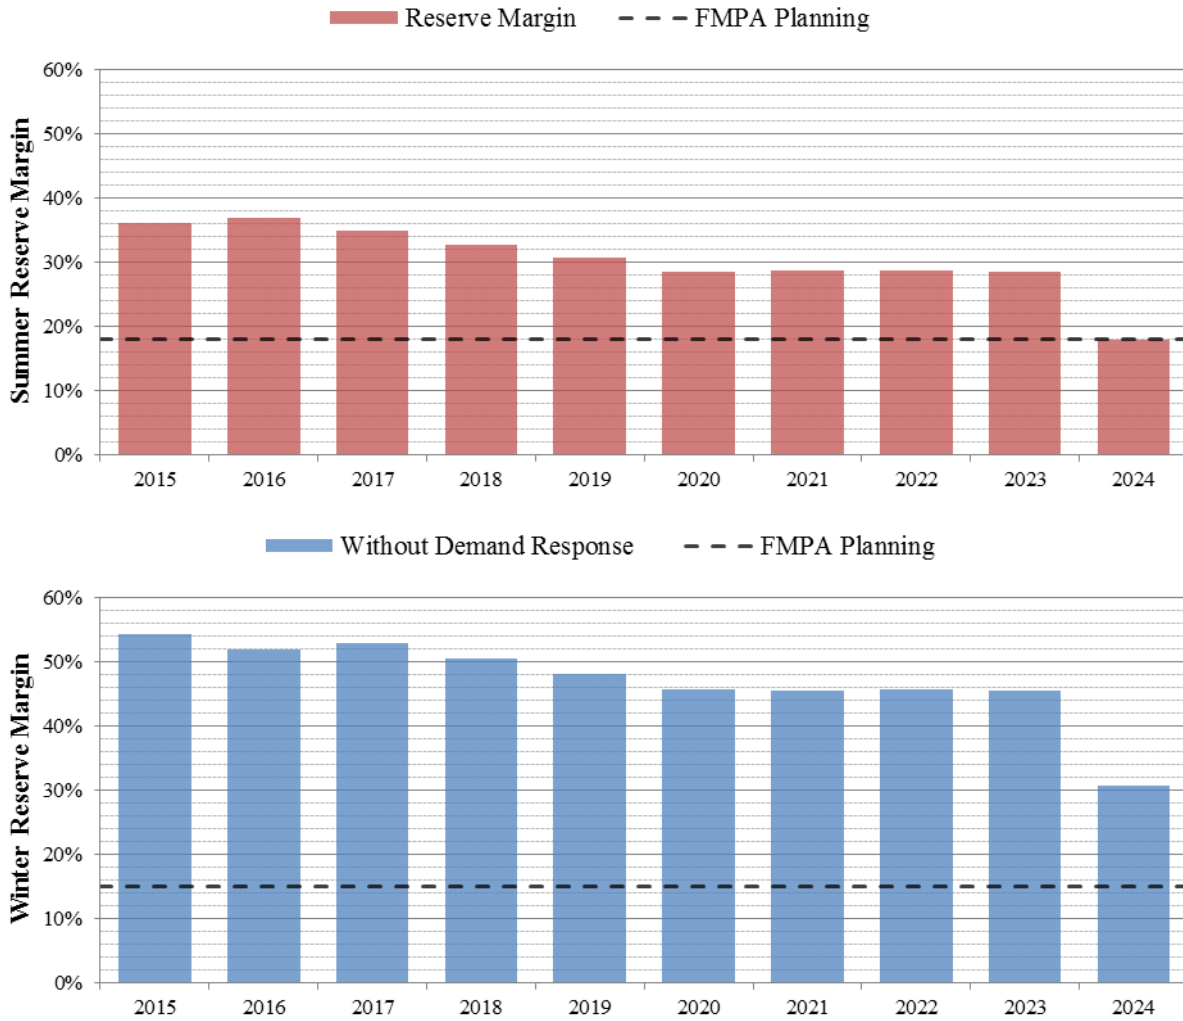

Source: 2015 Ten-Year Site Plan

## Generation Resources

FMPA plans no unit additions or retirements during the planning period. However, as discussed above, several ARP member systems have elected to modify their contractual agreements with FMPA, such that FMPA no longer utilizes the member system’s generation resources.


## Gainesville Regional Utilities (GRU)

GRU is a municipal utility and the smallest electric utility required to file a Ten-Year Site Plan. The utility’s service territory is within the FRCC region and consists of the City of Gainesville and its surrounding area. GRU also provides wholesale power to the City of Alachua and Clay Electric Cooperative. As a municipal utility, the Commission’s regulatory authority is limited to safety, rate structure, territorial boundaries, bulk power supply, operations, and planning. Pursuant to Section 186.801(2), F.S., the Commission finds GRU’s 2015 Ten-Year Site Plan suitable for planning purposes.

### Load & Energy Forecasts

In 2014, GRU had approximately 93,855 customers and annual retail energy sales of 1,709 GWh or approximately 0.8 percent of Florida’s annual retail energy sales. Figure 34 below, illustrates the company’s historic and forecast number of customers and retail energy sales, in terms of percentage growth from 2005. Over the last ten years, GRU’s customer base has increased by 7.19 percent, while retail sales have decreased by 7.81 percent. As illustrated retail energy sales are not anticipated to exceed their historic 2007 peak during the planning period.

**Figure 34: GRU Growth Rate**

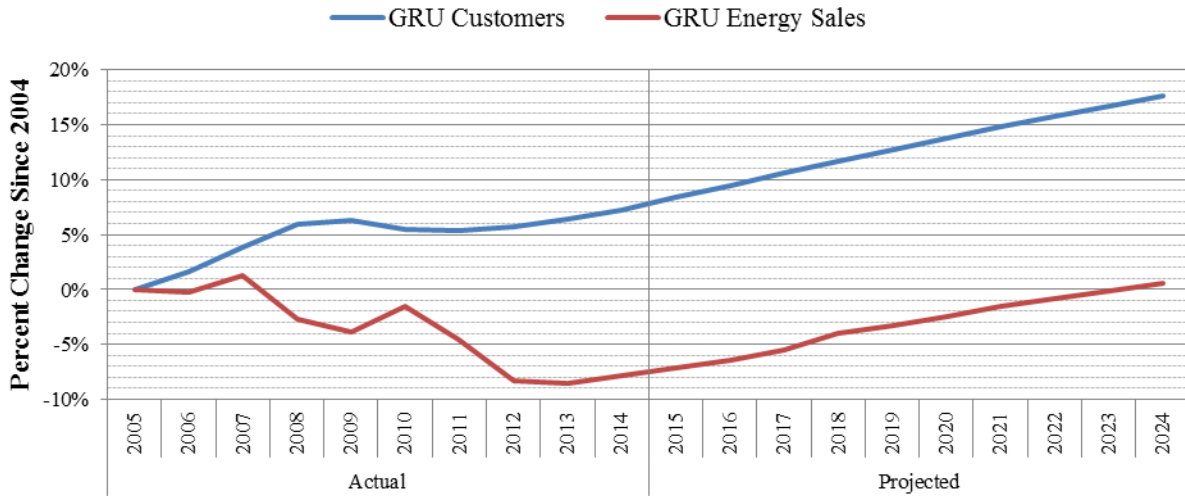


Source: 2015 Ten-Year Site Plan

The three graphs in Figure 35 below, shows GRU’s seasonal peak demand and net energy for load for the historic years of 2005 through 2014 and forecast years 2015 through 2024. GRU engages in multiple energy efficiency programs to reduce customer peak demand and annual energy for load. The graphs in Figure 35 include the impact of these demand-side management programs.



**Figure 35: GRU Demand and Energy Forecasts**

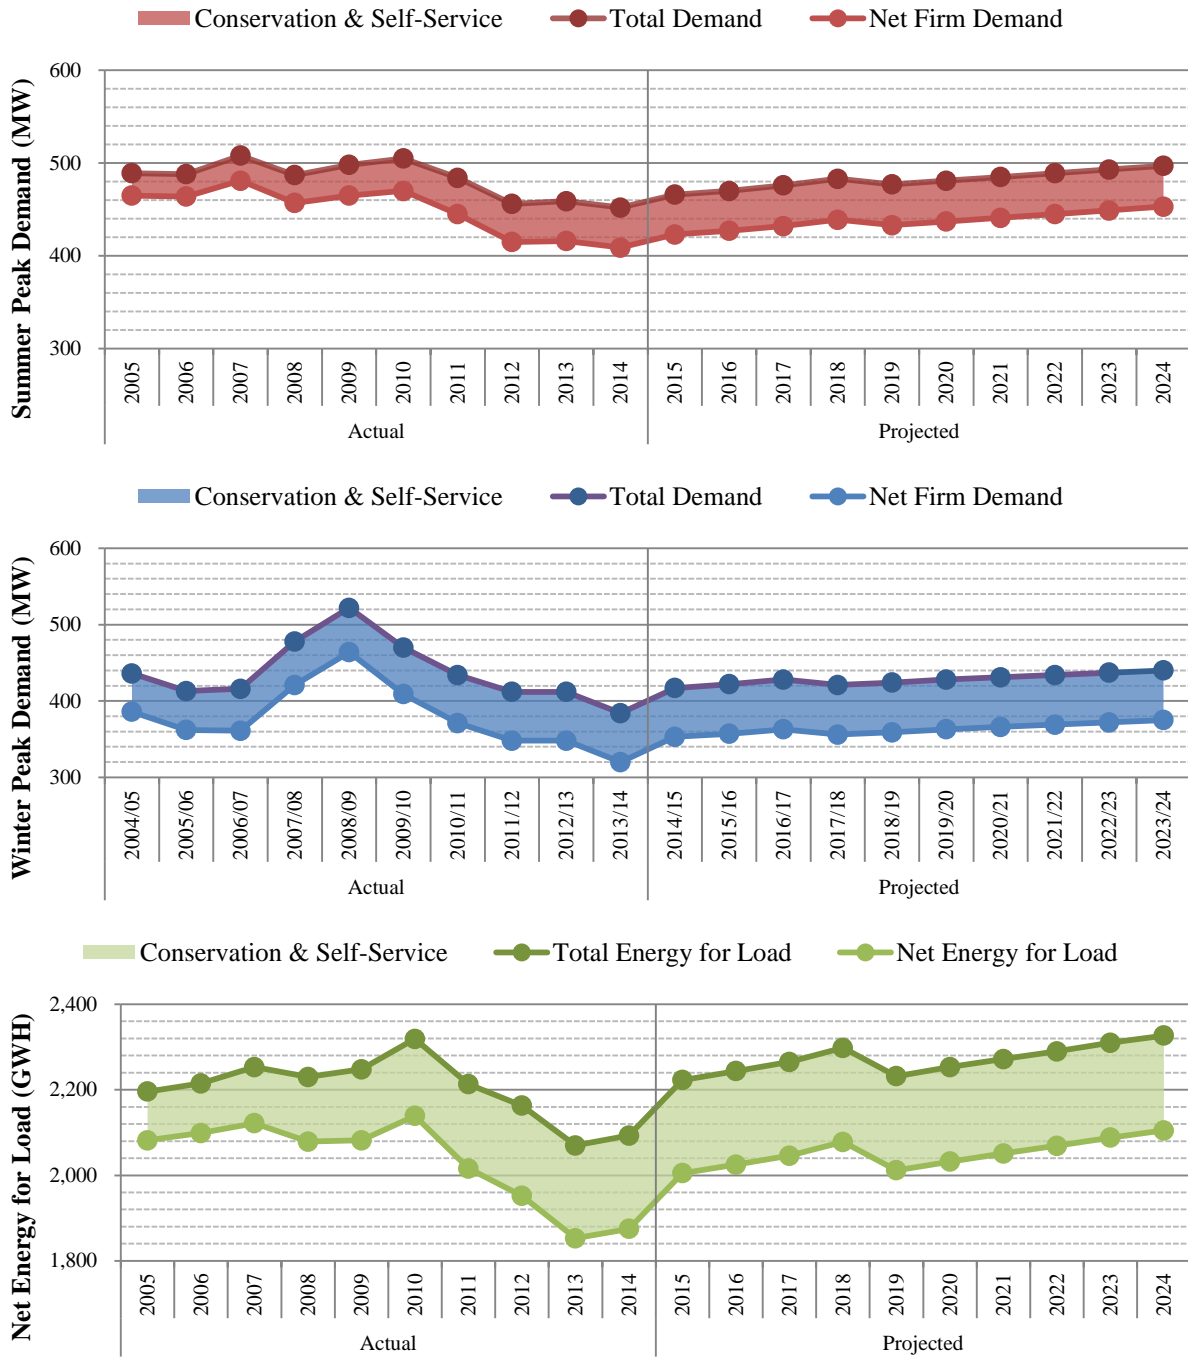

Source: 2015 Ten-Year Site Plan and Data Responses

## Fuel Diversity

Table 21 below, shows GRU’s actual net energy for load by fuel type as of 2014 and the projected fuel mix for 2024. In 2014 coal was approximately two times natural gas in terms of contribution to net energy for load, with the remaining energy split between renewable generation and non-utility generators. By 2024, GRU projects a decline in natural gas and an increase in renewable energy to almost 40 percent of net energy for load. This increase in renewables is primarily associated with the Gainesville Renewable Energy Center, a biomass facility that GRU has a long-term purchased power agreement with for approximately 100 MW of firm capacity and energy.

**Table 21: GRU Energy Consumption by Fuel Type**



Fuel Type	Net Energy for Load			
	2014		2024	
	GWh	%	GWh	%
Natural Gas	315	16.8%	284	13.5%
Coal	820	43.7%	820	39.0%
Nuclear	0	0.0%	0	0.0%
Oil	0	0.0%	0	0.0%
Renewable	635	33.9%	835	39.7%
Interchange	0	0.0%	0	0.0%
NUG & Other	105	5.6%	166	7.9%
<b>Total</b>	<b>1,875</b>		<b>2,105</b>	

Source: 2015 Ten-Year Site Plan and Data Responses

## Reliability Requirements

GRU utilizes a 15 percent planning reserve margin criterion for seasonal peak demand. Figure 36 below, displays the forecast planning reserve margin for GRU through the planning period for both seasons, including the impacts of demand-side management. As shown in the figure, GRU’s generation needs are controlled by its summer peak throughout the planning period. As a smaller utility, the reserve margin is an imperfect measure of reliability due to the relatively large impact a single unit may have on reserve margin. For example, GRU’s largest single unit, Deerhaven 2, a coal-fired steam unit, represents 56.3 percent of summer net firm peak demand in 2014, almost the entirety of the utility’s reserve margin.

**Figure 36: GRU Reserve Margin Forecast**

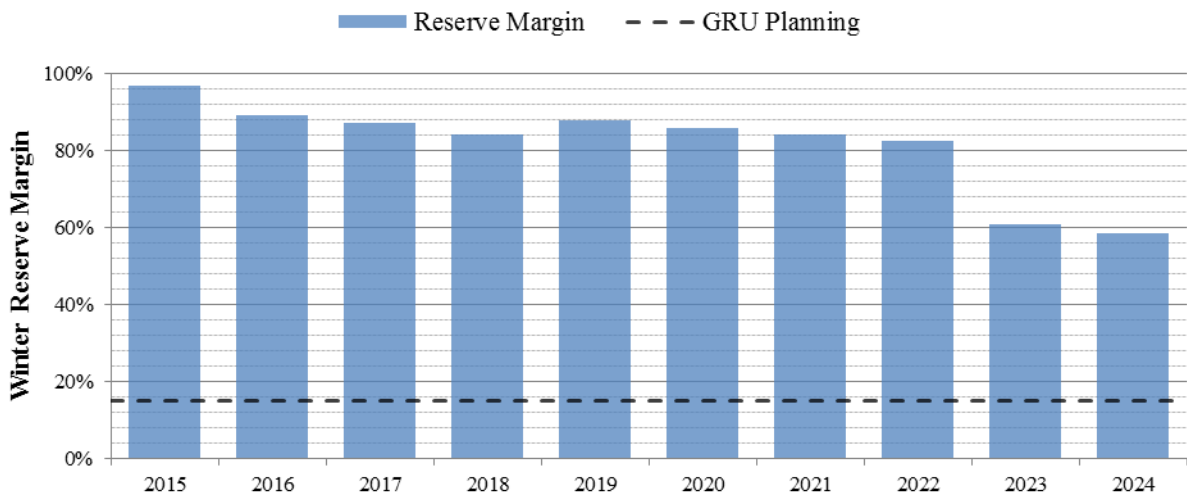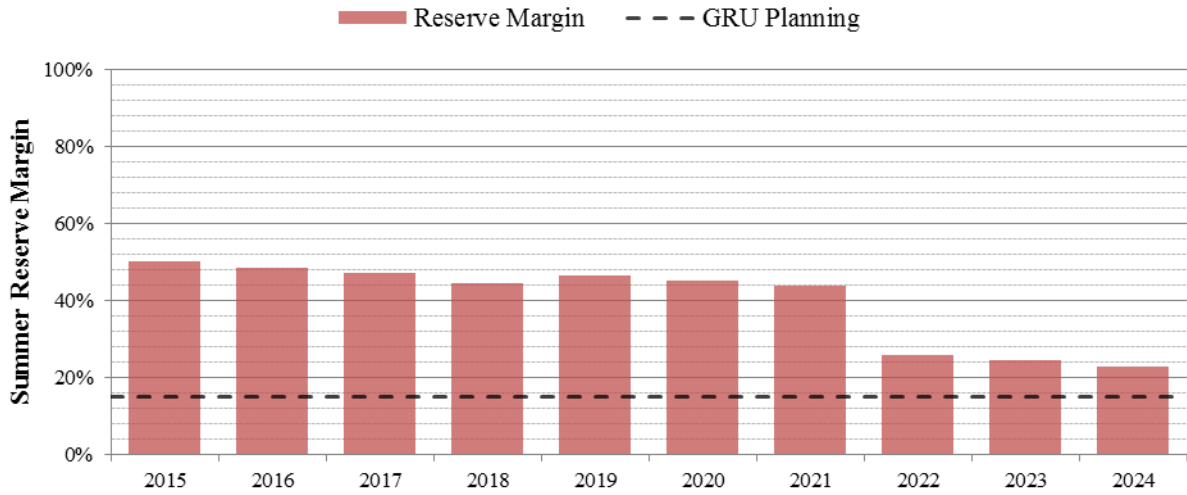

Source: 2015 Ten-Year Site Plan

## Generation Resources

GRU currently plans to retire a natural gas-fired steam unit towards the end of the planning period, as described in Table 22 below. As a smaller utility, single units can have a large impact upon reserve margin, discussed below. GRU does not plan to add additional generating capacity during the planning period.

**Table 22: GRU Generation Resource Changes**

Year	Unit Name	Fuel & Unit Type	Net Capacity (Sum MW)	Notes
<b>Retiring Units</b>				
2022	Deerhaven FS01	Natural Gas Steam	75	
<b>Retiring Units Total</b>			75	
<b>Net Additions</b>			<b>(75)</b>	

Source: 2015 Ten-Year Site Plan


# JEA

JEA, formerly known as Jacksonville Electric Authority, is Florida’s largest municipal utility and fifth largest electric utility. JEA’s service territory is within the FRCC region, and includes all of Duval County as well as portions of Clay and St. Johns Counties. As a municipal utility, the Commission’s regulatory authority is limited to safety, rate structure, territorial boundaries, bulk power supply, operations, and planning. Pursuant to Section 186.801(2), F.S., the Commission finds JEA’s 2015 Ten-Year Site Plan suitable for planning purposes.

## Load & Energy Forecasts

In 2014, JEA had approximately 433,578 customers and annual retail energy sales of 11,713 GWh or approximately 5.3 percent of Florida’s annual retail energy sales. Figure 37 below, illustrates the company’s historic and forecast number of customers and retail energy sales, in terms of percentage growth from 2005. Over the last ten years, JEA’s customer base has increased by 10.85 percent, while retail sales have declined by 6.36 percent. As illustrated JEA exceeded its 2007 peak for retail energy sales in 2010, but does not forecast returning to that level of energy sales during the planning period.


**Figure 37: JEA Growth Rate**

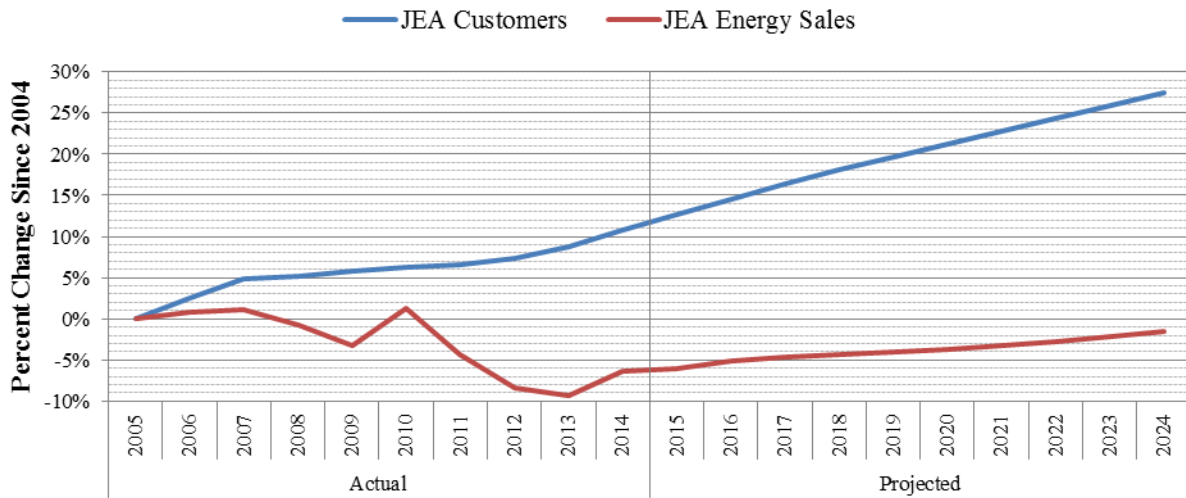

Source: 2015 Ten-Year Site Plan and 2015 FRCC Load & Resource Plan

The three graphs in Figure 38 below, shows JEA’s seasonal peak demand and net energy for load for the historic years of 2005 through 2014 and forecast years 2015 through 2024. These graphs include the full impact of demand-side management, and assume that all available demand response resources were or will be activated during the seasonal peak.

**Figure 38: JEA Demand and Energy Forecasts**

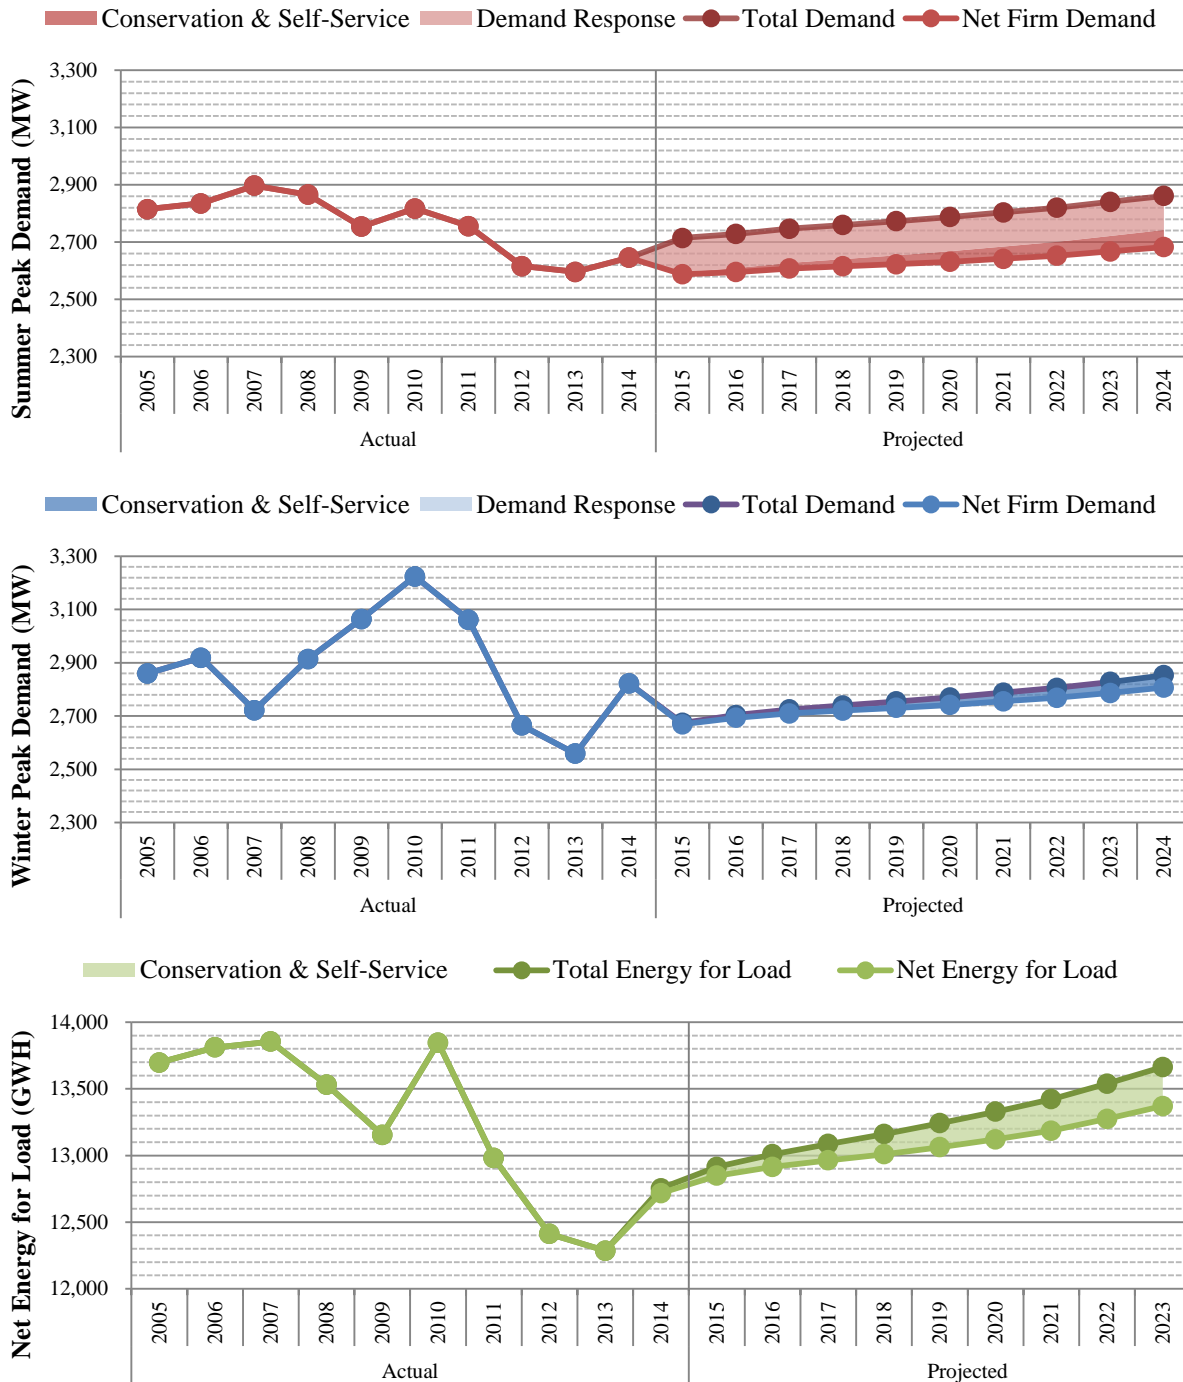

Source: 2015 Ten-Year Site Plan and Data Responses

While a municipal utility, JEA is subject to FEECA and currently offers energy efficiency and demand response programs to customers to reduce peak demand and annual energy consumption. The utility's 2015 Ten-Year Site Plan reflects the recently revised demand-side management goals established by the Commission in December 2014.

## Fuel Diversity

Table 23 below, shows JEA’s actual net energy for load by fuel type as of 2014 and the projected fuel mix for 2024. In 2014, a majority JEA’s net energy for load came from coal and petroleum coke, which is listed in the “NUG & Other” category in Table 23. While the utility plans on eliminating petroleum coke usage over the planning period, JEA projects the highest percent energy consumption from coal in 2024 of the Ten-Year Site Plan utilities.

**Table 23: JEA Energy Consumption by Fuel Type**

Fuel Type	Net Energy for Load			
	2014		2024	
	GWh	%	GWh	%
Natural Gas	3,993	31.5%	1,128	8.4%
Coal	7,012	55.4%	8,301	62.1%
Nuclear	0	0.0%	0	0.0%
Oil	9	0.1%	2	0.0%
Renewable	91	0.7%	72	0.5%
Interchange	477	3.8%	1,610	12.0%
NUG & Other	1,075	8.5%	2,258	16.9%
<b>Total</b>	<b>12,656</b>		<b>13,371</b>	

Source: 2015 Ten-Year Site Plan and Data Responses

## Reliability Requirements

JEA utilizes a 15 percent planning reserve margin criterion for seasonal peak demand. Figure 39 below, displays the forecast planning reserve margin for JEA through the planning period for both seasons, with and without the use of demand response. As shown in the figure, JEA’s generation needs are controlled by its summer peak throughout the planning period.

**Figure 39: JEA Reserve Margin Forecast**



Source: 2015 Ten-Year Site Plan

## Generation Resources

JEA plans to retire one unit during the planning period, as described in Table 24 below. The Northside Unit 3, a natural gas-fired steam unit is planned for retirement in 2016 based on the utility's Ten-Year Site Plan.



**Table 24: JEA Generation Resource Changes**

Year	Unit Name	Fuel & Unit Type	Net Capacity (Sum MW)	Notes
<b>Retiring Units</b>				
2016	Northside 3	Natural Gas Steam	524	Reserve Storage
<b>Retiring Units Total</b>			524	
<b>Net Additions</b>			<b>(524)</b>	

Source: 2015 Ten-Year Site Plan


# Lakeland Electric (LAK)

LAK is a municipal utility and the state’s third smallest electric utility required to file a Ten-Year Site Plan. The utility’s service territory is within the FRCC region and consists of the City of Lakeland and surrounding areas. As a municipal utility, the Commission’s regulatory authority is limited to safety, rate structure, territorial boundaries, bulk power supply, operations, and planning. Pursuant to Section 186.801(2), F.S., the Commission finds LAK’s 2015 Ten-Year Site Plan suitable for planning purposes.

## Load & Energy Forecasts

In 2014, LAK had approximately 124,021 customers and annual retail energy sales of 2,904 GWh or approximately 1.3 percent of Florida’s annual retail energy sales. Figure 40 below, illustrates the company’s historic and forecast number of customers and retail energy sales, in terms of percentage growth from 2005. Over the last 10 years, LAK’s customer base has increased by 5.10 percent, while retail sales have grown by 3.38 percent. As illustrated below, retail energy sales exceed their historic 2007 peak in 2010, and are anticipated to again exceed this value in 2015.




**Figure 40: LAK Growth Rate**

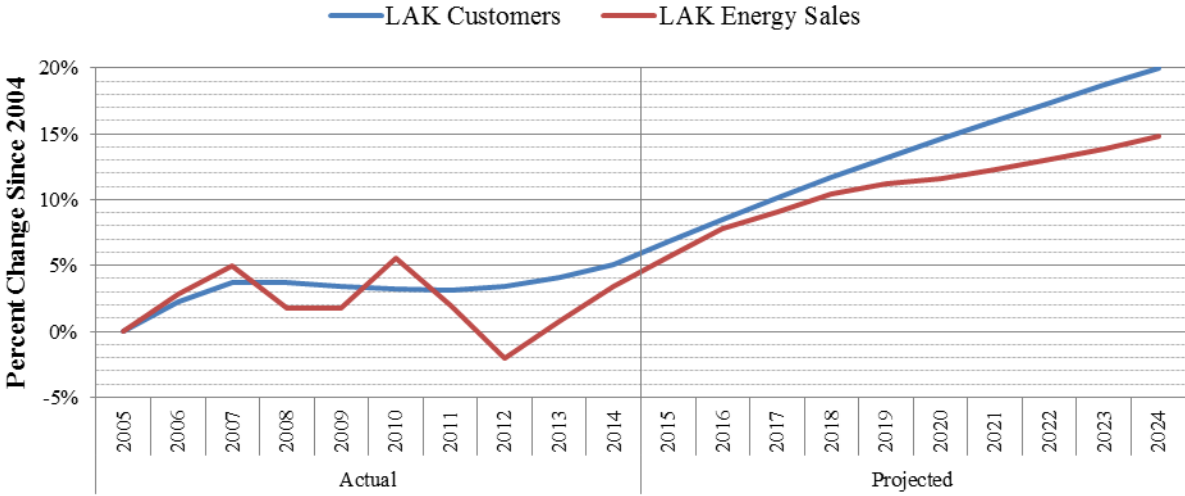

Source: 2015 Ten-Year Site Plan

The three graphs in Figure 41 below, shows LAK’s seasonal peak demand and net energy for load for the historic years of 2005 through 2014 and forecast years 2015 through 2024. LAK offers energy efficiency programs, the impacts of which are included in the graphs below.

**Figure 41: LAK Demand and Energy Forecasts**

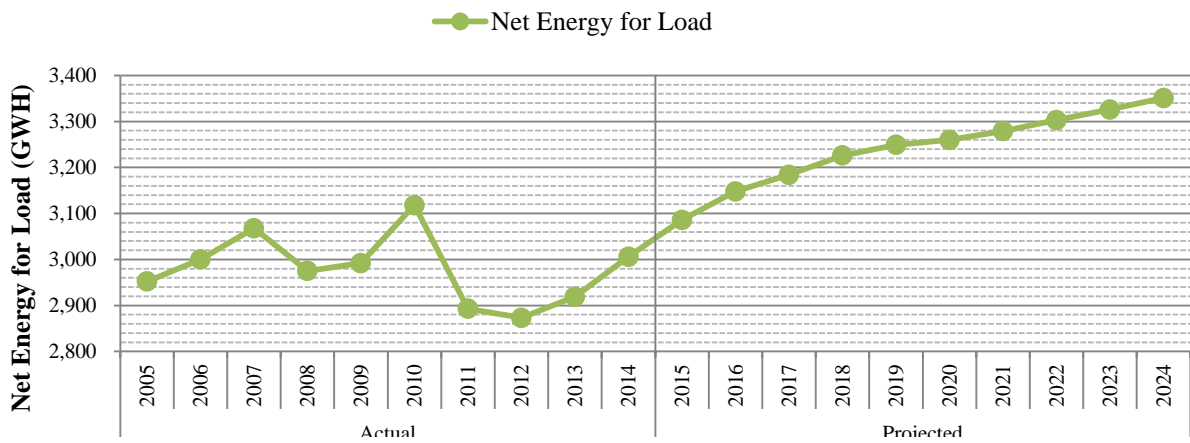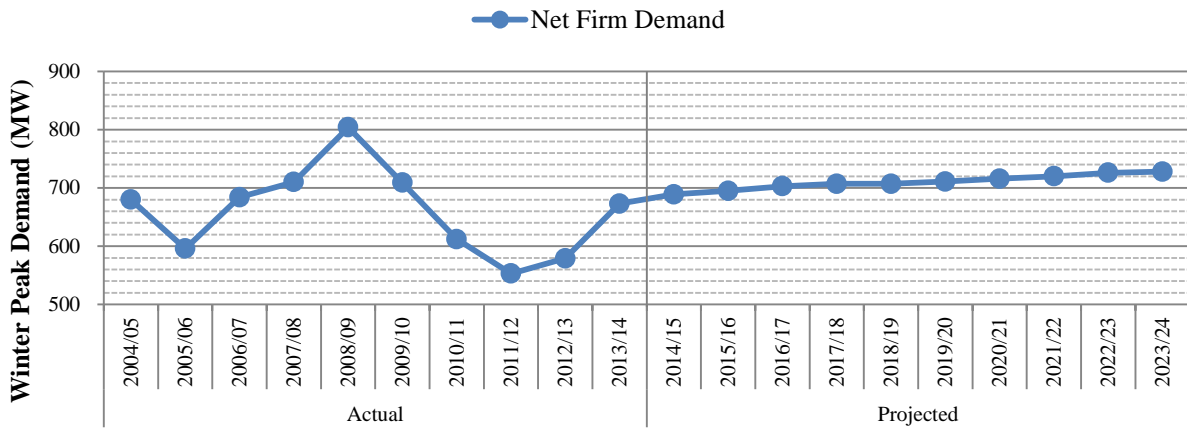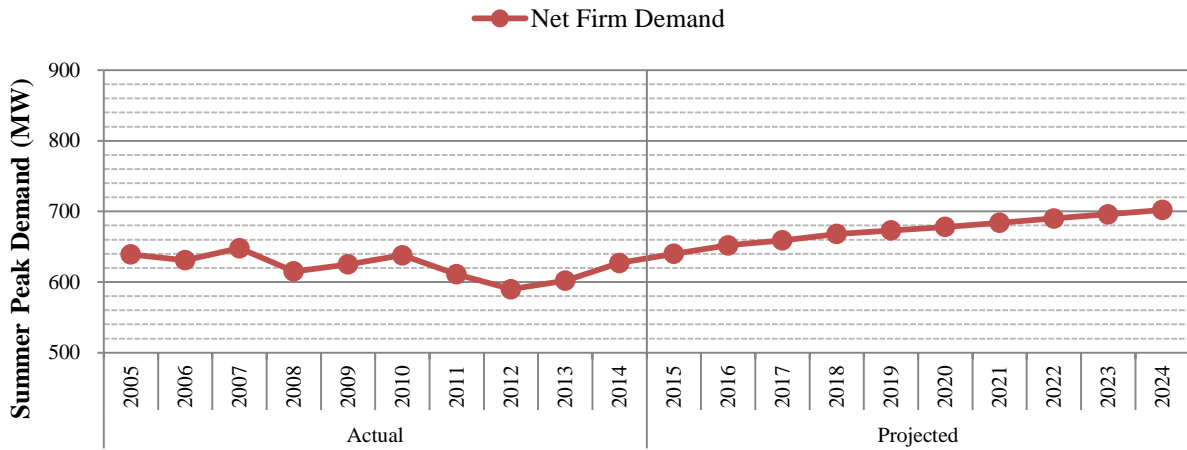

Source: 2015 Ten-Year Site Plan and Data Responses

## Fuel Diversity

Table 25 below, shows LAK’s actual net energy for load by fuel type as of 2014 and the projected fuel mix for 2024. LAK uses natural gas as its primary fuel type for energy, with coal representing about 10 percent net energy for load. While natural gas usage is anticipated to increase somewhat as a percent of net energy for load, coal is projected triple in 2024.

**Table 25: LAK Energy Consumption by Fuel Type**

Fuel Type	Net Energy for Load			
	2014		2024	
	GWh	%	GWh	%
Natural Gas	1,714	57.0%	2,524	75.3%
Coal	278	9.2%	1,131	33.8%
Nuclear	0	0.0%	0	0.0%
Oil	0	0.0%	1	0.0%
Renewable	12	0.4%	37	1.1%
Interchange	0	0.0%	0	0.0%
NUG & Other	1,002	33.3%	-342	-10.2%
<b>Total</b>	<b>3,006</b>		<b>3,351</b>	

Source: 2015 Ten-Year Site Plan and Data Responses

## Reliability Requirements

LAK utilizes a 15 percent planning reserve margin criterion for seasonal peak demand. Figure 42 below, displays the forecast planning reserve margin for LAK through the planning period for both seasons, including the impacts of demand-side management. As a smaller utility, the reserve margin is an imperfect measure of reliability due to the relatively large impact a single unit may have on reserve margin. For example, LAK’s largest single unit, McIntosh 5, a natural gas-fired combined cycle unit, represents 51.4 percent of winter net firm peak demand in 2014, in excess of the utility’s reserve margin.

**Figure 42: LAK Reserve Margin Forecast**



Source: 2015 Ten-Year Site Plan

## Generation Resources

LAK plans no unit additions or retirements during the planning period.


## Orlando Utilities Commission (OUC)

OUC is a municipal utility and Florida’s seventh largest electric utility and second largest municipal utility. The utility’s service territory is within the FRCC region and primarily consists of the Orlando metropolitan area. As a municipal utility, the Commission’s regulatory authority is limited to safety, rate structure, territorial boundaries, bulk power supply, operations, and planning. Pursuant to Section 186.801(2), F.S., the Commission finds OUC’s 2015 Ten-Year Site Plan suitable for planning purposes.

### Load & Energy Forecasts

In 2014, OUC had approximately 219,272 customers and annual retail energy sales of 6,191 GWh or approximately 2.8 percent of Florida’s annual retail energy sales. Figure 43 below, illustrates the company’s historic and forecast number of customers and retail energy sales, in terms of percentage growth from 2005. Over the last 10 years, OUC’s customer base has increased by 14.94 percent, while retail sales have grown by 5.79 percent. As illustrated retail energy sales are anticipated to exceed their historic 2008 peak in 2015.


**Figure 43: OUC Growth Rate**

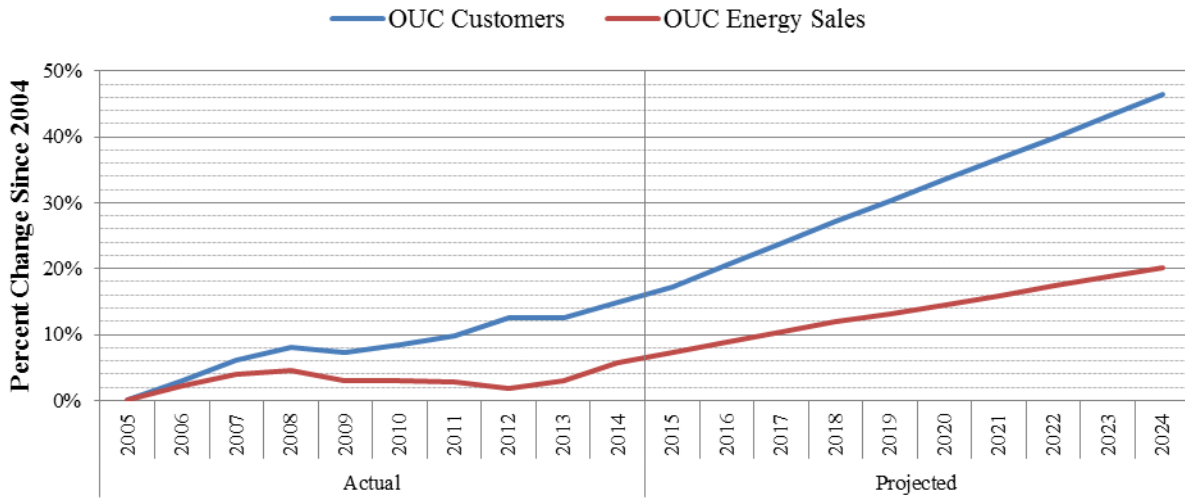

Source: 2015 Ten-Year Site Plan

The three graphs in Figure 44 below, shows OUC’s seasonal peak demand and net energy for load for the historic years of 2005 through 2014 and forecast years 2015 through 2024. These graphs include the impact of the utility’s demand side management programs. While a municipal utility, OUC is subject to FEECA and currently offers energy efficiency and demand response programs to customers to reduce peak demand and annual energy consumption.

**Figure 44: OUC Demand and Energy Forecasts**

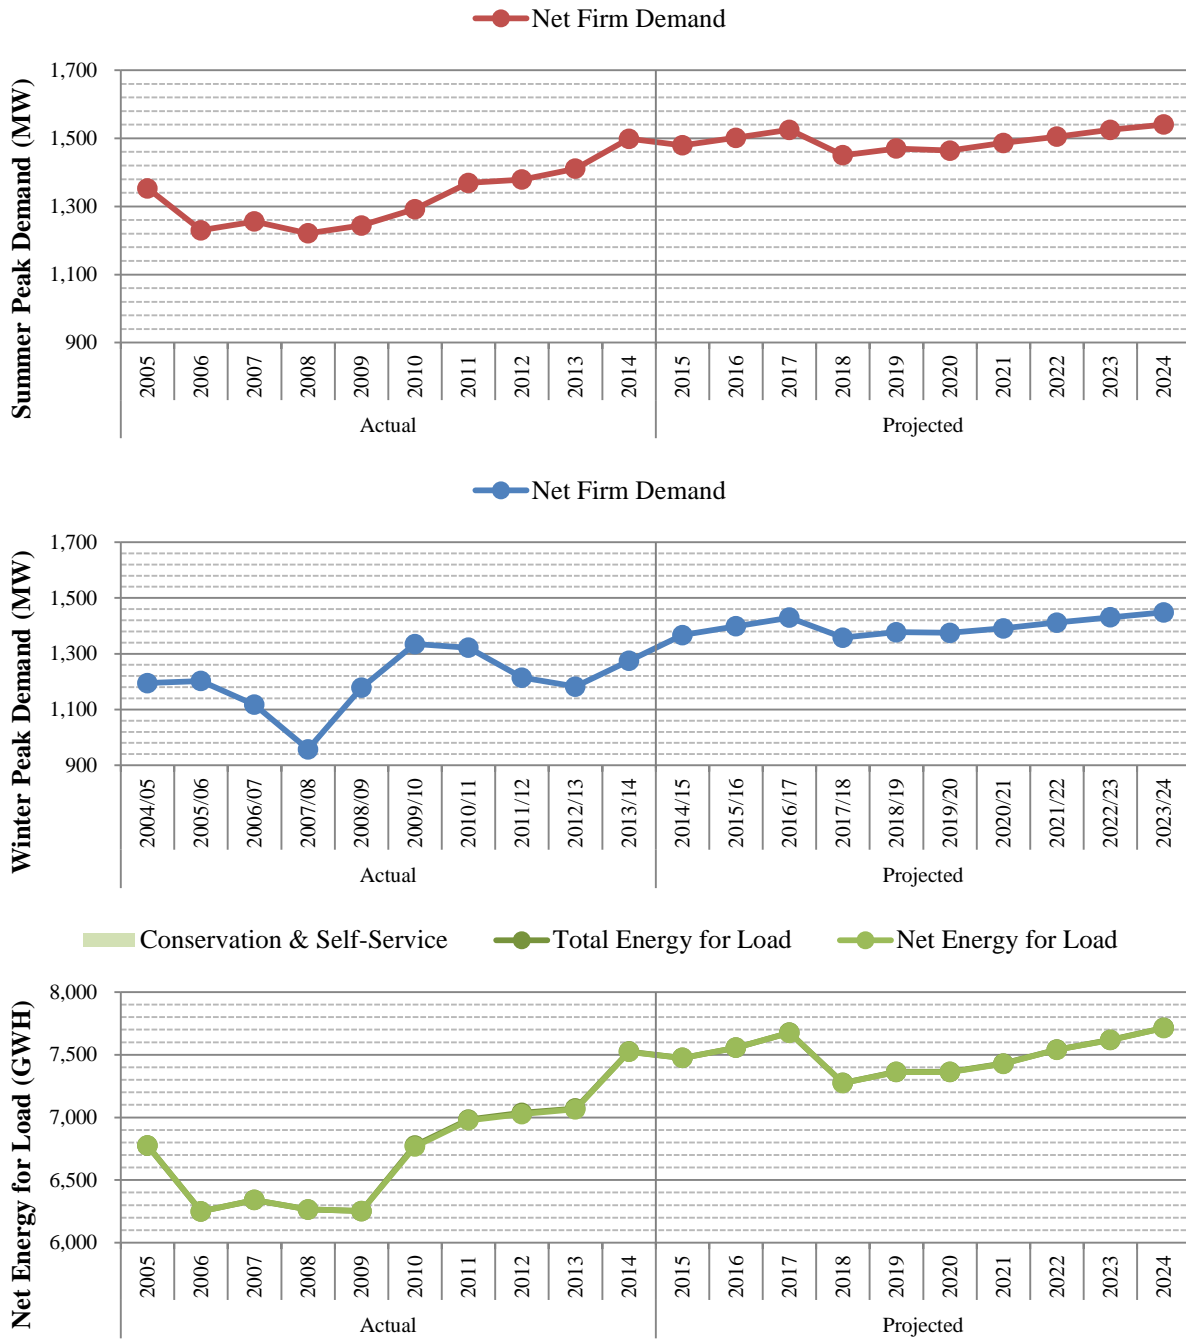

Source: 2015 Ten-Year Site Plan and Data Responses

## Fuel Diversity

Table 26 below, shows OUC’s actual net energy for load by fuel type as of 2014 and the projected fuel mix for 2024. In 2014, OUC used approximately equal portions of natural gas and coal as fuel to meet the utility’s net energy for load. However, OUC projects to significantly increase the quantity of energy consumed from coal, while decreasing natural gas usage by 2024. Based upon this projection, OUC as a percent of net energy for load would be the second largest user of coal in Florida by 2024.

**Table 26: OUC Energy Consumption by Fuel Type**

Fuel Type	Net Energy for Load			
	2014		2024	
	GWh	%	GWh	%
Natural Gas	3,405	45.3%	443	5.7%
Coal	3,534	47.0%	6,644	86.1%
Nuclear	472	6.3%	459	6.0%
Oil	1	0.0%	0	0.0%
Renewable	109	1.4%	168	2.2%
Interchange	0	0.0%	0	0.0%
NUG & Other	0	0.0%	0	0.0%
<b>Total</b>	<b>7,521</b>		<b>7,714</b>	



Source: 2015 Ten-Year Site Plan and Data Responses

## Reliability Requirements

OUC utilizes a 15 percent planning reserve margin criterion for seasonal peak demand. Figure 45 below, displays the forecast planning reserve margin for OUC through the planning period for both seasons, including the impact of demand-side management programs. As shown in the figure, OUC’s generation needs are controlled by its summer peak demand throughout the planning period.



**Figure 45: OUC Reserve Margin Forecast**

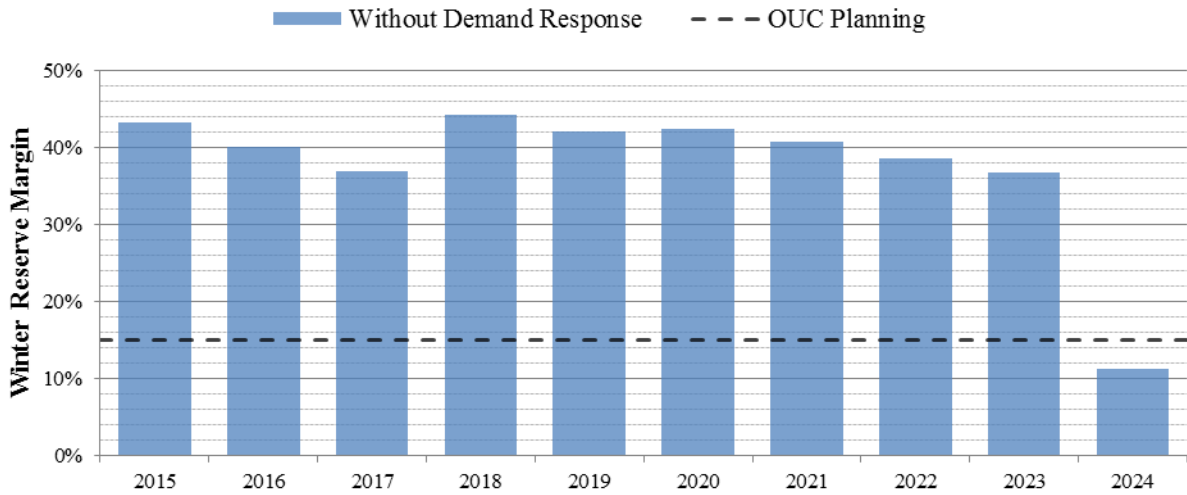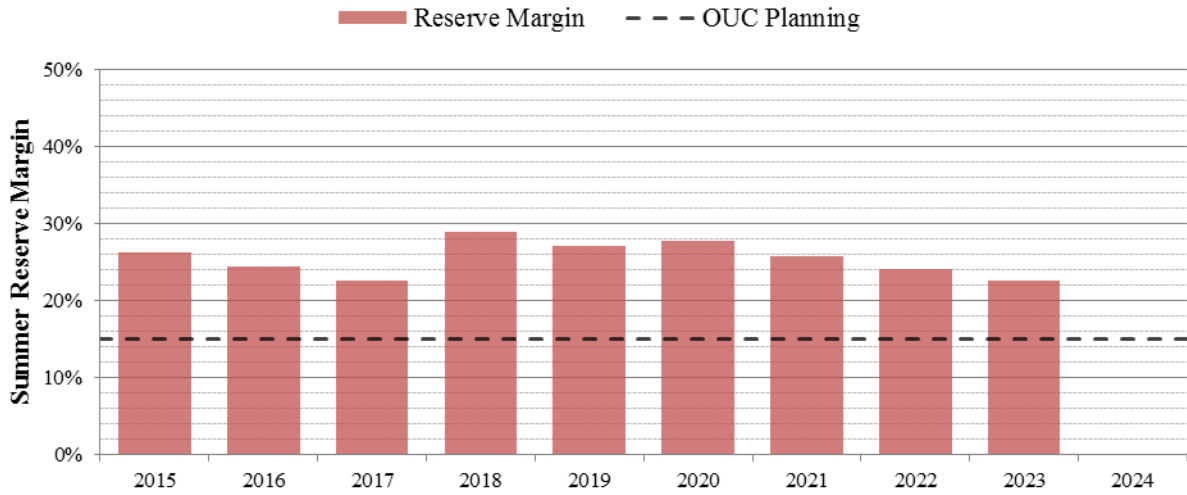

Source: 2015 Ten-Year Site Plan

## Generation Resources

Based upon current planning OUC is adding a combined cycle in 2023 using natural gas. The unit as shown, in Table 27 below, will be a 285 MW Natural Gas Unit and will require a determination of need from FPSC.

---

**Table 27: OUC Generation Resource Changes**

<b>Year</b>	<b>Unit Name</b>	<b>Fuel &amp; Unit Type</b>	<b>Net Capacity (Sum MW)</b>	<b>Notes</b>
<b>New Units</b>				
2023	Unknown	Natural Gas Combined Cycle	285	Requires PPSA
<b>New Units Total</b>			<b>285</b>	
<b>Net Additions</b>			<b>285</b>	

Source: 2015 Ten-Year Site Plan

---


## Seminole Electric Cooperative (SEC)

SEC is a generation and transmission rural electric cooperative that serves its member cooperatives, and is collectively Florida’s fourth largest utility. SEC’s generation and member cooperatives are within the FRCC region, with member cooperatives located in central and north Florida. As a rural electric cooperative, the Commission’s regulatory authority is limited to safety, rate structure, territorial boundaries, bulk power supply, operations, and planning. Pursuant to Section 186.801(2), F.S., the Commission finds SEC’s 2015 Ten-Year Site Plan suitable for planning purposes.

### Load & Energy Forecasts


In 2014, SEC had approximately 740,566 customers and annual retail energy sales of 12,960 GWh or approximately 6.7 percent of Florida’s annual retail energy sales. Figure 46 below, illustrates the company’s historic and forecast number of customers and retail energy sales, in terms of percentage growth from 2005. Over the last 10 years, SEC’s customer base has decreased by 10.5 percent, while retail sales have decreased 5.39 percent. As illustrated retail energy sales are anticipated to exceed their historic 2007 peak by 2022, approximately five years later than Florida as a whole. The decline shown in 2014 is associated with one member cooperative, Lee County Electric Cooperative, electing to end its membership with SEC.

**Figure 46: SEC Growth Rate**

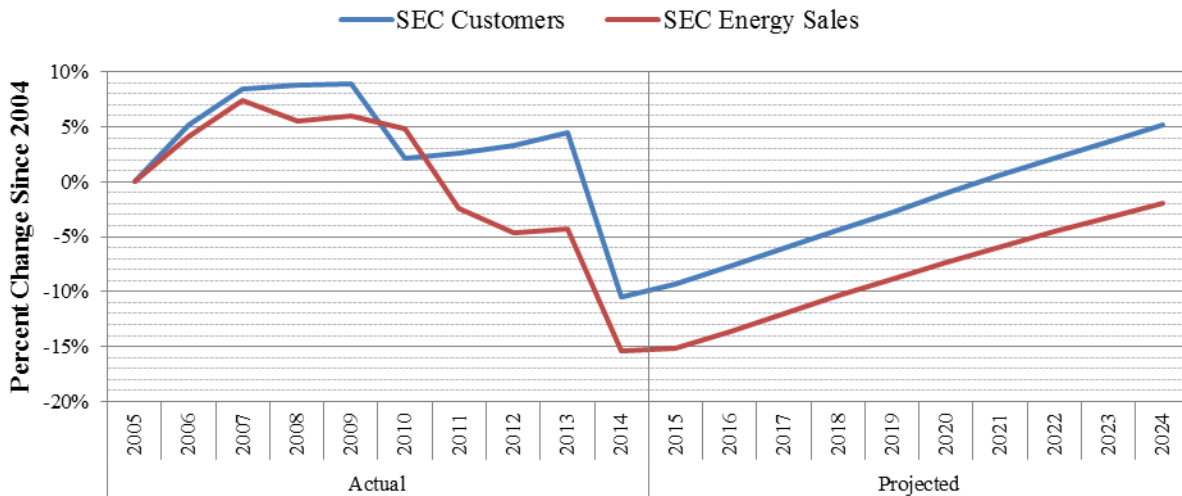

Source: 2015 Ten-Year Site Plan

**Figure 47: SEC Demand and Energy Forecasts**

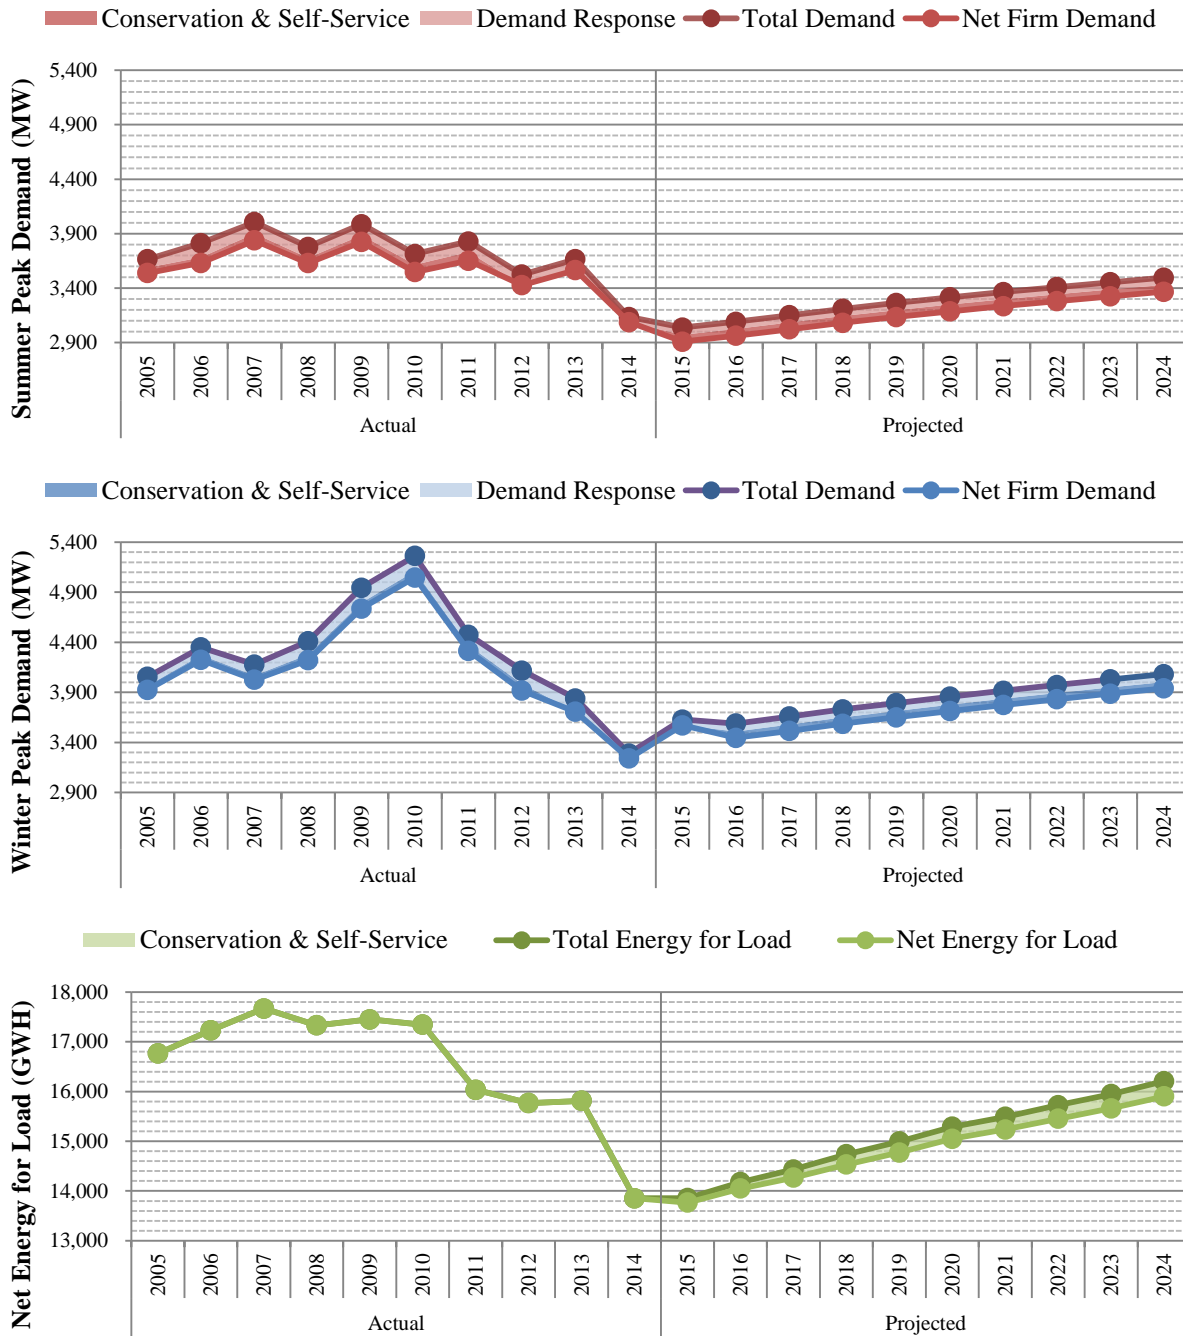

Source: 2015 Ten-Year Site Plan and Data Responses

The three graphs in Figure 47 above, shows SEC’s seasonal peak demand and net energy for load for the historic years of 2005 through 2014 and forecast years 2015 through 2024. As SEC is a generation and transmission company, it does not directly engage in energy efficiency or demand response programs. Member cooperatives do offer demand-side management programs, the impacts of which are included in the graphs below.

## Fuel Diversity

Table 28 below, shows SEC’s actual net energy for load by fuel type as of 2014 and the projected fuel mix for 2024. In 2014, SEC uses a combination of coal and natural gas to meet its member cooperatives’ net energy for load, with coal use slightly higher than natural gas. By 2024, SEC projects this to reverse, with natural gas usage somewhat higher than coal.

**Table 28: SEC Energy Consumption by Fuel Type**


Fuel Type	Net Energy for Load			
	2014		2024	
	GWh	%	GWh	%
Natural Gas	4,737	34.2%	7,504	47.2%
Coal	8,159	58.9%	7,571	47.6%
Nuclear	0	0.0%	0	0.0%
Oil	35	0.3%	48	0.3%
Renewable	923	6.7%	780	4.9%
Interchange	0	0.0%	0	0.0%
NUG & Other	0	0.0%	0	0.0%
<b>Total</b>	<b>13,854</b>		<b>15,903</b>	

Source: 2015 Ten-Year Site Plan and Data Responses

## Reliability Requirements

SEC utilizes a 15 percent planning reserve margin criterion for seasonal peak demand. Figure 48 below, displays the forecast planning reserve margin for SEC through the planning period for both seasons, with and without the use of demand response. Member cooperatives allow SEC to coordinate demand response resources to maintain reliability. As shown in the figure, SEC’s generation needs are determined by winter peak demand more often than summer peak demand during the planning period.

**Figure 48: SEC Reserve Margin Forecast**

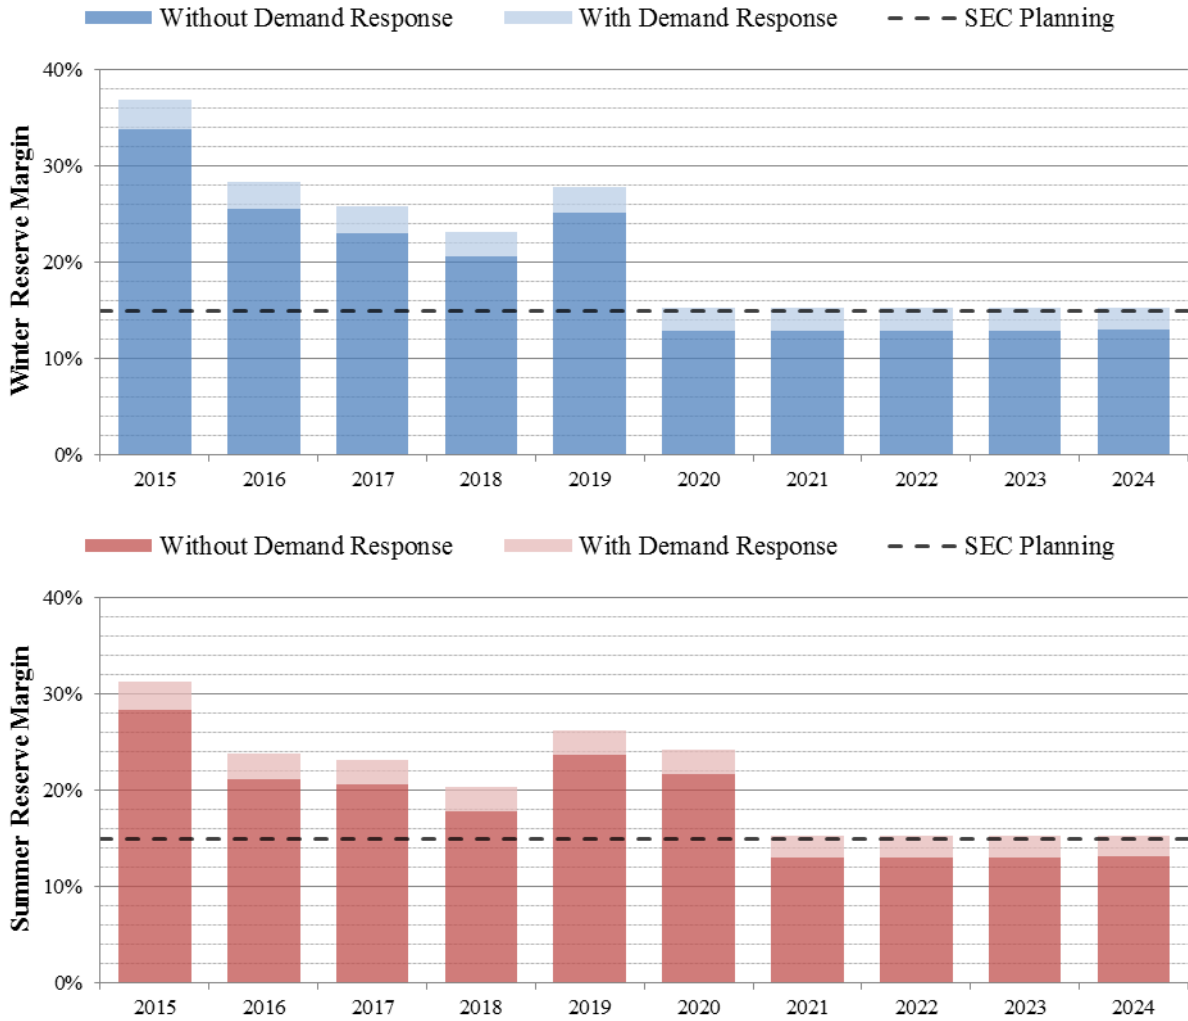

Source: 2015 Ten-Year Site Plan

## Generation Resources

SEC plans the addition of several generating units during the planning period, as described in Table 29 below. All unsited natural gas-fired units, SEC plans the addition of a total of seven combustion turbines and a single combined cycle unit over the planning period.

---

**Table 29: SEC Generation Resource Changes**

<b>Year</b>	<b>Unit Name</b>	<b>Fuel &amp; Unit Type</b>	<b>Net Capacity (Sum MW)</b>	<b>Notes</b>
<b>New Units</b>				
2021	Unnamed CC	Natural Gas Combined Cycle	649	Requires PPSA
2022	Unnamed CT 1	Natural Gas Combustion Turbine	201	
2023	Unnamed CT 2	Natural Gas Combustion Turbine	201	
2024	Unnamed CT 3	Natural Gas Combustion Turbine	201	
<b>New Units Total</b>			<b>1,252</b>	
<b>Net Additions</b>			<b>1,252</b>	

Source: 2015 Ten-Year Site Plan

---


## City of Tallahassee Utilities (TAL)

TAL is a municipal utility and the second smallest electric utility and municipal electric utility. The utility’s service territory is within the FRCC region and primarily consists of the City of Tallahassee and surrounding areas. As a municipal utility, the Commission’s regulatory authority is limited to safety, rate structure, territorial boundaries, bulk power supply, operations, and planning. Pursuant to Section 186.801(2), F.S., the Commission finds TAL’s 2015 Ten-Year Site Plan suitable for planning purposes.

### Load & Energy Forecasts

In 2014, TAL had approximately 116,708 customers and annual retail energy sales of 2,638 GWh or approximately 1.2 percent of Florida’s annual retail energy sales. Figure 49 below, illustrates the company’s historic and forecast number of customers and retail energy sales, in terms of percentage growth from 2005. Over the last 10 years, TAL’s customer base has increased by 8.28 percent, while retail sales have declined by 3.16 percent. As illustrated retail energy sales are not anticipated to exceed their historic 2007 peak until 2023, six years later than the state as a whole.

**Figure 49: TAL Growth Rate**

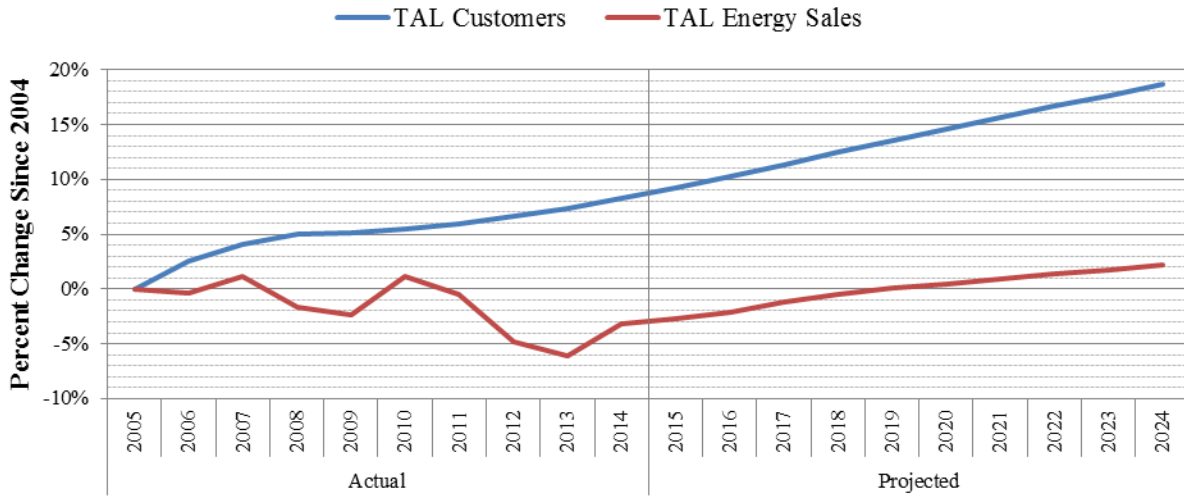


Source: 2015 Ten-Year Site Plan

The three graphs in Figure 50 below, shows TAL’s seasonal peak demand and net energy for load for the historic years of 2005 through 2014 and forecast years 2015 through 2024. These graphs include the impact of demand-side management, and for future years assume that all available demand response resources will be activated during the seasonal peak. TAL offers energy efficiency and demand response programs to customers to reduce peak demand and annual energy consumption. Currently TAL only offers demand response programs targeting appliances that contribute to summer peak, and therefore have no effect upon winter peak.



**Figure 50: TAL Demand and Energy Forecasts**

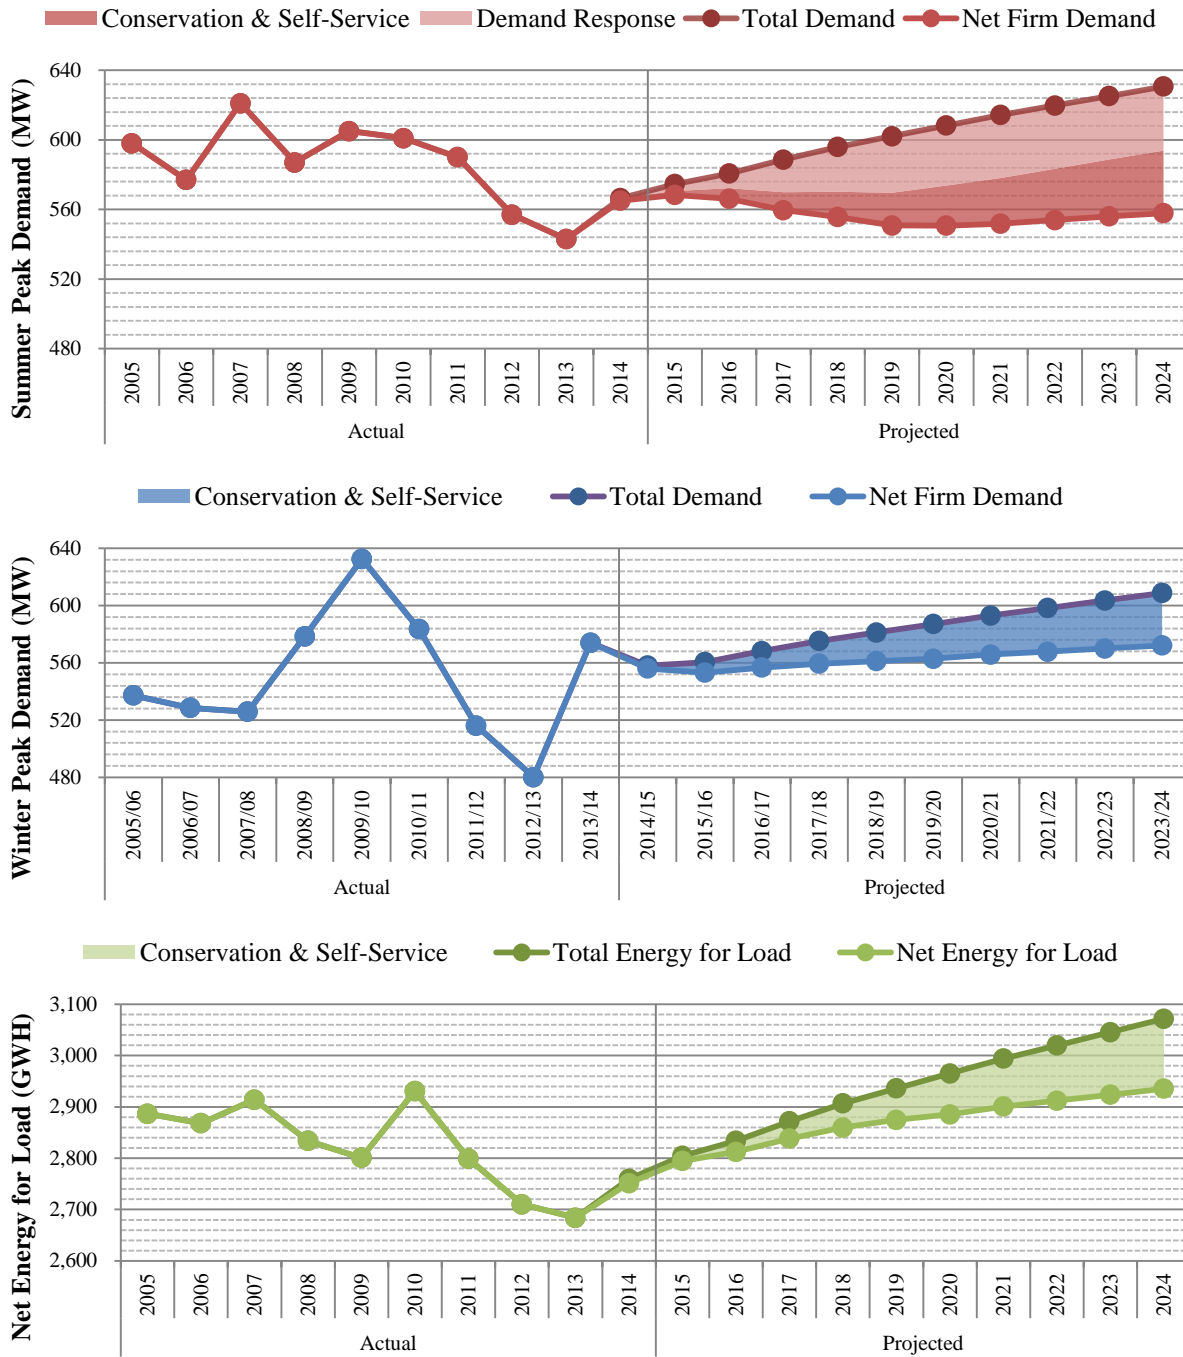

Source: 2015 Ten-Year Site Plan and Data Responses

## Fuel Diversity

Table 30 below, shows TAL’s actual net energy for load by fuel type as of 2013 and the projected fuel mix for 2023. TAL relies almost exclusively on natural gas for its generation, excluding some purchases from other utilities and qualifying facilities and the use of oil as a backup fuel. Natural gas is anticipated to remain the sole fuel on the system, with only natural gas-fired generation to be added.

**Table 30: TAL Energy Consumption by Fuel Type**



Fuel Type	Net Energy for Load			
	2014		2024	
	GWh	%	GWh	%
Natural Gas	2,788	101.3%	2,917	99.4%
Coal	0	0.0%	0	0.0%
Nuclear	0	0.0%	0	0.0%
Oil	0	0.0%	0	0.0%
Renewable	20	0.7%	14	0.5%
Interchange	0	0.0%	29	1.0%
NUG & Other	-56	-2.0%	-24	-0.8%
<b>Total</b>	<b>2,751</b>		<b>2,935</b>	

Source: 2015 Ten-Year Site Plan and Data Responses

## Reliability Requirements

TAL utilizes a 17 percent planning reserve margin criterion for seasonal peak demand. Figure 51 below, displays the forecast planning reserve margin for TAL through the planning period for both seasons, with and without the use of demand response. As discussed above, TAL only offers demand response programs applicable to the summer peak. As shown in the figure, TAL’s generation needs are controlled by its summer peak throughout the planning period.

**Figure 51: TAL Reserve Margin Forecast**

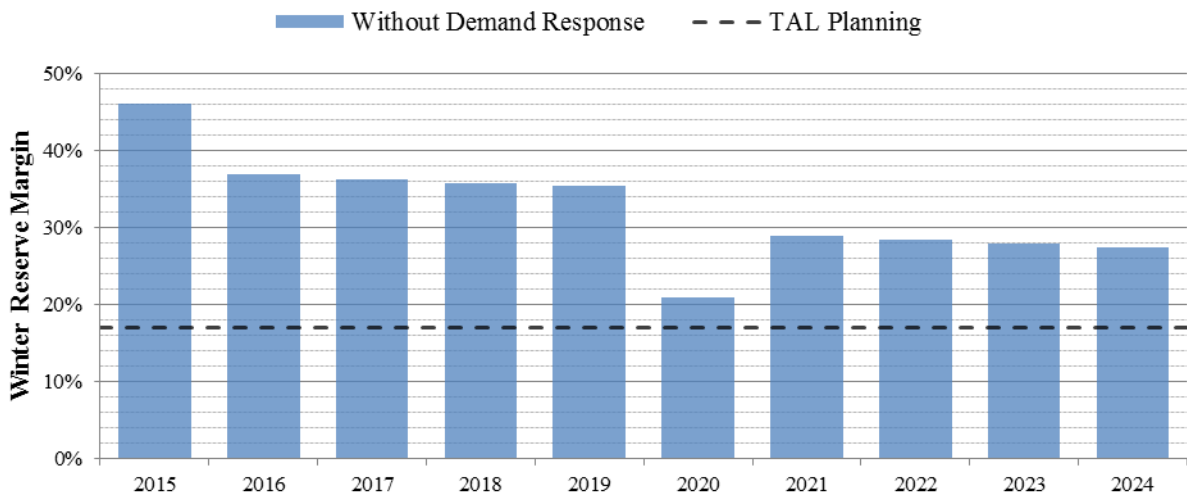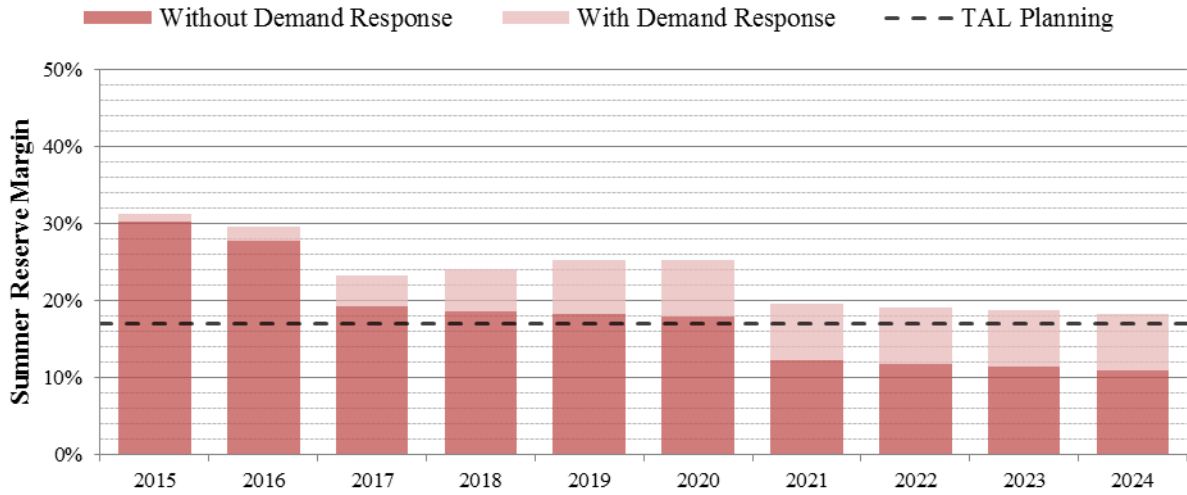

Source: 2015 Ten-Year Site Plan

## Generation Resources

TAL plans multiple unit retirements and a single addition during the planning period, as described in Table 31 below. Several older combustion turbines at two plant sites and a single steam unit, all natural gas-fired, are anticipated to be retired during the planning period. Based upon its current planning, TAL intends to add a new natural gas-fired combustion turbine in 2020.

**Table 31: TAL Generation Resource Changes**

<b>Year</b>	<b>Unit Name</b>	<b>Fuel &amp; Unit Type</b>	<b>Net Capacity (Sum MW)</b>	<b>Notes</b>
<b>Retiring Units</b>				
2016	Hopkins GT1	Natural Gas Combustion Turbine	12	
2016	Purdom GT1 & GT2	Natural Gas Combustion Turbine	20	
2017	Hopkins GT2	Natural Gas Combustion Turbine	24	
2021	Hopkins 1	Natural Gas Steam	76	
<b>Retiring Units Total</b>			<b>132</b>	
<b>New Units</b>				
2021	Hopkins	Natural Gas Combustion Turbine	46	
<b>New Units Total</b>			<b>46</b>	
<b>Net Additions</b>			<b>(86)</b>	

Source: 2015 Ten-Year Site Plan

# APPENDIX A

REVIEW OF THE  
**2015 TEN-YEAR SITE PLANS**  
OF FLORIDA'S ELECTRIC UTILITIES



NOVEMBER 2015



## **Ten-Year Site Plan Comments**

---

### **State Agencies**

- Fish and Wildlife Conservation Commission- General
- Fish and Wildlife Conservation Commission- FPL
- Department of Environmental Protection

### **Regional Planning Councils**

- Treasure Coast Regional Planning Council

### **Water Management Districts**

- Southwest Florida Water Management District

### **Local Governments**

- Brevard County
- Manatee County







Florida Fish and Wildlife Conservation Commission

Commissioners

Brian Yablonski  
Chairman  
Tallahassee

Aliese P. "Liesa" Priddy  
Vice Chairman  
Immokalee

Ronald M. Bergeron  
Fort Lauderdale

Richard A. Corbett  
Tampa

Richard Hanas  
Oviedo

Bo Rivard  
Panama City

Charles W. Roberts III  
Tallahassee

Executive Staff

Nick Wiley  
Executive Director

Eric Sutton  
Assistant Executive Director

Jennifer Fitzwater  
Chief of Staff

Office of the  
Executive Director

Nick Wiley  
Executive Director

(850) 487-3796  
(850) 921-5786 FAX

Managing fish and wildlife resources for their long-term well-being and the benefit of people.

620 South Meridian Street  
Tallahassee, Florida  
32399-1600  
Voice: (850) 488-4676

Hearing/speech-impaired:  
(800) 955-8771 (T)  
(800) 955-8770 (V)

MyFWC.com

July 14, 2015

Mr. Phillip Ellis  
Division of Engineering  
Public Service Commission  
2540 Shumard Oak Boulevard  
Tallahassee, FL 32399-0850  
[pellis@psc.state.fl.us](mailto:pellis@psc.state.fl.us)

RE: Ten-Year Power Plant Site Plans

Dear Mr. Ellis:

Florida Fish and Wildlife Conservation Commission (FWC) staff has reviewed the 2015 Ten-Year Power Plant Site Plans submitted to the Public Service Commission (PSC). We will be providing comments on the Florida Power and Light (FPL) site plan in a subsequent letter. However, we are submitting this letter to notify you that we have reviewed the following plans and have no comments regarding fish and wildlife resources:

- Gainesville Regional Utilities (GRU)
- Jacksonville Energy Authority (JEA)
- Florida Municipal Power Agency (FMPA)
- Gulf Power Company (GULF)
- City of Tallahassee Utilities (TAL)
- Seminole Electric Cooperative (SEC)
- Lakeland Electric (LAK)
- Tampa Electric Company (TECO)
- Orlando Utilities Commission (OUC)
- Duke Energy Florida (DEF)

We appreciate the opportunity to review the Ten-Year Site Plans, as provided by the PSC. If you need further assistance, please do not hesitate to contact Jane Chabre either by phone at (850) 410-5367 or by email at [FWCConservationPlanningServices@MyFWC.com](mailto:FWCConservationPlanningServices@MyFWC.com).

Sincerely,

Jennifer D. Goff  
Land Use Planning Program Administrator  
Office of Conservation Planning Services

jdg/jh  
ENV 2-11-3  
2015 Ten-Year Site Plans\_071415

cc: Moniaishi Mtenga, Florida Public Service Commission, [mmtenga@psc.state.fl.us](mailto:mmtenga@psc.state.fl.us)



July 20, 2015

Florida Fish and Wildlife Conservation Commission

Phillip Ellis
Division of Engineering
Florida Public Service Commission
2540 Shumard Oak Boulevard
Tallahassee, FL 32399-0850
pellis@psc.state.fl.us

Commissioners

Brian Yablonski
Chairman
Tallahassee

Aliese P. "Liesa" Priddy
Vice Chairman
Immokalee

Ronald M. Bergeron
Fort Lauderdale

Richard A. Corbett
Tampa

Richard Hanas
Oviedo

Bo Rivard
Panama City

Charles W. Roberts III
Tallahassee

Executive Staff

Nick Wiley
Executive Director

Eric Sutton
Assistant Executive Director

Jennifer Fitzwater
Chief of Staff

Office of the
Executive Director

Nick Wiley
Executive Director

(850) 487-3796
(850) 921-5786 FAX

Managing fish and wildlife resources for their long-term well-being and the benefit of people.

620 South Meridian Street
Tallahassee, Florida
32399-1600
Voice: (850) 488-4676

Hearing/speech-impaired:
(800) 955-8771 (T)
(800) 955-8770 (V)

MyFWC.com

RE: Florida Power and Light Company, 2015-2024 Ten-Year Power Plant Site Plan, Multiple Counties

Dear Mr. Ellis:

Florida Fish and Wildlife Conservation Commission (FWC) staff has reviewed the 2015-2024 Ten-Year Power Plant Site Plan (Plan) submitted by Florida Power and Light (FPL) and provides the following comments pursuant to Rule 25-22.071, Florida Administrative Code.

FPL's service area contains approximately 27,650 square miles within 35 counties throughout south and northeast Florida. FPL's electrical generating facilities consist of four nuclear facilities, three coal facilities, 15 combined cycle (CC) facilities, five fossil steam facilities, 48 combustion gas turbines (GT), two simple-cycle combustion turbines (CT), and two photovoltaic facilities. FPL's bulk transmission system includes 6,888 circuit miles of overhead and underground transmission lines. Integration of the generation, transmission, and distribution system is achieved through FPL's 569 substations.

Based upon its projection of future resource needs, FPL has identified eight Preferred Sites and three Potential Sites for future generation additions. The sites listed below include a combination of existing and new sites for the development of natural gas combined cycle, combustng turbines, and solar generation facilities.

Preferred Sites:

- 1. Port Everglades Plant, Broward County
2. Babcock Ranch Solar Energy Center, Charlotte County
3. Citrus Solar Energy Center, DeSoto County
4. Manatee Solar Energy Center, Manatee County
5. Lauderdale Plant Peaking Facilities, Broward County
6. Ft. Myers Plant Peaking Facilities, Lee County
7. Okeechobee Site, Okeechobee County
8. Turkey Point Plant, Miami-Dade County

Potential Sites:

- 1. Hendry County

2. Martin County
3. Putnam Plant Site (Putnam County)

FWC staff has previously provided comments on Preferred Sites 2, 3, and 4 during the permitting process. For the remaining sites, FWC staff reviewed our geographic information system data layers to determine the fish and wildlife resource issues that can be addressed prior to permitting or site certification activities. Based on our review, FWC staff offers the following comments for Preferred Site 7 and Potential Site 1.

#### Preferred Site Number 7: Okeechobee Site

FWC staff has met with FPL representatives and the U.S. Fish and Wildlife Service (USFWS) and has participated in initial site visits to discuss potential issues that may be encountered in certifying a new facility in Okeechobee County. The site is located within USFWS consultation areas for the Everglade snail kite (*Rostrhamus sociabilis plumbeus*, Federally Endangered [FE]), Audubon's crested caracara (*Polyborus plancus audubonii*, Federally Threatened [FT]), the Florida scrub jay (*Aphelocoma coerulescens*, FT), and the Florida grasshopper sparrow (*Ammodramus savannarum floridanus*, FE). The site is also within one wood stork (*Mycteria americana*, FT) nesting colony core foraging area (CFA) which constitutes an 18.6-mile radius around the nesting colony. Additionally, the site has potential for the following state- and federally listed species: Eastern indigo snake (*Drymarchon corais couperi*, FT), Sherman's fox squirrel (*Sciurus niger shermani*, State Species of Special Concern), and Florida sandhill crane (*Grus canadensis pratensis*, State Threatened). The Plan states that minimal impacts to federal- or state-listed animals are expected due to the previously disturbed nature of the site and lack of suitable onsite habitat for listed species. FWC staff will continue to work with FPL staff throughout any subsequent approval processes to ensure protection of listed species.

#### Potential Site Number 1: Hendry County

Our initial review indicates that the site is located within the USFWS consultation areas for Audubon's crested caracara (*Polyborus plancus audubonii*, FT), the Everglade snail kite (*Rostrhamus sociabilis plumbeus*, FE), the Florida bonneted bat (*Eumops floridanus*, FE), and the Florida panther (*Puma concolor coryi*, primary and secondary zone FE). The site is within one wood stork nesting colony CFA and the site has potential habitat for the Eastern indigo snake (*Drymarchon corais couperi*, FT).

The site is also located within the primary range for Big Cypress population of Florida black bear (*Ursus americanus floridanus*) (South Bear Management Unit). While the Florida black bear is no longer listed, FWC's Black Bear Management Plan (<http://myfwc.com/media/2612908/bear-management-plan.pdf>) provides measures to avoid negative human-bear interactions during construction and operation of the facility. The Plan states that FPL strives for no adverse impacts on federal- or state-listed animals, acknowledges that the area is considered habitat for the Florida panther, and FPL anticipates minimizing or mitigating for unavoidable wildlife or wetland impacts. FWC staff encourages FPL to work with FWC staff to identify potential fish and wildlife issues by conducting site-specific surveys to identify presence of listed species. FPL may also need to consult with the USFWS to determine the potential for impacts to federally listed species.

We appreciate the opportunity to provide input on this ten-year plan. If you need any further assistance, please do not hesitate to contact Jane Chabre either by phone at (850) 410-5367 or by email at [FWCConservationPlanningServices@MyFWC.com](mailto:FWCConservationPlanningServices@MyFWC.com). If you have specific technical questions regarding the content of this letter, please contact Marissa Krueger at (561) 882-5711 or by email at [Marissa.Krueger@MyFWC.com](mailto:Marissa.Krueger@MyFWC.com).

Sincerely,



Jennifer D. Goff  
Land Use Planning Program Administrator  
Office of Conservation Planning Services

jdg/mk  
ENV 2-11-2  
FPL 2015 Ten-Year Site Plan\_21027\_072015

cc: Moniaishi Mtenga, Florida Public Service Commission, [mmtenga@psc.state.fl.us](mailto:mmtenga@psc.state.fl.us)

**From:** [Bull, Robert \(Bobby\)](#)  
**To:** [Moni Mtenga](#)  
**Cc:** [Mulkey, Cindy](#); [Seiler, Ann](#)  
**Subject:** DEP Siting Coordination Office Ten-Year Site Plan Review  
**Date:** Thursday, July 02, 2015 10:20:23 AM

---

Good morning,

The Department of Environmental Protection's Siting Coordination Office has reviewed the 2015 Ten-Year Site Plans for Florida's Electric Utilities and found the documents to be adequate for planning purposes. Thank you for the opportunity to review and comment on the plans. If you have any questions for our office, feel free to contact me.

Bobby Bull, P.E.  
Florida Department of Environmental Protection  
Siting Coordination Office  
2600 Blair Stone Road, MS 5500  
Tallahassee, FL 32399-2400  
robert.bull@dep.state.fl.us  
850/717-9111





TREASURE COAST REGIONAL PLANNING COUNCIL  
INDIAN RIVER - ST. LUCIE - MARTIN - PALM BEACH

June 23, 2015

Mr. Phillip Ellis  
Division of Engineering  
Florida Public Service Commission  
2540 Shumard Oak Boulevard  
Tallahassee, FL 32399-0850


Subject: 2015 Ten Year Power Plant Site Plans

Dear Mr. Ellis:

Treasure Coast Regional Planning Council has reviewed the ten year power plant site plan prepared by Florida Power and Light Company. Council approved the comments in the attached report at a board meeting on June 19, 2015. The report concludes that the region and all of south Florida continue to remain vulnerable to fuel price increases and supply interruptions, because of the continued heavy reliance on only two primary fuel types, natural gas and nuclear fuel. Council urges FPL and the State of Florida to continue developing new programs to: 1) reduce the reliance on fossil fuels as future energy sources; 2) increase conservation activities to offset the need to construct new power plants; and 3) increase the reliance on renewable energy sources to produce electricity.

Please contact me if you have any questions.

Sincerely,



Peter G. Merritt, Ph.D.  
Assistant Director

Attachment

cc: Amy Brunjes, FPL

*"Bringing Communities Together" • Est. 1976*

421 SW Camden Avenue - Stuart, Florida 34994  
Phone (772) 221-4060 - Fax (772) 221-4067 - [www.tcrpc.org](http://www.tcrpc.org)

# TREASURE COAST REGIONAL PLANNING COUNCIL

## Report on the

### Florida Power & Light Company Ten Year Power Plant Site Plan 2015-2024

June 19, 2015

#### Introduction

Each year every electric utility in the State of Florida produces a ten year site plan that includes an estimate of future electric power generating needs, a projection of how those needs will be met, and disclosure of information pertaining to the utility's preferred and potential power plant sites. The Florida Public Service Commission (FPSC) has requested that Council review the most recent ten year site plan prepared by Florida Power & Light Company (FPL). The purpose of this report is to summarize FPL's plans for future power generation and provide comments for transmittal to the FPSC.

#### Summary of the Plan

The plan indicates that total summer peak demand is expected to grow by 15.0 percent from 23,286 megawatts (MW) in 2015 to 26,771 MW in 2024. During the same period, FPL is expecting to reduce electrical use through demand side management programs, which include a number of conservation, energy efficiency, and load management initiatives. FPL's demand side management programs are expected to grow by 22.5 percent from 1,951 MW in 2015 to 2,389 MW in 2024. After FPL's demand side management efforts are factored in, FPL will still require additional capacity from conventional power plants to meet future electrical demand (Exhibit 1). FPL is proposing to add a total of about 2,767 MW of summer capacity to its system from 2015 to 2024. FPL plans to obtain additional electricity through: 1) power purchases from qualifying facilities, utilities, and other entities; 2) upgrades to existing facilities; 3) modernization of existing FPL facilities; and 4) construction of new generating units. Major additions of new generating capacity are as follows:

- 2016 – place in service the Port Everglades Next Generation Clean Energy Center (1,237 MW) in the City of Hollywood;
- 2017 – place in service five new combustion turbines to replace gas turbines at the Lauderdale site (1,155 MW) in Broward County;
- 2019 – place in service the Okeechobee Next Generation Clean Energy Center (1,622 MW) in Okeechobee County; and
- 2023 – place in service a new combined cycle power plant (1,317 MW) (not sited).

Based on the projection of future resource needs, FPL has identified the following eight preferred sites for future power generating facilities:

1. Port Everglades Plant, Broward County
2. Babcock Ranch Solar Energy Center, Charlotte County

3. Citrus Solar Energy Center, DeSoto County
4. Manatee Solar Energy Center, Manatee County
5. Lauderdale Plant Peaking Facilities, Broward County
6. Fort Myers Plant Peaking Facilities, Lee County
7. Okeechobee Site, Okeechobee County
8. Turkey Point Plant, Miami-Dade County

Also, FPL has identified 3 potential sites for new or expanded power generating facilities. The identification of potential sites does not represent a commitment by FPL to construct new power generating facilities at these sites. The potential sites include:

1. Hendry County
2. Martin County
3. Putnam Plant Site, Putnam County

The ten year site plan describes six factors that have impacted or could impact FPL's resource plan. These factors include:

1. Maintaining/enhancing fuel diversity in the FPL system.
2. Maintaining a balance between load and generating capacity in southeastern Florida, particularly in Miami-Dade and Broward counties.
3. Maintaining an appropriate balance of demand side management and supply resources to achieve system reliability.
4. The impact of federal and state energy efficiency codes and standards on FPL's projected demand and energy load forecasts.
5. The increasing cost competitiveness of utility-scale photovoltaic (PV) facilities due to the continued decline of the cost of PV modules.
6. New environmental regulations, particularly from the U.S. Environmental Protection Agency's proposed Clean Power Plan issued in June 2014.

### Evaluation

One of the main purposes of preparing the ten year site plan is to disclose the general location of proposed power plant sites. The FPL ten year site plan identifies no preferred sites and one potential site for future power generating facilities in the Treasure Coast Region (Exhibit 2). The only potential site identified in the Treasure Coast Region is Martin County. The plan indicates FPL is currently evaluating potential sites in Martin County for a future PV facility. No specific locations have been selected at this time.

One preferred site, the Okeechobee site is located in northeastern Okeechobee County directly adjacent to Indian River County. The ten year site plan indicates that FPL owns 2,800 acres at this site. FPL plans to use approximately 200 acres of this land for development of a natural gas-fired combined cycle unit at this site. Natural gas is expected to be supplied by an existing pipeline as well as a future pipeline. The Florida Southeast Connection pipeline project is currently in the process of obtaining approval from the Federal Energy Regulatory Commission. The ten year site plan also indicates that the Okeechobee site is one of the most likely sites to be



used for future large-scale solar using PV generation facilities. FPL representatives have indicated that they are coordinating with Indian River County staff regarding possible impacts to the county.

A change in the 2015 ten year site plan is that FPL no longer has plans to acquire the City of Vero Beach's electric system. In early 2013, FPL came to an agreement with the City of Vero Beach to purchase the city's electric utility system. However, lack of progress among negotiating parties has resulted in uncertainty regarding whether FPL will provide electric load to the city. As a result, the 2015 ten year site plan does not include electric service to Vero Beach in its load forecast.

The ten year site plan indicates that fossil fuels will be the primary source of energy used to generate electricity by FPL during the next 10 years (Exhibit 3). The plan indicates fossil fuels will account for 70.3 percent (3.5 percent from coal, 0.1 percent from oil, and 66.7 percent from natural gas) of FPL's electric generation in 2015. The plan predicts fossil fuels will account for 74.9 percent (2.3 percent from coal, 0.1 percent from oil, and 72.5 percent from natural gas) of FPL's electric generation in 2024. During the same period, nuclear sources are predicted to change from 23.2 percent in 2015 to 21.5 percent in 2024. Solar sources are predicted to increase from 0.2 percent in 2015 to 0.5 percent in 2024.

### Renewable Energy

This is the first FPL 10 year site plan to indicate that the generation of solar energy is now competitive on FPL's system at specific sites. FPL has concluded from its research programs that utility-scale PV applications are the most economical way to utilize solar energy. Their analysis suggests that utility-scale PV is at least twice as economical on an installed \$/kw basis compared to distributed PV systems. Utility-scale PV facilities have become cost competitive due to the continued decline of the cost of PV modules. However, utility-scale PV is only cost effective at specific sites that have advantages at this time. In future years, other sites may become cost-effective and added to the plan, especially if PV costs continue to decline. FPL plans to pursue solar energy in three ways, including 1) utility-scale PV facilities; 2) a community-based solar partnership pilot program; and 3) a commercial and industrial partnership pilot program. These programs are described below.

**Utility-scale PV Facilities.** FPL is planning to add three new PV facilities by the end of 2016. These are the Babcock Ranch Solar Energy Center in Charlotte County, Citrus Solar Energy Center in DeSoto County, and Manatee Solar Energy Center in Manatee County. Each of the PV facilities will be approximately 74.5 MW. These new facilities will be in addition to the existing Martin Next Generation Solar Energy Center (75 MW) in Martin County, the DeSoto Next Generation Solar Energy Center (25 MW) in DeSoto County, and the Space Coast Next Generation Solar Energy Center (10 MW) in Brevard County. The new facilities will increase FPL's solar generation capacity from its current 110 MW to approximately 333 MW. The economics of these projects are aided by the fact that the sites are located close to existing electric infrastructure, including transmission lines and electric substations, and by the fact that bringing these solar facilities into service prior to the end of 2016 will allow the facilities to take advantage of investment tax credits that are scheduled to be reduced in 2017.

**Community-based Solar Partnership Pilot Program.** FPL is introducing a voluntary solar pilot program to provide customers with an additional and flexible opportunity to support development of solar power in Florida. This pilot program will provide all customers the opportunity to support the use of solar energy at a community scale and is designed for customers who do not wish, or are not able, to place solar equipment on their roof. Customers can participate in the program through voluntary contributions of \$9/month starting in mid-2015. The voluntary contribution is required because the cost per MW to construct this type of distributed generation scale facility is approximately double the cost of utility scale facilities. Also, the operation and maintenance costs of these facilities are expected to be three times as much as for utility-scale PV systems.

The first 200 kW PV projects under this pilot program will be built by FPL in the first half of 2015 at locations in the City of West Palm Beach and in Broward County. Additional PV facilities under this program will be built when the projected voluntary contributions are sufficient to cover on-going program costs without increasing electric rates for all customers. The locations of additional PV facilities have not yet been determined. FPL estimates that the project could result in approximately 2 MW of community-located PV installations supported by over 10,000 customer participants by the end of the three-year pilot program.

**Commercial and Industrial Partnership Pilot Program.** This pilot program will be conducted in partnership with interested commercial and industrial customers over about a five year period. Limited investments will be made in PV facilities located at customer sites in selected geographic areas of FPL's service territory. The objective of this portion of the pilot program is to examine the effect of high penetration of distributed generation PV on FPL's distribution system and to determine how best to address any problems that may be identified. FPL will site approximately 5 MW of PV facilities in areas where distributed generation PV already exists to better study feeder loading impacts. PV installations at Daytona International Speedway and Florida International University's (FIU) Engineering Center campus in West Miami-Dade County have been selected based on their interconnection with targeted circuits. In addition, this pilot program will also install a battery storage facility of approximately 1 MW capacity. A multi-year research partnership agreement has been executed with FIU to assist FPL in research and development of battery storage.

### Conclusion

The region and all of south Florida continue to remain vulnerable to fuel price increases and supply interruptions, because of the continued heavy reliance on only two primary fuel types, natural gas and nuclear fuel. The 2015 ten year site plan does project an increase in the generation of renewable energy, with the addition of three new solar PV facilities by the end of 2016. However, Council remains concerned that the ten year site plan does not project a significant increase in the use of renewable energy during the next decade. During the 10-year planning horizon, the use of natural gas is projected to rise from 66.7 percent to 72.5 percent, while solar is projected to rise from 0.2 percent to 0.5 percent. Council recommends that FPL adopt a more balanced portfolio of fuels that includes a significant component of renewable energy sources. Council continues to encourage the Florida Legislature to adopt a Renewable

Portfolio Standard in order to provide a mechanism to expand the use of renewable energy in Florida.

Council supports FPL's existing and proposed solar projects and encourages FPL to develop additional projects based on renewable resources. FPL should consider developing other programs to install, own, and operate PV units on the rooftops of private and public buildings. The shift to rooftop PV systems distributed throughout the area of demand could reduce reliance on large transmission lines and reduce costs associated with owning property; purchasing fuel; and permitting, constructing, and maintaining a power plant. Another advantage of this strategy is that PV systems do not require water for cooling. The incentive for owners of buildings to participate in this strategy is they could be offered a reduced rate for purchasing electricity. Also, FPL should consider expanding solar rebate programs for customers who install PV and solar water heating systems on their homes and businesses. These rebates should be coordinated with other programs, such as the Solar and Energy Loan Fund (SELF) and Property-Assessed Clean Energy (PACE) programs, to provide participants in these programs the option of receiving a rebate. SELF is a low interest rate loan program that provides financing for clean energy solutions. PACE programs allow property owners to finance energy retrofits by placing an additional tax assessment on the property in which the investment is made.

Council urges FPL and the State of Florida to continue developing new programs to: 1) reduce the reliance on fossil fuels as future energy sources; 2) increase conservation activities to offset the need to construct new power plants; and 3) increase the reliance on renewable energy sources to produce electricity. The complete costs of burning fossil fuels, such as the costs to prevent environmental pollution and costs to the health of the citizens, need to be considered in evaluating these systems. State legislators should amend the regulatory framework to provide financial incentives for the power providers and the customers to increase conservation measures and to rely to a greater extent on renewable energy sources. Also, the state should reconsider the currently used test for energy efficiency and choose a test that will maximize the potential for energy efficiency and renewable energy sources. The phasing in of PV and other locally available energy sources will help Florida achieve a sustainable future.

Attachments

# EXHIBIT 1

**Table ES-1: Projected Capacity & Firm Purchase Power Changes**

Year *	Projected Capacity & Firm Purchase Power Changes	Summer MW	Date	Summer Reserve Margin **
2015	Turkey Point	(22)	January-15	
	Fort Myers	(5)	January-15	
	Lauderdale GT	(8)	January-15	
	Lauderdale GT	(8)	January-15	
	Port Everglades GT	(8)	January-15	
	Palm Beach SWA - additional firm capacity	70	June-15	
	Martin	(3)	June-15	
	Scherer	(9)	June-15	
	<b>Total of MW changes to Summer firm capacity:</b>	<b>6</b>		<b>25.7%</b>
2016	Cedar Bay -PPA retirement	(250)	October-15	
	Cedar Bay -FPL Ownership	250	October-15	
	LPS Replacement	(928)	December-15	
	Fort Myers 2	37	June-16	
	Fort Myers GTs 1 -10	(540)	June-16	
	Lauderdale GTs 1- 12	(412)	June-16	
	Martin	2	June-16	
	Port Everglades Next Generation Clean Energy Center	1,237	June-16	
	Sanford	3	June-16	
	<b>Total of MW changes to Summer firm capacity:</b>	<b>(601)</b>		<b>21.3%</b>
2017	Babcock Solar Energy Center (Charlotte) ***	38	September-16	
	Citrus Solar Energy Center (DeSoto) ***	38	September-16	
	Manatee Solar Energy Center ***	38	September-16	
	Lauderdale GTs 13- 22	(343)	October-16	
	Turkey Point Unit 1 synchronous condenser	(398)	October-16	
	Port Everglades GTs	(412)	December-16	
	Cedar Bay	(250)	December-16	
	Lauderdale GTs - 5 CT	1,155	December-16	
	Fort Myers GTs - 2 CT	482	December-16	
	Fort Myers 3A&B - upgraded	50	December-16	
	Martin	2	January-17	
	Sanford	1	January-17	
	Sanford	4	January-17	
	Turkey Point #5	23	June-17	
Manatee	4	June-17		
	<b>Total of MW changes to Summer firm capacity:</b>	<b>415</b>		<b>20.9%</b>
2018	Unspecified Short-Term Purchase	207	May-18	
	Turkey Point Nuclear Unit #3	20	June-18	
	Turkey Point Nuclear Unit #5	3	June-18	
	<b>Total of MW changes to Summer firm capacity:</b>	<b>227</b>		<b>20.0%</b>
2019	Unspecified Short-Term Purchase	(207)	September-18	
	SJRPP suspension of energy	(382)	2 <sup>nd</sup> Quarter	
	Turkey Point Nuclear Unit #4	20	June-19	
	Okeechobee Next Generation Clean Energy Center ****	1,622	June-19	
	<b>Total of MW changes to Summer firm capacity:</b>	<b>1,053</b>		<b>22.8%</b>
2020	---	---	---	
	<b>Total of MW changes to Summer firm capacity:</b>	<b>0</b>		<b>21.3%</b>
2021	Eco-Gen PPA firm capacity	180	January-21	
	Cape Next Generation Clean Energy Center	88	June-21	
	<b>Total of MW changes to Summer firm capacity:</b>	<b>268</b>		<b>22.0%</b>
2022	Riviera Beach Next Generation Clean Energy Center	86	June-22	
	<b>Total of MW changes to Summer firm capacity:</b>	<b>86</b>		<b>20.9%</b>
2023	Unalut CC	1,317	June-23	
	<b>Total of MW changes to Summer firm capacity:</b>	<b>1,317</b>		<b>24.4%</b>
2024	---	---	---	
	<b>Total of MW changes to Summer firm capacity:</b>	<b>0</b>		<b>22.2%</b>


\* Year shown reflects when the MW change begins to be accounted for in Summer reserve margin calculations.

\*\* Winter Reserve Margins are typically high than Summer Reserve Margin. Winter Reserve Margin are shown on Schedule 7.2 in Chapter II.

\*\*\* MW values shown represent the firm capacity assumption for each 74.5 MW nameplate (AC) PV facility.

\*\*\*\* The Okeechobee generating is FPL's best self-build option for 2019. During 2015 it will be evaluated versus

# EXHIBIT 2 Treasure Coast Region Significant Energy Facilities

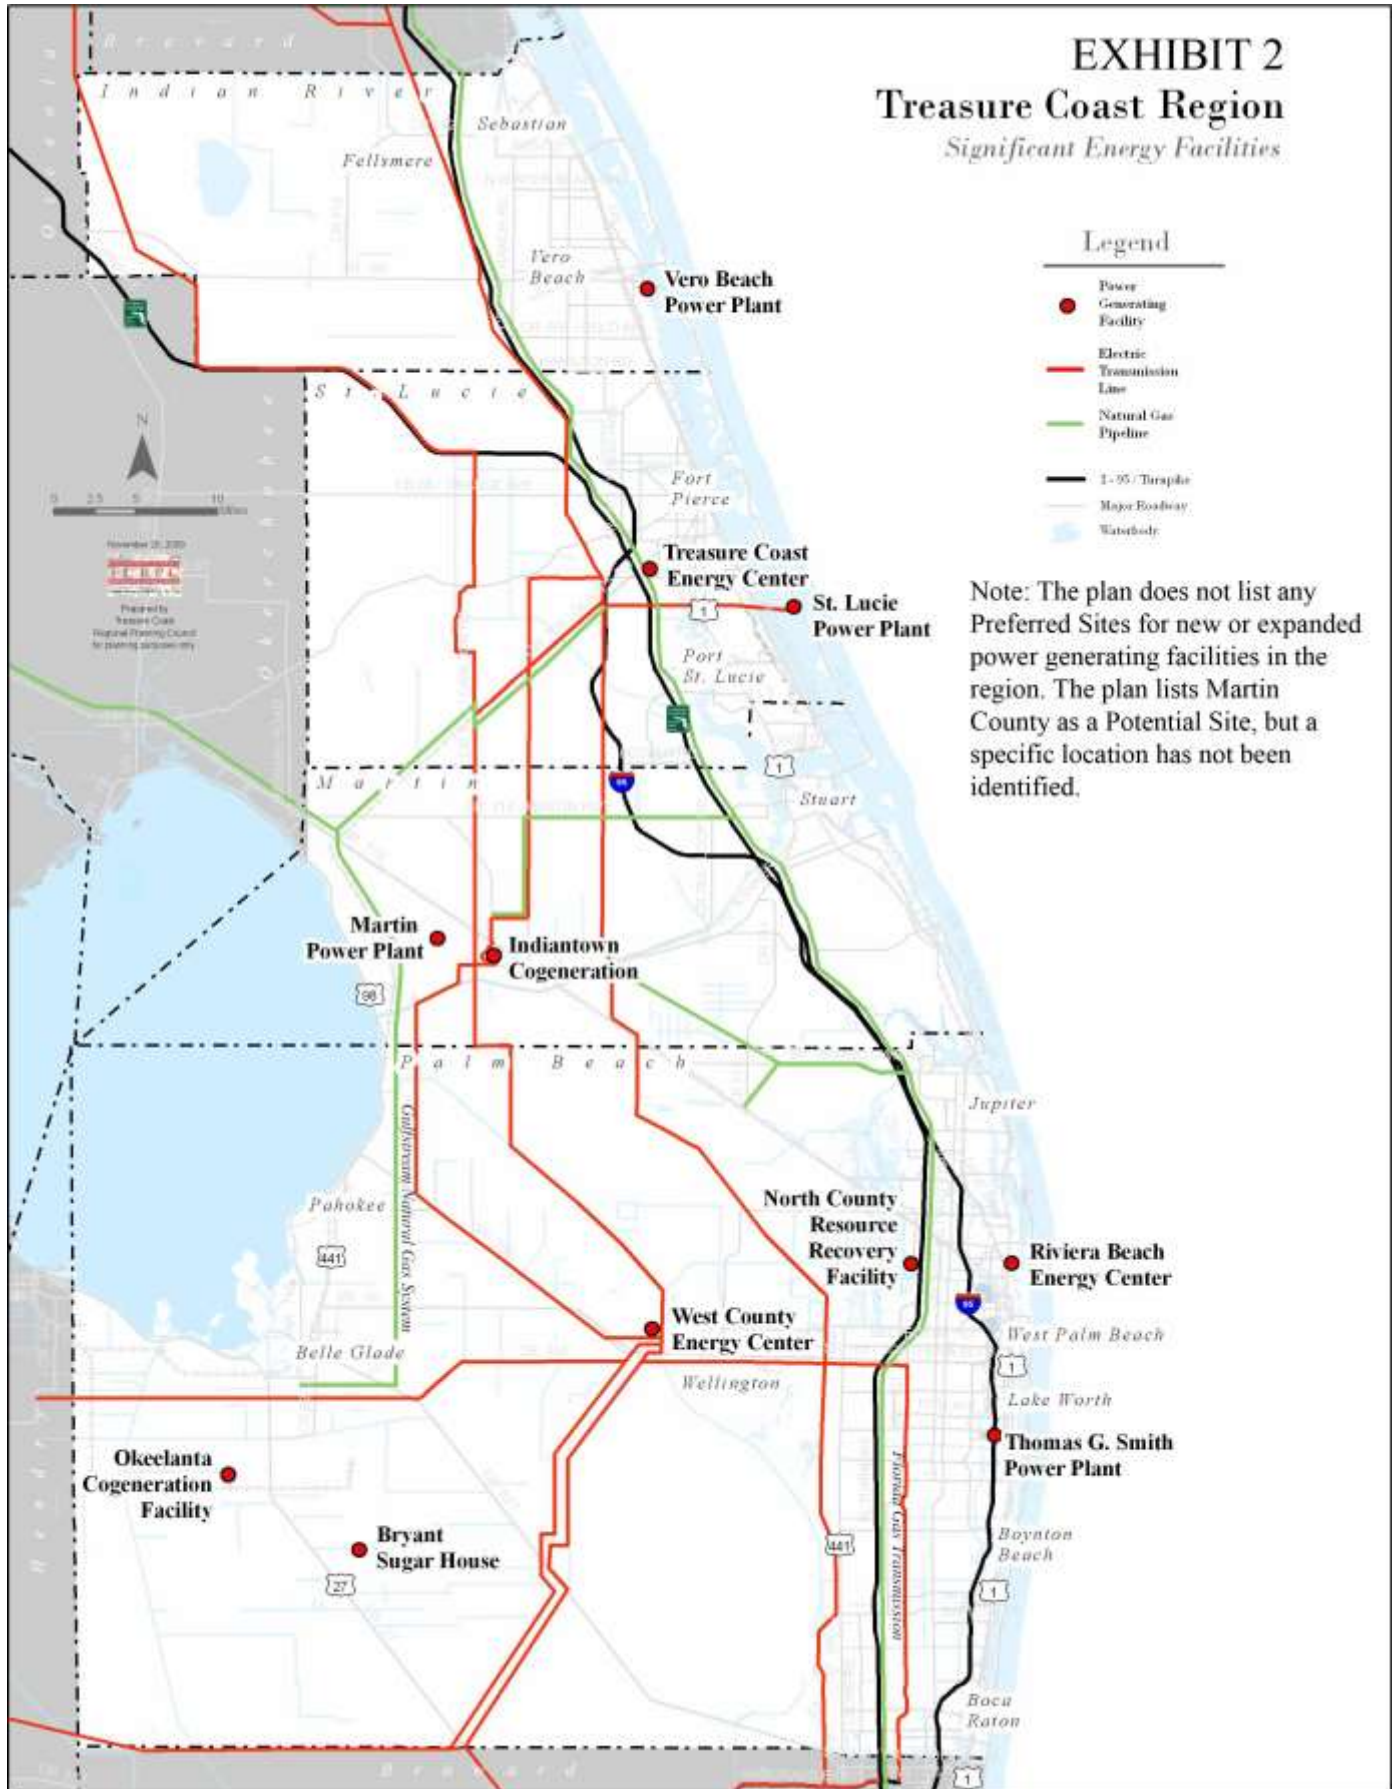

# EXHIBIT 3

Schedule 6.2  
Energy Sources % by Fuel Type

Energy Source	Units	Actual <sup>1/</sup>		Forecasted									
		2013	2014	2016	2015	2017	2018	2019	2020	2021	2022	2023	2024
(1) Annual Energy interchange <sup>2/</sup>	%	4.0	4.2	3.0	1.0	0.9	1.0	0.2	0.0	0.0	0.0	0.0	0.0
(2) Nuclear	%	22.6	23.1	23.2	23.3	22.8	22.7	22.9	22.3	22.1	22.3	21.8	21.5
(3) Coal	%	5.4	3.8	3.5	3.1	2.7	2.6	2.9	2.4	2.6	2.5	2.5	2.3
(4) Residual (FO6) -Total	%	0.1	0.2	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
(5) Steam	%	0.1	0.2	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
(6) Distillate (FO2) -Total	%	0.1	0.1	0.0	0.1	0.0	0.0	0.1	0.0	0.0	0.1	0.1	0.1
(7) Steam	%	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
(8) CC	%	0.1	0.1	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.1	0.1	0.1
(9) CT	%	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
(10) Natural Gas -Total	%	67.4	68.2	66.7	69.2	64.0	64.1	69.5	71.7	71.7	71.3	71.9	72.5
(11) Steam	%	2.2	1.6	1.1	1.0	0.4	0.5	0.8	0.8	0.6	0.7	0.6	0.4
(12) CC	%	64.8	66.3	65.7	68.1	63.3	63.1	67.5	70.3	70.6	70.0	70.6	71.7
(13) CT	%	0.4	0.3	0.0	0.1	0.4	0.5	1.1	0.6	0.5	0.6	0.7	0.4
(14) Solar <sup>3/</sup>	%	0.1	0.2	0.2	0.3	0.6	0.6	0.5	0.5	0.5	0.5	0.5	0.5
(15) PV	%	0.1	0.1	0.1	0.2	0.5	0.5	0.5	0.4	0.4	0.4	0.4	0.4
(16) Solar Thermal	%	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1
(17) Other <sup>4/</sup>	%	0.4	0.1	3.2	2.8	9.0	9.0	3.8	3.0	3.0	3.1	3.1	3.1
		100	100	100	100	100	100	100	100	100	100	100	100

1/ Source: A Schedules and Actual Data for Next Generation Solar Centers Report.

2/ The projected figures are based on estimated energy purchases from SJRPP, the Southern Companies (UPS contract), and other utilities.

3/ Represents output from FPL's PV and solar thermal facilities.

4/ Represents a forecast of energy expected to be purchased from Qualifying Facilities, Independent Power Producers, net of Economy and other Power Sales.



An Equal Opportunity Employer

# Southwest Florida Water Management District

2379 Broad Street, Brooksville, Florida 34604-6899

(352) 796-7211 or 1-800-423-1476 (FL only)

WaterMatters.org

### Bartow Service Office

170 Century Boulevard  
Bartow, Florida 33830-7700  
(863) 534-1448 or  
1-800-492-7862 (FL only)

### Sarasota Service Office

6750 Fruitville Road  
Sarasota, Florida 34240-9711  
(941) 377-3722 or  
1-800-320-3503 (FL only)

### Tampa Service Office

7601 U.S. 301 North (Fort King Highway)  
Tampa, Florida 33637-6759  
(813) 985-7481 or  
1-800-836-0797 (FL only)

**Michael A. Babb**  
Chair, Hillsborough

**Randall S. Maggard**  
Vice Chair, Pasco

**Jeffrey M. Adams**  
Secretary, Pinellas

**David W. Dunbar**  
Treasurer, Hillsborough, Pinellas

**Carlos Beruff**  
Former Chair, Manatee

**H. Paul Senft, Jr.**  
Former Chair, Polk

**Ed Armstrong**  
Pinellas

**Bryan K. Beswick**  
DeSoto, Hardee, Highlands

**Thomas E. Bronson**  
Hernando, Marion

**Wendy Griffin**  
Hillsborough

**George W. Mann**  
Polk

**Michael A. Moran**  
Charlotte, Sarasota

**Vacant**  
Citrus, Lake, Levy, Sumter

**Robert R. Beltran, P.E.**  
Executive Director

July 9, 2015

Mr. Moniaishi Mtenga, Engineering Specialist  
Division of Engineering  
Florida Public Service Commission  
2540 Shumard Oak Boulevard  
Tallahassee, FL 32399-0850

## Subject: Electric Utility 2015 Ten-Year Site Plans

Dear Mr. Mtenga:

In response to your request, the Southwest Florida Water Management District (District) has completed its review of the 2015 Ten-Year Site Plans (Site Plans) for Duke Energy Florida (DEF), Tampa Electric Company (TECO), Florida Power and Light (FPL), and Seminole Electric Company (SEC). The District's review is being conducted pursuant to Section 186.801(2)(e), Florida Statutes, which requires that the Public Service Commission consider "the views of the appropriate water management district as to the availability of water and its recommendation as to the use by the proposed plant of salt water or fresh water for cooling purposes."

### Forecast of Facilities Requirements

The following information was provided by the utilities in their respective Site Plans:

- DEF indicates that new combined cycle units are proposed in 2018 adjacent to the Crystal River Site. The Certification Order for these units was recently issued by the DEP Secretary. DEF also indicates that four combustion turbine units are proposed at undesignated sites in 2024.
- TECO indicates that conversion of the Polk Power Station's simple cycle combustion turbines (Units 2-5) to a waste heat recovery natural gas combined cycle unit is underway and is scheduled for completion in 2017. In addition, a new combustion turbine is proposed in 2021 at an undesignated site.
- FPL indicates that only solar photovoltaic facilities are proposed within the District's jurisdictional boundaries over the ten-year planning horizon. A small quantity of water is necessary for occasional cleaning of solar panels. Potable water would be used for this purpose or water obtained from a tank trucked to the site.

Mr. Moniaishi Mtenga, Engineering Specialist

July 9, 2015

Page 2

- SEC indicates that a new combined cycle plant is proposed in 2021 at an undesignated site. In addition, three new combustion turbine units are proposed in 2022, 2023, and 2024 at undesignated sites. According to SEC, the final decision as to whether to construct and own these additional facilities will be based upon future economic studies.

### District Comments


The District offers the following general technical assistance comments:

- The most water conserving practices must be used in all processes and components of the power plant's water use that are environmentally, technically and economically feasible for the activity, including reducing water losses, recycling, and reuse. If a lower quality water is available and is environmentally, technically and economically feasible for all or a portion of the proposed use, this lower quality water must be used.
- For new generating facilities proposed in the southern and much of the central portions of the District, there are additional water use constraints. These areas have been designated as Water Use Caution Areas. This designation has occurred in response to water resource impacts, such as salt water intrusion, lowered water levels in lakes and wetlands, and reduced stream flows, which have been caused by excessive ground water withdrawals. Regional recovery strategies are being implemented to address these adverse water resource impacts. Consequently, the District has heightened concerns regarding potential impacts due to additional water withdrawals.

Early coordination with the District's Water Use Permit (WUP) staff is encouraged prior to submittal of any Site Certification or WUP applications. For assistance or additional information concerning the District's WUP program, please contact Claire Muirhead, WUP Evaluation Manager in the District's Tampa Service Office, at (813) 985-7481, extension 6533, or [claire.muirhead@watermatters.org](mailto:claire.muirhead@watermatters.org).

We appreciate this opportunity to participate in the review process. If you have any questions or require further assistance, please do not hesitate to contact me at (352) 796-7211, extension 4790, or [james.golden@watermatters.org](mailto:james.golden@watermatters.org).

Sincerely,



James J. Golden, AICP  
Senior Planner

JG

C: Claire Muirhead, SWFWMD



**From:** [Ragain, Rebecca](#)  
**To:** [Moni Mtenga](#)  
**Cc:** [Sobrino, Robin M](#)  
**Subject:** FW: Review of Ten Year Site Plans for Florida's Electric Utilities  
**Date:** Wednesday, July 15, 2015 2:21:37 PM

---

Mr. Mtenga,

Brevard County has reviewed the relevant Ten-Year Site Plan identified below and has no comment on the plan. Thank you for the opportunity for Brevard County to review the 2015 Ten-Year Site Plans.

*Rebecca Ragain, AICP*

Planning and Development Department  
2725 Judge Fran Jamieson Way, Building A  
Viera, FL 32940  
321-633-2065 Ext. 52632

---

**From:** Moni Mtenga [<mailto:MMtenga@PSC.STATE.FL.US>]  
**Sent:** Monday, July 06, 2015 10:59 AM  
**To:** Sobrino, Robin M  
**Subject:** Review of Ten Year Site Plans for Florida's Electric Utilities

Dear Robin Sobrino

Pursuant to Section 186.801, Florida Statutes, the Florida Public Service Commission (Commission) is responsible for reviewing and classifying each electric utility's Ten-Year Site Plan as "suitable" or "unsuitable." As part of the annual review in accordance with Rule 25-22.071, Florida Administrative Code, the Commission must provide a copy of the relevant Ten-Year Site Plans and solicit the views of the appropriate state, regional, and local agencies. To this end, the Commission has made available on its website electronic copies of the 2015 Ten-Year Site Plans for all the Florida electric utilities at the following link:

<http://www.psc.state.fl.us/utilities/electricgas/10yrsiteplans.aspx>

Below is a list of those electric utilities that have identified preferred or potential plant sites in your jurisdiction. Please review these Ten-Year Site Plans and provide comments, along with a brief summary if possible, on their suitability as planning documents. Please note that these plans are not designed to give information about proposed facilities in such detail as would be required for a development permit or other formal process.

**Relevant Ten-Year Site Plans**

Orlando Utilities Commission
------------------------------

Please forward all comments by September 30, 2015, including an electronic copy to my email address below. If you have any questions, require additional time to file comments, or would like to receive a hardcopy of the Ten-Year Site Plans, please feel free to contact me by phone at (850) 413-6586 or by email ([mmtenga@psc.state.fl.us](mailto:mmtenga@psc.state.fl.us)) or Phillip Ellis by phone at (850) 413-6626 or

by email ([pellis@psc.state.fl.us](mailto:pellis@psc.state.fl.us)). Thank you for your assistance.

***Moniaishi Mtenga***

Engineering Specialist

Division of Engineering

Florida Public Service Commission

[mmtenga@psc.state.fl.us](mailto:mmtenga@psc.state.fl.us)

850-413-6586 (W)

"Under Florida Law, email addresses are Public Records. If you do not want your e-mail address released in response to public record requests, do not send electronic mail to this entity. Instead, contact this office by phone or in writing."



**Building & Development Services  
Administration  
P. O. Box 1000  
Bradenton, Florida 34206  
Phone: (941) 748-4501  
[www.mymanatee.org](http://www.mymanatee.org)**

August 4, 2015

Moniaishi Mtenga  
Engineering Specialist  
Division of Engineering  
Florida Public Service Commission  
[mmtenga@psc.state.fl.us](mailto:mmtenga@psc.state.fl.us)

RE: Ten Year Site Plans for Florida's Electric Utilities – FPL

Dear Moniaishi Mtenga:

Manatee County is identified in the FPL plan for a new photovoltaic (PV) facility on the existing FPL Parrish Power Plant property by the end of 2016. The site plan for this project has been going through our public hearing process, with a positive staff recommendation.

The Planning Commission approved the site plan this month and the next public hearing is with our Board of County Commissioners scheduled for August 6, 2015. This is an exciting project for Manatee County.

The ten-year plan does not identify any other areas of Manatee County for expansion. However, it's important for our future infrastructure planning that FPL works with Manatee County as early as possible in terms of any upgrades to poles and transmission lines.

Specifically, upgrading existing poles to the larger and concrete type affect our ability to provide future infrastructure services in developing areas. In some instances, the installation of these poles has conflicted with our future infrastructure planning efforts with our utility master planning and road improvement planning.

We would like to work closer with FPL and share our own plans early on. I believe we share a common goal of expanding our respective infrastructure and services more efficiently to serve future customers.

We look forward to working with FPL in the future and will be in touch to schedule a meeting with staff involved in infrastructure planning for a status update. Thank you.

Sincerely,

John Osborne, AICP  
Planning Official

cc: Ed Hunzeker, County Administrator  
Dan Schlandt, Deputy County Administrator  
Karen Windon, Deputy County Administrator  
John R. Barnott, Director, Building & Development Services  
Ron Schulhofer, Director, Public Works Department  
Mike Gore, Director, Utilities  
Charlie Hunsicker, Director, Parks & Natural Resources  
Charlie Bishop, Director, Property Management  
Sia Mollanazar, Deputy Director Engineering Services  
Sage Kamiya, Deputy Director, Traffic Management  
Jeff Streitmatter, Project Management Division Manager  
Chris Mowbray, Highway Engineering Division Manager  
Clarke Davis, Transportation Planning Manager